



## CONSOLIDATED COMMISSION ON UTILITIES

Guam Power Authority | Guam Waterworks Authority  
P.O. Box 2977 Hagatna, Guam 96932 | (671) 648-3002 | [guamccu.org](http://guamccu.org)

### GUAM WATERWORKS AUTHORITY WORK SESSION

*CCU Conference Room*

4:00 p.m., October 17, 2017

#### AGENDA

#### 1. ISSUES FOR DECISION

- 1.1 Relative to the Creation and Addendum of Certified, Technical and Professional (CTP) List of Positions and to Adopt CCU Resolution No. 2012-49 as an Approved Business Process for Guam Waterworks Authority / Resolution No. 01-FY2018
- 1.2 Relative to the Adoption of the 2017 Market Update and the Approval to Migrate to the 10<sup>th</sup> Market Percentile for the Guam Waterworks Authority's / Resolution No. 02-FY2018
- 1.3 Relative to Approving the Construction Management Contract for Tumon No. 2, Hyundai, and Chaot No. 2 Tank and Systems Upgrades / Resolution No. 03-FY2018

#### 2. GM REPORT

#### 3. ISSUES FOR DISCUSSION

#### 4. DIVISION REPORTS

- 4.1 Communications
- 4.2 Compliance & Safety
- 4.3 Customer Service
- 4.4 Engineering
- 4.5 Finance
- 4.6 Operations

#### 5. ANNOUNCEMENTS

- 5.1 Next CCU Meetings: GPA Work Session 10/19/17; CCU Meeting: 10/20/17

#### 6. ADJOURNMENT



**GUAM WATERWORKS AUTHORITY**

*"Better Water, Better Lives."*

Gloria B. Nelson Public Service Building | 688 Route 15 | Mangilao, Guam 96913

Tel: (671) 300-6846

### **Issues for Decision**

#### **Resolution No. 01-FY2018 (Formerly Resolution No. 53-FY2017)**

Relative to the Creation and Addendum of Certified, Technical and Professional (CTP) List of Positions and to Adopt CCU Resolution No. 2012-49 as an Approved Business Process for Guam Waterworks Authority

#### **What is the project's objective and is it necessary and urgent?**

The objectives are to provide for the integration of previously non-CTP positions for which specific knowledge of utility systems and/or operations is required, into the list of CTP positions; and, we request the Board's approval of the proposed creation of positions and the addition of the previously non-CTP positions to the list of CTP positions. These actions are necessary to maintain uniformity in the application of the promotion/demotion/transfer pay policy relative to CCU Resolution No. 2012-49 for all CTP positions covered under the Strategic Pay Scale, and to apply CCU Resolution No. 2012-49 to GWA business processes.

The matters covered under this resolution are necessary and urgent to address the obsolete pay grades that were in place since 2007 and to allow for a refit and reset of the new pay grades that will coincide with the 2017 market data.

#### **Where is the location?**

Within the Guam Waterworks Authority

#### **How much will it cost?**

There is no cost to create and adopt the Resolution.

#### **When will it be completed?**

Upon approval by the CCU, the transition is anticipated to take effect January 1, 2018.

#### **What is the funding source?**

N/A

#### **The RFP/BID responses:**

N/A



**CONSOLIDATED COMMISSION ON UTILITIES**  
Guam Power Authority | Guam Waterworks Authority  
P.O. Box 2977 Hagatna, Guam 96932 | (671)649-3002 | guamccu.org

**RESOLUTION NO. 01-FY2018**

**RELATIVE TO THE CREATION AND ADDENDUM OF CERTIFIED, TECHNICAL,  
AND PROFESSIONAL (CTP) LIST OF POSITIONS AND TO ADOPT CCU  
RESOLUTION NO. 2012-49 AS AN APPROVED BUSINESS PROCESS FOR GUAM  
WATERWORKS AUTHORITY**

**WHEREAS**, Section 8104 (c), Chapter 8, and Section 14104 (c), Chapter 14 of Title 12 of the Guam Code Annotated authorizes the Guam Waterworks Authority to establish its internal organization and management and adopt regulations for the administration of its operations; and

**WHEREAS**, under 12 G.C.A. § 14105, the Consolidated Commission on Utilities (“CCU”) has plenary authority over financial, contractual and policy matters relative to the Guam Waterworks Authority (“GWA”); and

**WHEREAS**, the Guam Waterworks Authority (“GWA”) is a Guam Public Corporation established and existing under the laws of Guam; and

**WHEREAS**, Public Law 28-159 added Subsection 7.03 to the GPA Personnel Rules and Regulations, and added Paragraph 29 to the Glossary of GWA’s Personnel Rules, item (c) authorizing the General Manager to petition the Consolidated Commission on Utilities (CCU) to amend, to include, but not limited to deleting, adding, or modifying such positions, the approved list of each Authority’s CTP positions; and

**WHEREAS**, a new Chapter 5.200 to GWA’s Personnel Rules and Regulations, item 3.0.3, authorizes the CCU to approve, disapprove, or amend, the unified pay scale at any regularly scheduled meeting; and

1       **WHEREAS**, a market review update of all positions and the CTP Strategic Pay scale  
2 was conducted and completed in August 2017 by Alan Searle and Associates. (See Exhibit A,  
3 Appendices A-A5). This resulted in an adjustment of the pay scale to address obsolete pay  
4 grades that were in place since 2007 and a reset and refit of new grades to coincide with 2017  
5 Market Data. The market review determined that GWA positions are below the 5<sup>th</sup> market  
6 percentile based on 2017 Market Data. It was also determined that implementation of an updated  
7 pay scale is necessary to maintain the utilities position in the market place aimed at being  
8 externally competitive in attracting and retaining employees. (See Exhibit A, Appendices B1-  
9 B3); and

10  
11       **WHEREAS**, GWA desires to improve business processes, optimize its assets and  
12 maximize employees' performance. GWA prefers to consolidate its pay policy and all positions  
13 under the Strategic Pay plan and add remaining positions to the list of CTP positions, providing  
14 equity. (See Exhibit A, Appendices C-C8). GWA also recognizes that these positions involve  
15 processes that are uncommon and unique to the utility. Thus, GWA petitions to create positions  
16 for incumbents to integrate and transition into the Strategic Pay classification methodology  
17 applicable to CTP positions (See Exhibit A, Appendices D1-D3); and

18  
19       **WHEREAS**, modern companies operate on information and GWA must leverage  
20 information in modernizing its infrastructure and technology, and must create an awareness of  
21 the importance of protecting these facets critical to the utilities. GWA operations are critical to  
22 preserving its business processes and the quality of life island-wide. GWA is committed to  
23 promoting and strengthening the role and responsibility of all employees in the protection of  
24 information, infrastructure and technology through physical security and cyber security training  
25 programs, of which, will help preserve assets, and, deter the impact of an attack to the utility; and

26  
27  
28       **NOW THEREFORE BE IT RESOLVED**, the Consolidated Commission on Utilities  
29 approves and authorize as follows:

- 30  
31       1. To accept the recommendations of the market review update conducted by Alan  
32 Searle and Associates, including implementation of a new and adjusted Strategic

Pay Scale for all Certified, Technical, and Professional (CTP) positions. (Exhibit A, Appendices A-A5 & B1-B3).

2. The creation of positions delineated in Exhibit A, Appendices D1-D3, and the addition of these positions into the GWA list of CTP positions delineated in Exhibit A, Appendices C-C8. The incumbents of these positions must complete a Physical Security training course prior to a reclassification of position. Thereafter, the incumbents must complete a Cyber Security training course and other courses deemed necessary by the management to ensure preservation of utility assets and deterrence of the impact of an attack to the utility.
3. To maintain uniformity in the application of the promotion/demotion/transfer pay policy relative to CCU Resolution No. 2012-49, and in the spirit of equity for all positions covered under the Strategic Pay Scale for CTP positions, CCU Resolution No. 2012-49 delineated in Exhibit A, Appendices E1-E16, is applicable to GWA business processes.

**RESOLVED**, that the Chairman certified and the Board Secretary attests to the adoption of this Resolution.

**DULY AND REGULARLY ADOPTED**, this 20<sup>th</sup> day of October, 2017.

Certified by:

Attested by:

**JOSEPH T. DUENAS**  
Chairperson

**J. GEORGE BAMBA**  
Secretary

//

//

//

**SECRETARY'S CERTIFICATE**

I, J. George Bamba, Board Secretary of the Consolidated Commission on Utilities as evidenced by my signature above do hereby certify as follows:

The foregoing is a full, true and accurate copy of the resolution duly adopted at a regular meeting by the members of the Guam Consolidated Commission on Utilities, duly and legally held at a place properly noticed and advertised at which meeting a quorum was present and the members who were present voted as follows:

AYES: \_\_\_\_\_

NAYS: \_\_\_\_\_

ABSTENTIONS: \_\_\_\_\_

ABSENT: \_\_\_\_\_

///

///

///

///

///

///

///

## **GUAM WATERWORKS AUTHORITY EXECUTIVE REPORT**

### **MISSION STATEMENT: The Guam Waterworks Authority SHALL**

**Provide outstanding customer service by delivering excellent water and wastewater services in a safe, reliable, responsible and cost effective manner.**

### **AUTHORITY:**

#### *12 GCA CHAPTER 14, GUAM WATERWORKS AUTHORITY*

##### *§14103. Continuation of Existence.*

*Guam Waterworks Authority (GWA) is continued in existence as a public corporation.*

##### *§ 14105. Governance of Authority.*

*All powers vested in the Authority, except as provided herein, shall be exercised by the Consolidated Commission on Utilities, as established in Chapter 79 of Title 12 of the Guam Code Annotated.*

#### *4 GCA §6303 (d) - Creation of positions.*

*GWA Personnel Rules & Regulations; Paragraph A to the Glossary of GWA's Personnel Rules - Certified, Technical, and Professional Positions (as amended by Public Law 28-159 Section 3 (c)):*

### **SUMMARY:**

The Guam Waterworks Authority owns and operates an extensive network of facilities that provides water and wastewater services to the majority of island residents. These facilities represent a significant investment and include substantial visible and underground infrastructure assets.

GWA Operates and maintains more than 200 water facilities on Guam. The facility types can generally be classified as sources, reservoirs, and waster booster pumping stations. GWA is also responsible for three public water systems. The Northern, Central and Southern Public Water Systems.

GWA provides wastewater services for Guam's general population and Andersen Air Force Base. The wastewater system consists of seven wastewater basins: Agat, Umatac - Merizo, Inajaran, Baza Gardens, Pago Socio, Northern District and Hagatna.

While these efforts support efficient and reliable utility service, they cannot abate the growing cyber and physical security threats to the Authority. GWA continues to build better business processes and optimize its assets, the roles of *all employees* have become increasingly critical to the defense of potential security breaches to the GWA infrastructure.

Security breaches and threats – both physical and cyber -impact people, information, functions and physical assets. These hazards can range from workplace violence, crime, including personal and property thefts, terrorism acts, and natural disasters to name a few.

All employees are responsible to conduct safe work practices in their working environment and to secure their work places to delay or deter threats to GWA facilities. Examples of this include, and are not limited to:

*Cashier* duties involving the ability to observe the actions and behavior of a potential adversary and alerting authorities, protecting the face-to-face cash handling process and securing customer information when conducting payment transactions using the proprietary customer service program that is interconnected to the GWA network.

*Administrative and clerical duties* involve securing and updating employee and customer data on the utility's integrated network and protecting access to this information. This also includes observance and monitoring of internal and external customers access to office business and processes.

*Finance and Accounting duties* involve responsibility for the financial records of the Authority. This includes: analyzing financial statements, long range financial planning, enhancing and monitoring internal controls, preparing annual budgets, external/internal audit functions, debt/financing proposals, managing investments, revenue collection and tracking. Accounting computer based applications used in carrying out the functions of Finance and Accounting include, but not limited to the JD Edwards Accounting Modules and Customer Care and Billing system.

*Maintenance Worker* duties involve work the maintenance of GWA facilities including facilities, treatment plants, pumping stations, wells and the administration office building. They must be cognizant to hazard conditions at these sites and apply corrective measures to minimize risks to integrity of these physical assets.

*Procurement* duties include the purchasing of materials and equipment, and the storing of equipment, materials and parts relevant to operations work such as water distribution, water production and treatment, wastewater collection and wastewater treatment plants and facilities overhauls, underground water and sewer line construction and repairs, and conducting inventory of large bulk items unique to the GWA operations. Measures are implemented to protect access to warehouses and storage areas from unauthorized persons. Additional duties include inputting and retrieving data on the utility's integrated network for accountability.

The security of GWA's assets is paramount. The whole organization is accountable for ensuring safety and preparedness of its employees when safety and security at any level is compromised.


GWA has embarked on a cybersecurity training program for all employees. GWA will also implement a physical security training program. These training programs are the initial stages of enhancing employees' awareness and knowledge of the importance of securing GWA assets and its environment.



Recently, an updated market review of all positions was conducted and determined GWA's position in the market is relatively at the 15<sup>th</sup> market percentile of the 2017 Market Data (Appendix A). The review included an adjustment of the pay scale to address obsolete pay grades that were in place since 2007, and a refit and reset of new grades to coincide with the 2017 Market Data (Appendices B and C). The proposed creation of positions were also included in the market review update (Appendices D1 - D17)

Based on the foregoing, management recognizes that all positions are critical to the safety and welfare of GWA operations. In meeting management's needs for the efficacy of operating the utility within modern industry standards, we recommend the following:

- a) To approve the proposed creation of positions (delineated in Appendices D1 – D17); and
- b) To add these newly created positions (delineated in Appendices D1 – D17) to GWA's list of Certified, Technical and Professional positions (delineated in Appendix C).
- c) To accept the recommendations of the market review update for CTP positions, including a new pay scale, the refit and reset of new grades to coincide with the 2017 market data, and implementation of a structural adjustment subject to the availability of funds (Appendices A and B).
- d) To maintain uniformity in the application of the promotion/demotion/transfer pay policy relative to CCU Resolution No. 2012-49 for all CTP positions covered under the Strategic Pay Scale, apply CCU Resolution No. 2012-49 to GPA and GWA business processes (delineated in Appendices E1 – E16).

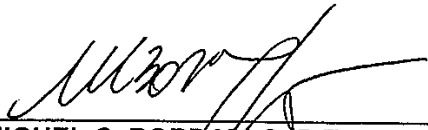  
\_\_\_\_\_  
MIGUEL C. BORDALLO, P.E.  
General Manager, GWA

9.12.17  
Date

GUAM WATERWORKS AUTHORITY  
COMPENSATION & BENEFITS STUDY  
Market Review

Executive Summary  
September 2017



ALAN SEARLE & ASSOCIATES  
*Management Consultants, Russell, New Zealand*

## **A. Background**

With the passing of public laws PL 28-113 and PL 28-159 GWA was given the mandate to implement a new market based compensation model that would aid the attraction and retention of "Certified Technical and Professional" or CTP personnel. The law was a result of concerns that the Authority was losing highly skilled personnel due to the fact that current salaries and compensation were not sufficient to attract and retain such personnel.

Through the RFP process, GWA in 2005 engaged the consulting services of Alan Searle & Associates to undertake the above compensation study. This was an extensive project involving three stages as follows :

The first stage of the study focused on job evaluation which involved applying a structured methodology of twelve (12) individual factors to assess all CTP positions. Each factor derived a point value with their sum representing the "total point" value of the position. The process was important as it re-established the internal equity of all positions based on job size. An exponential regression analysis was then undertaken to determine GWA's base salary pay line. This step was also important in that the resulting base salary pay line could eventually be compared to the market percentiles identified in Stage Two.

The second stage involved gathering external pay data on all CTP positions. The target market was the U.S. water industry and extensive data was gathered from a number of sources including the AWWA (American Water Works Association), U.S. Bureau of Labor Statistics (BLS), U.S. Department of Labor (DOL), U.S. Federal Government / Civil Service, U.S. Military, Web Based Compensation Companies, U.S. Utility Recruitment Companies and U.S. Utility Company Websites. The resulting data was analyzed and presented as market percentiles (5<sup>th</sup> through to the 95<sup>th</sup>) with the 50<sup>th</sup> market percentile being the market average. A second exponential regression analysis was then undertaken to compare GWA's base salary pay line against the market percentiles as gathered in 2008.

The results validated GWA's market vulnerability as their base salary pay line (for a large number of CTP positions) was clearly below the 5<sup>th</sup> market percentile. This was an exceptionally low position and validated the ongoing difficulties GWA had been experiencing in being able to attract and retain CTP employees. The situation at the time was further exacerbated by Gov. Guam policy (Hay methodology) that stipulated that employees on Step 10 and above receive a 3.5% increment (based on satisfactory performance) once every two (2) years. On an annualized basis this was clearly below the CPI (Consumer Price Index).

With the passing of resolution 01-FY2008 the CCU approved a transition period (beginning in fiscal year 2008) to migrate all CTP positions to a more competitive position in the market. The CCU resolution approved a five-year phase-in using the 5<sup>th</sup>, 15<sup>th</sup>, 25<sup>th</sup>, 35<sup>th</sup> and 50<sup>th</sup> market percentiles as targets for 2008 and subsequent years.

The third stage of the review focused on implementation and the transition of all CTP employees into the new compensation model. The new salary schedule has twenty-six (26) alphabetical grades each with twenty (20) numeric steps. An additional feature was the introduction of four (4) sub-steps per step which amounts to eighty sub-steps in total. Each sub-step increases base salary by 1% and was introduced to allow a performance range for GWA to ultimately pay for performance.

The outcome of the above was the identification of a specific implementation range for each CTP position. With each implementation range encompassing sixteen (16) sub-steps the final phase was to migrate all CTP employees into the new compensation model. In completing this exercise the following three implementation criteria was applied : education, experience and performance. The end result was a score (for each employee) that could be transposed to their specific implementation range and a new grade, step and sub-step identified.

#### **B. Current Review (2017)**

The current review replicates the second stage above in order to provide updated market data as at 2017. Once again the target market was the U.S. water industry and extensive data was gathered from a number of sources including the AWWA (American Water Works Association), U.S. Bureau of Labor Statistics (BLS), U.S. Department of Labor (DOL), U.S. Federal Government / Civil Service, U.S. Military, Web Based Compensation Companies, U.S. Utility Recruitment Companies and U.S. Utility Company Websites.

In summary, external pay data was gathered on 230 positions (both CTP and Non-CTP) with results once again being analyzed and presented as market percentiles (5<sup>th</sup> through to the 95<sup>th</sup>). Please note that as with the earlier study the 50<sup>th</sup> market percentile represents the market average (U.S. mainland). An exponential regression analysis was then undertaken (see Appendix A) to compare GWA's base salary pay line against the 2017 market percentiles as gathered.

#### **C. Observations / Recommendations**

In terms of recommendations the focus must be on ensuring that GWA's compensation model (cost permitting) is in the most competitive position it can be with regards the external market place. Whilst any increase in market position obviously comes at a cost this must be weighed against the Authority's ability to attract and retain competent employees.

With reference to Appendix A, GWA's market position in 2008 was extremely vulnerable with a large number of employees well below the 5<sup>th</sup> market percentile. Whilst some adjustments were made to correct the situation the market has unfortunately continued to move through to 2017. Given those early initiatives taken by the CCU we would now place GWA (with reference to Appendix A) at just below the 5<sup>th</sup> market percentile based on the 2017 market data that has been obtained.

Having determined GWA's current market position (relative to the 2017 market data) we then completed a number of cost options aimed at migrating GWA to a more competitive market position. These included migrating to the 5<sup>th</sup> (essentially a status quo option), 10<sup>th</sup>, 15<sup>th</sup>, 20<sup>th</sup> and 25<sup>th</sup> market percentiles. The costing process also included both a 5 sub-step and 7 sub-step implementation range for employee "slotting" purposes. The results are shown in Appendix B.


In undertaking the above cost analysis it also became apparent that an updated pay schedule was also required. With the current pay schedule now 10 years old, grades A, B & C have become redundant and are no longer being used. The need for an update is also reflected in the fact that some employees are approaching or have exceeded Step 20, Sub-step D.

In terms of a course of action our recommendations are as follows :

1. Consolidate GWA's compensation model to include all employees i.e. both CTP and Non-CTP employees.

Note : the need to distinguish between CTP and Non-CTP positions has become largely irrelevant as all positions are now deemed critical in providing the Authority's services. This perspective is clearly evident with both PAG and GIAA (excluding ARFF and Airport Police) now incorporating all positions in their respective compensation models.

2. Make an initial structural adjustment (cost permitting) to the 5<sup>th</sup> market percentile based on the 2017 market data. If this can be done we would recommend using the 5 sub-step implementation range cost option as "employee slotting" is closer than using the 7 sub-step cost option. As outlined earlier, this is essentially a status quo adjustment as despite being at just below the 5<sup>th</sup> market percentile this adjustment targets (in particular) those employees who are below the 5<sup>th</sup> market percentile regression line.
3. Agree on a transition plan (cost permitting) aimed at migrating GWA to a higher market percentile e.g. the 10<sup>th</sup>, 15<sup>th</sup>, 20<sup>th</sup> or 25<sup>th</sup> market percentile based on the 2017 market data. With the eventual target being the 50<sup>th</sup> market percentile (or market average within the U.S. mainland based on the prevailing market) this transition plan will continue the momentum to ensure GWA's compensation model is externally competitive.
4. Given current controls in a) annually determining the implementation range on offer re : pay for performance, and b) determining the percentage of employees who can receive the "top scores" continue to allow (for employees below the 50<sup>th</sup> market percentile of market average within the U.S. mainland) the employees eventual pay for performance adjustment to be added to their base salary. This makes computation of any future regression analysis a lot more accurate when comparing results against the prevailing market.

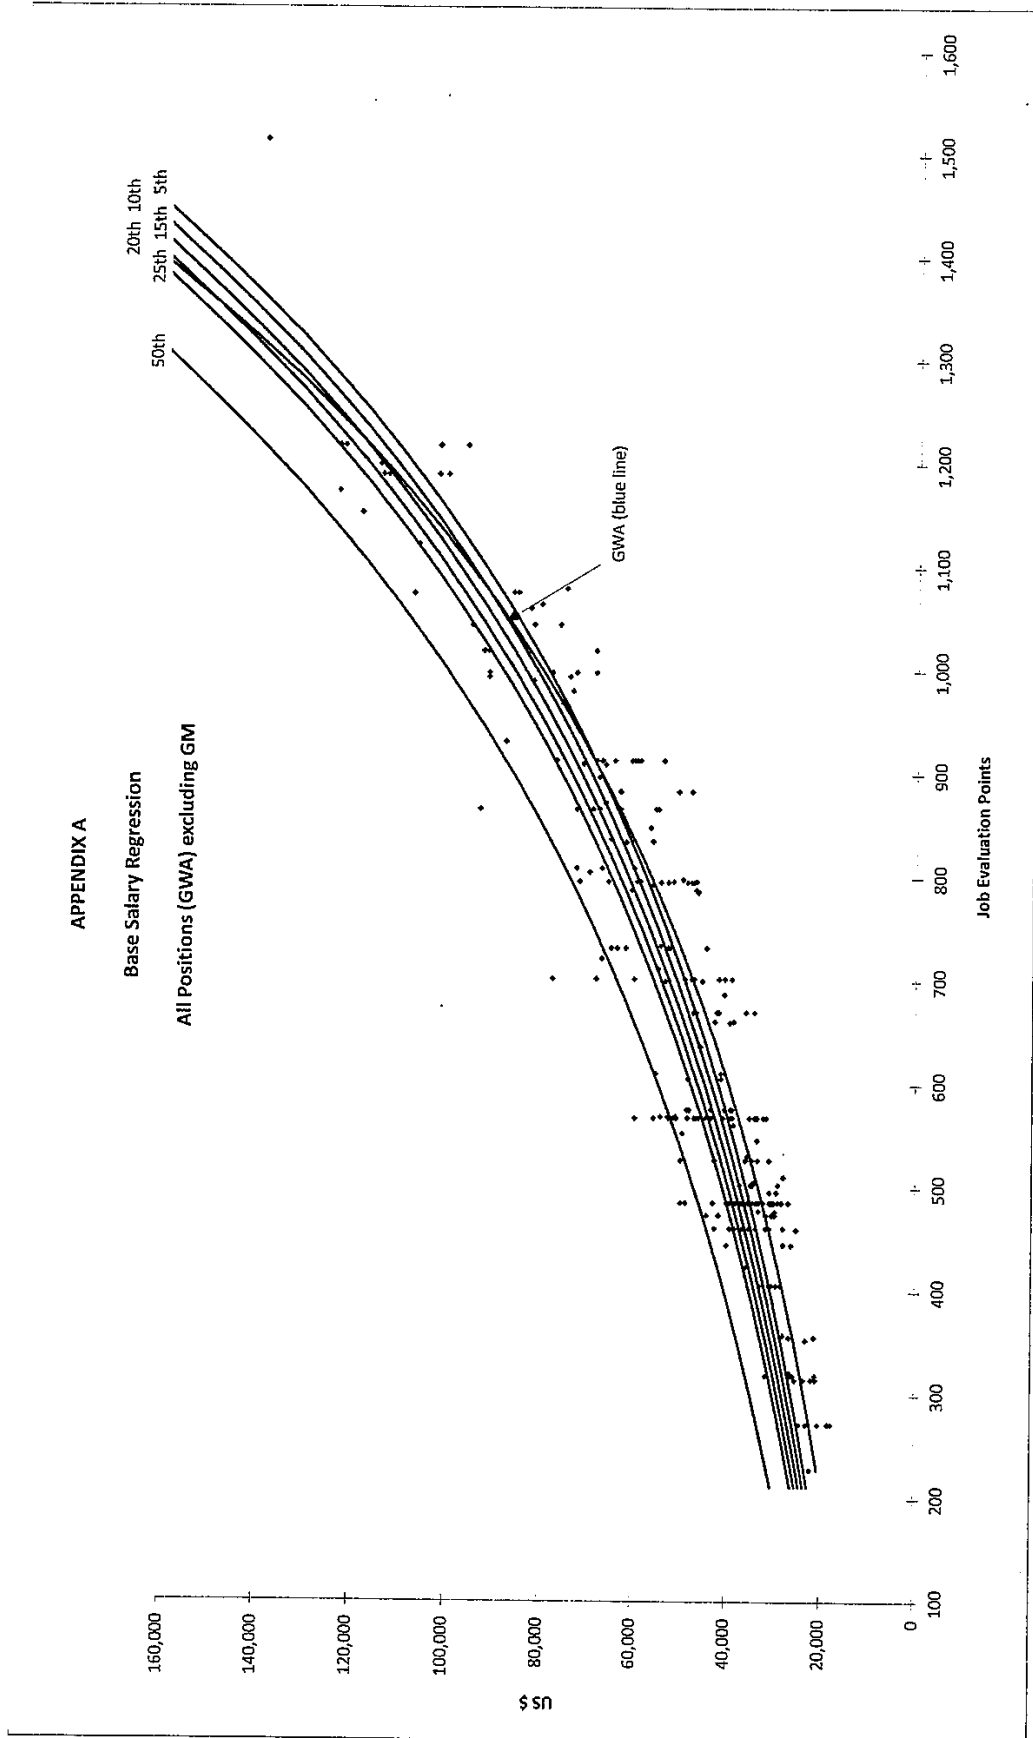

Base Salary - all GWA positions (CTP + Non CTP) excluding GM  
 Base Salary - 2017 market percentiles - 5th, 10th, 15th, 20th, 25th and 50th (U.S. Water / Wastewater Utilities)

## APPENDIX B

## ESTIMATED COST IN MIGRATING GWA TO VARIOUS MARKET PERCENTILES

## BASED ON 2017 MARKET DATA

## GWA - Seven (7) Sub-Step Implementation Range

Market Percentile 2017	Base Salary	Total Compensation (Base Salary plus Benefits)	Percentage Increase
5th	971,101	1,494,002	6.52
10th	1,258,166	1,935,640	8.44
15th	1,574,160	2,421,785	10.56
20th	1,924,266	2,960,409	12.91
25th	2,302,416	3,542,178	15.45

## GWA - Five (5) Sub-Step Implementation Range

Market Percentile 2017	Base Salary	Total Compensation (Base Salary plus Benefits)	Percentage Increase
5th	1,053,018	1,620,028	7.07
10th	1,348,839	2,075,137	9.05
15th	1,674,843	2,576,682	11.24
20th	2,034,034	3,129,283	13.65
25th	2,423,857	3,729,011	16.26

STRATEGIC PAY SCALE (2017)

	Step 1				Step 2				Step 3				Step 4				Step 5				Step 6				Step 7																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																				
--	--------	--	--	--	--------	--	--	--	--------	--	--	--	--------	--	--	--	--------	--	--	--	--------	--	--	--	--------	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--



[illegible]

[illegible]

**CTP POSITIONS (GWA)**

Authority	Position	JE Points	Grade
GWA	Accountant I	670	J
GWA	Accountant II	796	K
GWA	Accountant III	913	L
GWA	Accounting Technician I	431	F
GWA	Accounting Technician II	503	G
GWA	Accounting Technician III	606	I
GWA	Administrative Aide	353	D
GWA	Administrative Assistant	527	H
GWA	Administrative Officer	611	I
GWA	Asset Man. and Maint. Information System Officer	913	L
GWA	Assistant Chief Engineer	1232	Q
GWA	Assistant Chief Financial Officer	1122	O
GWA	Assistant General Manager Collection & Distribution	1173	P
GWA	Assistant General Manager Compliance & Safety	1152	O
GWA	Assistant General Manager Production & Treatment	1173	P
GWA	Automotive Mechanic I	477	G
GWA	Automotive Mechanic II	561	I
GWA	Biologist I	590	H
GWA	Biologist II	708	J
GWA	Biologist III	848	K
GWA	Budget Analyst	779	K
GWA	Building Custodian	228	A
GWA	Buyer I	381	F
GWA	Buyer II	496	H
GWA	Buyer Supervisor I	735	J
GWA	Buyer Supervisor II	834	K

**CTP POSITIONS (GWA)**

Authority	Position	JE Points	Grade
GWA	Carpenter I	461	G
GWA	Carpenter II	543	I
GWA	Carpenter Leader	683	J
GWA	Cashier I	315	C
GWA	Cashier II	358	E
GWA	Centralized Wastewater Maintenance Superintendent	998	N
GWA	Chemist I	600	I
GWA	Chemist II	754	J
GWA	Chemist III	858	L
GWA	Chief Budget Officer	994	N
GWA	Chief Engineer, PE (GWA)	1514	R
GWA	Chief Water and Wastewater Systems Dispatcher	984	N
GWA	Clerk I	212	A
GWA	Clerk II	270	B
GWA	Clerk III	322	C
GWA	Clerk Typist I	270	B
GWA	Clerk Typist II	322	C
GWA	Clerk Typist III	346	D
GWA	Collection Agent	421	E
GWA	Collection Supervisor	795	K
GWA	Communications Manager	1060	N
GWA	Community Maintenance Worker	422	E
GWA	Computer Operations Supervisor	844	K
GWA	Computer Operator I	356	E
GWA	Computer Operator II	506	G
GWA	Computer Operator III	637	I

**CTP POSITIONS (GWA)**

Authority	Position	JE Points	Grade
GWA	Computer Technician I	479	G
GWA	Computer Technician II	575	I
GWA	Computer Technician Leader	709	J
GWA	Computer Technician Supervisor	897	L
GWA	Construction Inspector I	498	G
GWA	Construction Inspector II	622	I
GWA	Construction Inspector III	732	K
GWA	Contracts & Small Claims Administrator	798	K
GWA	Controller	1079	O
GWA	Customer Service Representative	461	G
GWA	Customer Service Representative Supervisor	795	K
GWA	Electrician I	478	G
GWA	Electrician II	569	I
GWA	Electrician Leader	712	J
GWA	Employee Development Specialist I	503	H
GWA	Employee Development Specialist II	670	J
GWA	Employee Development Specialist III	796	K
GWA	Engineer I	687	J
GWA	Engineer II	809	K
GWA	Engineer III	931	M
GWA	Engineer Supervisor	1044	O
GWA	Equipment Maintenance Superintendent	998	N
GWA	Equipment Operator-I	397	E
GWA	Equipment Operator II	445	F
GWA	Equipment Operator III	511	G
GWA	Equipment Operator IV	546	H

**CTP POSITIONS (GWA)**

Authority	Position	JE Points	Grade
GWA	Equipment Operator Leader I	644	I
GWA	Equipment Operator Leader II	661	J
GWA	Equipment Operator Supervisor	795	K
GWA	General Accounting Supervisor	1001	N
GWA	General Manager (GWA)	1734	S
GWA	GIS Analyst I	502	H
GWA	GIS Analyst II	612	J
GWA	GIS Analyst III	756	K
GWA	GIS/LIS Manager	910	L
GWA	Grants Administrator	994	N
GWA	Heavy Equipment Mechanic I	477	G
GWA	Heavy Equipment Mechanic II	561	I
GWA	Heavy Equipment Mechanic Leader	700	J
GWA	Heavy Equipment Mechanic Supervisor	909	L
GWA	Information Technology Manager	1064	O
GWA	Internal Auditor	1019	N
GWA	Inventory Management Officer	824	K
GWA	Laboratory Technician I	469	F
GWA	Laboratory Technician II	576	I
GWA	Laboratory Technician Supervisor	837	K
GWA	Land Agent I	362	E
GWA	Land Agent II	465	G
GWA	Land Agent III	531	I
GWA	Legal Secretary I	397	E
GWA	Legal Secretary II	460	G
GWA	Legal Secretary III	532	H

**CTP POSITIONS (GWA)**

Authority	Position	JE Points	Grade
GWA	Maintenance Welder I	477	G
GWA	Maintenance Welder II	557	I
GWA	Maintenance Welder III	696	J
GWA	Maintenance Worker	422	E
GWA	Management Analyst I	503	H
GWA	Management Analyst II	670	J
GWA	Management Analyst III	796	K
GWA	Management Analyst IV	913	L
GWA	Meter Reader I	319	C
GWA	Meter Reader II	406	E
GWA	Meter Reader Leader	553	H
GWA	Monitoring Laboratory Services Administrator	1074	O
GWA	Network Analyst	793	J
GWA	Network Systems Administrator	897	L
GWA	Operations & Maintenance Manager	1189	P
GWA	Payroll Clerk I	346	D
GWA	Payroll Clerk II	438	G
GWA	Payroll Clerk III	493	H
GWA	Payroll Supervisor	805	K
GWA	Personnel Assistant I	364	D
GWA	Personnel Assistant II	433	F
GWA	Personnel Services Administrator	1064	O
GWA	Personnel Specialist I	503	H
GWA	Personnel Specialist II	670	J
GWA	Personnel Specialist III	796	K
GWA	Personnel Specialist IV	913	L

**CTP POSITIONS (GWA)**

Authority	Position	JE Points	Grade
GWA	Planner / Co-ordinator I	503	H
GWA	Planner / Co-ordinator II	670	J
GWA	Planner / Co-ordinator III	796	K
GWA	Planner / Co-ordinator IV	913	L
GWA	Planner I	503	H
GWA	Planner II	670	J
GWA	Planner III	796	K
GWA	Planner IV	913	L
GWA	Plant Electrical Instrument Superintendent	1003	N
GWA	Plant Electrical Instrument Technician I	488	G
GWA	Plant Electrical Instrument Technician II	576	I
GWA	Plant Electrical Instrument Technician Leader	722	J
GWA	Program Coordinator I	503	H
GWA	Program Coordinator II	670	J
GWA	Program Coordinator III	796	K
GWA	Program Coordinator IV	913	L
GWA	Programmer Analyst I	683	J
GWA	Programmer Analyst II	910	L
GWA	Pumping Station Leader	702	J
GWA	Pumping Station Operator I	486	G
GWA	Pumping Station Operator II	568	I
GWA	Pumping Station Supervisor	866	L
GWA	Quality Control / Quality Assurance Officer	851	L
GWA	Refrigeration Mechanic I	477	G
GWA	Refrigeration Mechanic II	561	I
GWA	Refrigeration Mechanic Leader	696	J



**CTP POSITIONS (GWA)**

Authority	Position	JE Points	Grade
GWA	Right of Way Supervisor	915	L
GWA	Safety Inspector I	418	F
GWA	Safety Inspector II	539	H
GWA	Safety Inspector III	741	J
GWA	Safety Supervisor	872	K
GWA	Secretary I	378	E
GWA	Secretary I (Typist)	378	E
GWA	Secretary II	438	G
GWA	Secretary II (Typist)	438	G
GWA	Senior Engineer Supervisor, PE	1217	P
GWA	Senior Engineer, PE	1044	O
GWA	Senior Regulatory Analyst	1019	N
GWA	Sewer Plant Leader	702	J
GWA	Sewer Plant Operator I	486	G
GWA	Sewer Plant Operator II	568	I
GWA	Sewer Plant Supervisor	866	L
GWA	Shop Planner	786	K
GWA	Source Control Manager	980	M
GWA	Staff Attorney	1199	P
GWA	Storekeeper I	322	C
GWA	Storekeeper II	424	F
GWA	Supply Management Administrator	990	M
GWA	Survey Supervisor	900	L
GWA	Systems & Programming Administrator	968	L
GWA	Systems / Trouble Dispatch Supervisor	788	K
GWA	Systems Dispatcher I	660	J

**CTP POSITIONS (GWA)**

Authority	Position	JE Points	Grade
GWA	Systems Dispatcher II	788	K
GWA	Systems Dispatcher III	911	L
GWA	Technical Support Analyst	683	J
GWA	Tool Clerk	275	B
GWA	Trades Helper	272	B
GWA	Training & Development Manager	913	L
GWA	Training Specialist	503	H
GWA	Trouble Dispatcher	474	G
GWA	Trouble Dispatcher Leader	600	J
GWA	Trouble Dispatcher Supervisor	788	K
GWA	Utility Services Administrator	1075	O
GWA	Warehouse Supervisor I	724	J
GWA	Warehouse Supervisor II	803	K
GWA	Wastewater Collection Superintendent	998	N
GWA	Wastewater Construction / Maintenance Superintendent	998	N
GWA	Wastewater Maintenance Mechanic I	486	G
GWA	Wastewater Maintenance Mechanic II	568	I
GWA	Wastewater Maintenance Mechanic Leader	702	J
GWA	Wastewater Maintenance Mechanic Supervisor	866	L
GWA	Wastewater Plant Superintendent	998	N
GWA	Water & Wastewater Systems Control Dispatcher I	660	J
GWA	Water & Wastewater Systems Control Dispatcher II	788	K
GWA	Water / Sewer Maintenance Leader	702	J
GWA	Water / Sewer Maintenance Supervisor	866	L
GWA	Water / Sewer Maintenance Worker I	486	G
GWA	Water / Sewer Maintenance Worker II	568	I

**CTP POSITIONS (GWA)**

Authority	Position	JE Points	Grade
GWA	Water and Wastewater Systems Leader	702	J
GWA	Water Construction / Maintenance Superintendent	998	N
GWA	Water Distribution System Manager	998	N
GWA	Water Meter Maintenance & Repair Leader	702	J
GWA	Water Meter Maintenance & Repair Supervisor	866	L
GWA	Water Meter Maintenance & Repair Worker I	486	G
GWA	Water Meter Maintenance & Repair Worker II	568	I
GWA	Water Meter Reader I	319	C
GWA	Water Meter Reader II	406	E
GWA	Water Meter Reader Leader	553	H
GWA	Water Meter Reader Supervisor	734	J
GWA	Water Plant Leader	702	J
GWA	Water Plant Operator I	486	G
GWA	Water Plant Operator II	568	I
GWA	Water Plant Supervisor	866	L
GWA	Water Treatment Plant Superintendent	998	N
GWA	Welder I	477	G
GWA	Welder II	557	I
GWA	Welder III	696	J
GWA	Word Processing Secretary I	378	E
GWA	Word Processing Secretary II	438	G

**PROPOSED NEW POSITIONS TO ADD TO CTP LIST (GWA)**

Authority	Position	JE Points	Grade
GWA	Utility Accounting Technician I	431	F
GWA	Utility Accounting Technician II	503	G
GWA	Utility Accounting Technician III	606	I
GWA	Utility Administrative Aide	353	D
GWA	Utility Administrative Assistant	527	H
GWA	Utility Cashier I	315	C
GWA	Utility Cashier II	358	E
GWA	Utility General Accounting Supervisor	1001	N
GWA	Utility Personnel Assistant I	364	D
GWA	Utility Personnel Assistant II	433	F
GWA	Utility Storekeeper I	322	C
GWA	Utility Storekeeper II	424	F
GWA	Utility Trades Helper	272	B

Five (5) Sub-Step Implementation Range (15 <sup>th</sup> Market Percentile)											
UTILITY	STATUS	POSITION	JE	Structural Adjustment – MIN				Structural Adjustment - MAX			
				Base Salary	Grade	Step	Sub Step	Base Salary	Grade	Step	Sub Step
GWA	FILLED	Accounting Technician III	606	43,606	I	5	B	45,377	I	6	B
GWA	FILLED	Administrative Aide	353	29,366	D	4	A	30,559	D	5	A
GWA	FILLED	Administrative Assistant	527	39,323	H	5	C	40,920	H	6	C
GWA	FILLED	Cashier I	315	26,904	C	3	C	27,997	C	4	C
GWA	FILLED	Cashier II	315	30,247	E	4	A	31,475	E	5	A
GWA	FILLED	Storekeeper II	424	32,062	F	4	A	33,364	F	5	A
GWA	FILLED	Trades Helper	272	24,683	B	3	C	25,685	B	4	C

Five (5) Sub-Step Implementation Range (15 <sup>th</sup> Market Percentile)											
UTILITY	STATUS	POSITION	JE	Structural Adjustment – MIN				Structural Adjustment - MAX			
				Base Salary	Grade	Step	Sub Step	Base Salary	Grade	Step	Sub Step
GWA	NEW	Utility Personnel Assistant I	364	29,366	D	4	A	30,559	D	5	A
GWA	NEW	Utility Personnel Assistant II	433	32,706	F	4	C	34,034	F	5	C
GWA	NEW	General Accounting Supervisor	1001	82,303	N	3	D	85,645	N	4	D
GWA	NEW	Accounting Technician I	431	31,745	F	3	D	33,033	F	4	D
GWA	NEW	Accounting Technician II	503	36,076	G	5	C	37,541	G	6	C
GWA	NEW	Storekeeper I	322	26,904	C	3	C	27,997	C	4	C

## Appendix D2

Seven (7) Sub-Step Implementation Range (15 <sup>th</sup> Market Percentile)											
UTILITY	STATUS	POSITION	JE	Structural Adjustment – MIN				Structural Adjustment - MAX			
				Base Salary	Grade	Step	Sub Step	Base Salary	Grade	Step	Sub Step
GWA	FILLED	Accounting Technician III	606	42,747	I	4	D	45,377	I	6	B
GWA	FILLED	Administrative Aide	353	28,788	D	3	C	30,559	D	5	A
GWA	FILLED	Administrative Assistant	527	38,549	H	5	A	40,920	H	6	C
GWA	FILLED	Cashier I	315	26,374	3	C	A	27,997	C	4	C
GWA	FILLED	Cashier II	322	29,651	E	3	C	31,475	E	5	A
GWA	FILLED	Storekeeper II	424	31,430	F	3	C	33,364	F	5	A
GWA	FILLED	Trades Helper	272	24,196	B	3	A	25,685	B	4	C

Seven (7) Sub-Step Implementation Range (15 <sup>th</sup> Market Percentile)											
UTILITY	STATUS	POSITION	JE	Structural Adjustment – MIN				Structural Adjustment - MAX			
				Base Salary	Grade	Step	Sub Step	Base Salary	Grade	Step	Sub Step
GWA	NEW	Utility Personnel Assistant I	364	28,788	D	3	C	30,559	D	5	A
GWA	NEW	Utility Personnel Assistant II	433	32,062	F	4	A	34,034	F	5	C
GWA	NEW	General Accounting Supervisor	1001	80,682	N	3	B	85,645	N	4	D
GWA	NEW	Accounting Technician I	431	31,119	F	3	B	33,033	F	4	D
GWA	NEW	Accounting Technician II	503	35,366	G	5	A	37,541	G	6	C
GWA	NEW	Storekeeper I	322	26,374	C	3	A	27,997	C	4	C

## Appendix D3

**CONSOLIDATED COMMISSION ON UTILITIES**

**RESOLUTION NO. 2012-49**

***RESOLUTION RELATIVE TO AMENDING THE PROMOTION/DEMOTION/TRANSFER  
POLICY***

**WHEREAS**, the General Manager, Guam Power Authority petitions the Consolidated Commission on Utilities (CCU) to amend the Promotion/Demotion/Transfer Policy, and

**WHEREAS**, the CCU has the lawful authority under Public Law 28-159, Section 3.0.b to approve and amend a unified pay scale and implementation plan for employees in certified, technical, and professional positions; and

**WHEREAS**, the Guam Power Authority is a public corporation established and existing under the laws of Guam; and

**WHEREAS**, in 2007, the CCU adopted the recommendations of the Compensation and Benefits Study conducted by Alan Searle & Associates; and

**WHEREAS**, the CCU also endorsed a plan to transition GPA to the new compensation model over a five (5) year period beginning fiscal year 2008; and

**WHEREAS**, the transition plan also included a compensation formula used to determine new rates of pay upon an employee's promotion and/or demotion into another position; and

**WHEREAS**, based on the current pay policy, upon promotion, an employee's new base salary is determined by slotting the current salary into the higher pay grade closest to but not less than the current salary earned and is then awarded a further six sub-steps; and

1       **WHEREAS**, the implementation of the current pay policy distorts internal equity; and

2  
3       **WHEREAS**, when upon promotion, junior employees are slotted at the minimum range  
4 with an additional six sub-steps increase surpassing senior employees whose step placements  
5 were slotted at the minimum range at the time of a transitional movement to the next market  
6 percentile.

7  
8       **WHEREAS**, the proposed policy change corrects this problem by making a process  
9 change to when the six sub-steps is applied.

10  
11       **WHEREAS**, when an employee is being promoted the first step will be to identify a new  
12 base salary six sub-steps up from the employee's current base salary. If the new base salary is  
13 still below the minimum of the implementation range he/she is promoted to then they are slotted  
14 at the minimum of the new implementation range.

15  
16       **WHEREAS**, for demotions, the process will be applied with a six sub-step decrease  
17 down the grade prior to slotting into the new lower grade.

18  
19       **NOW THEREFORE, BE IT RESOLVED**, by the Consolidated Commission on Utilities  
20 does hereby approve and authorize as follows:

- 21  
22       1. The amendment of the Promotion/Demotion/Transfer Policy applicable to CTP  
23 positions and personnel at GPA as delineated in Appendices "D, E and F" of  
24 Exhibit 1.
- 25       2. That the Guam Waterworks Authority also review the effect of the pay policy  
26 applicable to the determination of new pay rates assigned upon a  
27 promotion/demotion/transfer of personnel in CTP positions as delineated in  
28 Appendices "D, E and F" of Exhibit 1.



**RESOLVED**, that the Chairman certified and the Board Secretary attests to the adoption of this Resolution.

**DULY AND REGULARLY ADOPTED** this 24th day of July, 2012.

**Certified by:**

**Attested by:**

**SIMON A. SANCHEZ, II**  
Chairperson  
Consolidated Commission on Utilities

**GLORIA B. NELSON**  
Secretary  
Consolidated Commission on Utilities

## SECRETARY'S CERTIFICATE

I, Gloria B. Nelson, Board Secretary of the Consolidated Commission on Utilities evidenced by my signature do hereby certify as follows:

The foregoing is a full, true and accurate copy of the resolution duly adopted at a regular meeting by the members of the Guam Consolidated Commission on Utilities, duly and legally held at a place properly noticed and advertised at which meeting a quorum was present and the members who were present voted as follows:

AYES:	<u>4</u>
NAYS:	<u>0</u>
ABSTENTIONS:	<u>0</u>
ABSENT:	<u>1</u>



GUAM POWER AUTHORITY  
HUMAN RESOURCES DIVISION  
STAFF REPORT

**I. REQUEST:**

The General Manager requests the Consolidated Commission on Utilities (CCU) to amend the Promotion/Demotion/Transfer Policy applicable to certified, technical, and professional (CTP) positions.

**II. AUTHORITY:** P.L. 28-159, Section 3.0.b.

**III. BACKGROUND:**

In March 2007, the CCU adopted the recommendations of the Compensation and Benefits Study conducted by Alan Searle and Associates. These recommendations included a comprehensive compensation methodology, a pay scale, an implementation plan and a list of positions distributed as List A and List B of certified, technical and professional positions. The scope of the study involved comparisons of all GPA positions to industry standards and the national average market conditions. This was necessary to retain employees and provide incentives to attract new ones. Further, the pay scale in effect prior to the adoption of the new pay scale was outdated and had not been revisited since its implementation in 1990.

In adopting the recommendations presented by Alan Searle and Associates, the CCU was prudent and endorsed a plan to transition GPA to the new compensation model over a five year period beginning in fiscal year 2008. The incremental transitions provide a more competitive market position for GPA. The initial structural adjustment was made to the 5th market percentile in 2008. In 2009, GPA targeted a second structural pay adjustment at the 15<sup>th</sup> market percentile. However, based on funding availability the second structural pay adjustment was allocated at the 10<sup>th</sup> market percentile. To date, most positions are on or near the 12<sup>th</sup> market percentile as a result of performance pay increments.

The recommendations adopted by the CCU also included a compensation formula that is used to determine new rates of pay upon an employee's promotion and or demotion into another position. Based on the current policy, 6% is tagged on to the new base salary in the higher grade closest to but not less than the current salary earned. At face value, the formula appeared to work well. However, in its implementation there was discrepancy overall in the slotting of new rates with regard the implementation range of a position during a transitional pay adjustment placing the new rate of pay above the minimum range creating internal inequity.

**IV. DISCUSSION:**


When moving from one market percentile to the next higher percentile, the impact in moving from a position of a lower grade and implementation pay range to a position of a higher grade and implementation pay range is significant. The result of this process is similar to a step to step movement which creates a wider gap between incumbent employees being bypassed by the newly promoted employees in the same position. It is important to note, that when moving from one market percentile to the next higher market percentile, there are incumbent employees in positions whose current salaries are below the minimum step of the implementation range. From there, their salaries will be brought up to the minimum range during the transitional and structural pay adjustment. There are also employees whose current salaries are slotted above the minimum step of the implementation range. This is where the discrepancy exists. Under the current pay policy, junior employees who are promoted are slotted above the minimum range with an additional six percent increase. Thus, exceeding current incumbents placements during a transitional movement.

The proposed amendment will provide the six percent increase from the employees current pay grade and sub-step prior to slotting into the new pay grade and sub-step of the position promoted to. This process will maintain internal equity between the positions and the gaps that exist between junior and senior employees. (See Exhibit 1 Alan Searle & Associates Report, May 2012).

**V. RECOMMENDATION:**

- a. To approve the amendment of the Promotion/Demotion/Transfer Policy applicable to CTP positions and personnel at GPA as delineated in Appendices "D, E and F" of Exhibit 1.
- b. To request that the Guam Waterworks Authority also review the effect of the pay policy applicable to the determination of new pay rates assigned upon the promotion/demotion/transfer of personnel in CTP positions as delineated in Appendices "D, E and F" of Exhibit 1.

  
Julie L. Quinata  
Personnel Services Administrator

 7/6/12  
JOAQUIN C. FLORES, P.E.  
General Manager, GPA

GUAM POWER AUTHORITY  
COMPENSATION & BENEFITS STUDY

Request to Amend  
Promotion / Demotion Policy  
May 2012



ALAN SEARLE & ASSOCIATES LIMITED

*Management Consultants, Auckland, New Zealand*

EXHIBIT "1"  
Appendix E6

**INDEX**

Index	1
1. Background	2
2. Current Policy	2
3. Proposed Policy	2
4. Impact / Handling of Proposed Policy Change	3
5. Summary	4
Current Policy	
Appendix A : Current Promotion and Demotion Policy	5
Appendix B : Example of Current Policy (Promotions)	6
Appendix C : Example of Current Policy (Demotions)	7
Proposed Policy	
Appendix D : Proposed Promotion and Demotion Policy	8
Appendix E: Example of Proposed Policy (Promotions)	9
Appendix F : Example of Proposed Policy (Demotions)	10

## **GUAM POWER AUTHORITY**

### **Request To Amend Promotion / Demotion / Transfer Policy**

#### **1.0 Background**

When the compensation study for GPA and GWA was ratified a policy (Appendix A) concerning promotions, demotions and transfers was also included. However it has since been identified that under certain promotional situations employees are effectively receiving “two bites at the cake” so to speak. The certain situations referred to above are those instances where (prior to the promotion) the employee’s current base salary is below the minimum of the implementation range they are being promoted to. In this situation current policy is such that the employee is initially slotted at the minimum of the implementation range he/she is being promoted to (seen as the first “bite of the cake”) and is then awarded a further six sub-steps (seen as the second “bite of the cake”) in order to identify their new base salary. This policy whilst attractive to the employee being promoted needs to be amended in order to ensure internal relativities and equity are maintained.

Please note that the above also applies to PAG, GIAA and GCC who also have the same policy in place with regards their compensation models.

#### **2.0 Current Policy**

Current policy (to handling promotions and demotions) is outlined in Appendix A

An example of current policy relating to promotions is outlined in Appendix B

An example of current policy relating to demotions is outlined in Appendix C

#### **3.0 Proposed Policy**

The proposed policy change corrects the problem by simply making a process change to when the six sub-steps is applied. In short, when an employee is being promoted the first step will be to identify a new base

salary six sub-steps up from the employee's current base salary (grade, step and sub-step). If this new base salary is still below the minimum of the implementation range he/she is being promoted to then they are simply slotted at the minimum of the new implementation range. If on the other hand the new base salary is above the minimum of the implementation range he/she is being promoted to then they would be slotted at the closest sub-step just on the high side.

In summary, the proposed change simply applies (as an initial step) the six sub-steps to the employee's current base salary and grade. For promotions this is a six sub-step increase up the grade or for demotions it is a six sub-step decrease down the grade. This then identifies a value that can then be compared to the implementation range of the position the employee is being promoted or demoted to.

The proposed policy (to handling promotions and demotions) is outlined in Appendix D

An example of the proposed policy relating to promotions is outlined in Appendix E

An example of the proposed policy relating to demotions is outlined in Appendix F

#### **4.0 Impact / Handling of Proposed Policy Change**

Whilst some employees at GPA have benefited from existing policy in the handling of their promotion we cannot turn around now and reduce their base salaries as the policy was correctly followed at the time the promotion was calculated. However, any advantage can be brought back to a "level playing field" when GPA / GWA make their next structural adjustment in pay and move i.e. to a higher market percentile. For information purposes, both GPA / GWA are currently around the 10<sup>th</sup> - 15<sup>th</sup> market percentile compared to utilities (both electric and water) on the U.S. mainland.

The "level playing field" is achieved as follows : when the next structural adjustment is calculated we identify (which is part of the normal process) a new implementation range for every position. With regards the minimum of that range an employee's current base salary is either above or below it. So therefore the salary of an employee who (by virtue of their promotion) may have exceeded a longer serving employee in the same position are now both treated the same and depending on the implementation criteria will be slotted accordingly.



## **5.0 Summary**

Whilst current promotion policy has benefited some employees slightly the situation can be corrected.

As outlined earlier, the optimum time to make that change is when GPA / GWA make their next structural adjustment in pay and move to a higher market percentile. The process is straightforward for once the new implementation ranges have been identified (at the preferred market percentile) all employees are treated the same, and as previously outlined, depending on the implementation criteria will be slotted accordingly.



## **APPENDIX A**

### **1.1 Promotion**

- a) A pay adjustment resulting in an increase / promotion either by competition, reclassification, pay grade reassignment or temporary appointment is effectuated by identifying from the new pay grade the salary (sub-step) closest to, but not less than the salary currently being received prior to promotion plus an additional six (6) sub-steps. This identifies the new base salary.
- b) A pay adjustment where the salary received prior to promotion is below the low end of the new implementation range shall be slotted at the lowest sub-step of the new implementation range plus an additional six (6) sub-steps. This identifies the new base salary.
- c) The General Manager at his / her discretion, or upon the recommendation of a respective Division Manager, may grant up to three (3) additional sub-steps, based on superior performance, significant contributions made to the business unit or the Authority as a whole, or demonstration of personal enrichment and development related to and beyond the job requirement. All requests for additional sub-step placement must be justified in writing.

### **1.2 Demotion**

- a) A pay adjustment resulting in a decrease either by demotion, voluntary, reclassification, or pay grade reassignment is effectuated by identifying from the amended pay grade the salary (sub-step) closest to, but not more than the salary (sub-step) currently being received prior to demotion less an additional six (6) sub-steps. This identifies the new base salary.
- b) A pay adjustment where the salary received prior to demotion, voluntary, reclassification, or pay grade reassignment is below the lowest sub-step of the new implementation range shall be slotted at the lowest sub-step of the new implementation range. This identifies the new base salary.

*APPENDIX "A"*

Appendix E11

## Appendix B : Example - Promotions (Current Policy)

			Step 3						Step 4							Step 5							Step 6							Step 7							Step 8						
	C	D	A	B	C	D	A	B	C	D	A	B	C	D	A	B	C	D	A	B	C	D	A	B	C	D	A	B	C	D	A	B	C	D	A	B	C						
Position A	33,309	33,642	33,978	34,318	34,661	35,008	35,358	35,712	36,060	36,429	36,794	37,162	37,533	37,909	38,288	38,671	39,057	39,448	39,842	40,241	40,643	41,050	41,460	41,875	42,293																		
Position B	37,972	38,352	38,735	39,123	39,514	39,909	40,308	40,711	41,118	41,530	41,945	42,364	42,788	43,216	43,648	44,084	44,525	44,971	45,420	45,874	46,333	46,797	47,264	47,737	48,214																		
Position C	43,288	43,721	44,158	44,600	45,046	45,496	45,951	46,411	46,875	47,344	47,817	48,295	48,778	49,266	49,759	50,256	50,759	51,268	51,779	52,297	52,820	53,348	53,881	54,420	54,965																		

☐ Low end of implementation range

☐ Employees current grade, step and sub-step prior to promotion i.e. Grade I, Step 8, Sub-step B (\$41,875)

Step 1 : Initially move to closest sub-step on new grade (high side) i.e. Grade J, Step 5, Sub-step A (\$41,945)

☐ Step 2 : Increase by a further 6 (six) sub-steps to identify final grade, step and sub-step i.e. Grade J, Step 6, Sub-step C (\$44,525)

	Step 2					Step 3					Step 4					Step 5					Step 6					Step 7					Step 8			
	A	B	C	D	A	B	C	D	A	B	C	D	A	B	C	D	A	B	C	D	A	B	C	D	A	B	C	D	A	B	C	D	A	
Position A	25,125	25,376	25,630	25,886	26,145	26,407	26,671	26,937	27,207	27,479	27,754	28,031	28,312	28,595	28,881	29,169	29,461	29,756	30,053	30,354	30,657	30,964	31,274	31,586	31,902									
Position B	28,643	28,929	29,218	29,510	29,806	30,104	30,405	30,709	31,016	31,326	31,639	31,956	32,275	32,598	32,924	33,253	33,586	33,922	34,261	34,603	34,949	35,299	35,652	36,008	36,368									
				1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	25	26	27	28	29	30	

☐ Low end of implementation range

☐ Employees current grade, step and sub-step prior to promotion i.e. Grade G, Step 4, Sub-step C (\$27,754)

Step 1 : As employees current base salary is below minimum initially move to low end of implementation range of new grade i.e. Grade H, Step 2, Sub-step C (\$29,218)

☐ Step 2 : Increase by 6 (six) sub-steps to identify new grade, step and sub-step i.e. Grade H, Step 4, Sub-step A (\$31,016)

APPENDIX "B"  
Appendix E12

## Appendix C : Example - Demotions (Current Policy)

			Step 3						Step 4						Step 5						Step 6						Step 7						Step 8					
	C	D	A	B	C	D	A	B	C	D	A	B	C	D	A	B	C	D	A	B	C	D	A	B	C	D	A	B	C	D	A	B	C					
Position A	33,309	33,642	33,978	34,318	34,661	35,008	35,358	35,712	36,069	36,429	36,794	37,162	37,533	37,909	38,288	38,671	39,057	39,448	39,842	40,241	40,643	41,050	41,460	41,875	42,293													
Position B	37,972	38,352	38,735	39,123	39,514	39,909	40,308	40,711	41,118	41,530	41,945	42,364	42,788	43,216	43,648	44,084	44,525	44,971	45,420	45,874	46,333	46,797	47,264	47,737	48,214													
Position C	43,268	43,721	44,158	44,600	45,046	45,496	45,951	46,411	46,875	47,344	47,817	48,295	48,778	49,266	49,759	50,256	50,759	51,266	51,779	52,297	52,820	53,348	53,881	54,420	54,965													

Low end of Implementation range

Employees current grade, step and sub-step prior to demotion i.e. Grade J, Step 5, Sub-step A (\$41,945)

Step 1 : Initially move to closest substep on lower grade (low side) i.e. Grade I, Step 8, Sub-step B (\$41,875)

Step 2 : Decrease by 6 (six) sub-steps to identify final grade, step and sub-step i.e. Grade I, Step 6, Sub-step D (\$39,448)

			Step 3					Step 4					Step 5					Step 6					Step 7					Step 8				
	C	D	A	B	C	D	A	B	C	D	A	B	C	D	A	B	C	D	A	B	C	D	A	B	C	D	A	B	C			
Position A	33,309	33,642	33,978	34,318	34,661	35,008	35,358	35,712	36,069	36,429	36,794	37,162	37,533	37,909	38,288	38,671	39,057	39,448	39,842	40,241	40,643	41,050	41,460	41,875	42,293							
Position B	37,872	38,352	38,735	39,123	39,514	39,909	40,308	40,711	41,118	41,530	41,945	42,364	42,788	43,216	43,648	44,084	44,525	44,971	45,420	45,874	46,333	46,797	47,264	47,737	48,214							
Position C	43,288	43,721	44,158	44,600	45,046	45,498	45,951	46,411	46,875	47,344	47,817	48,295	48,778	49,266	49,769	50,258	50,759	51,266	51,779	52,297	52,820	53,348	53,881	54,420	54,965							

Low end of Implementation range

Employees current grade, step and sub-step prior to demotion i.e. Grade J, Step 2, Sub-step D (\$38,352)

Step 1 : Initially move to closest substep on lower grade (low side) i.e. Grade I, Step 6, Sub-step A (\$38,288)

Step 2 : Decrease by 6 (six) sub-steps to identify final grade, step and sub-step i.e. Grade I, Step 4, Sub-step C (\$36,069)

Note : if six (6) sub-steps cannot be taken, take low end of Implementation range as new base salary

APPENDIX "C"  
Appendix E13

## APPENDIX D

### 1.1 Promotion

A pay adjustment resulting in a promotion either by competition, reclassification, pay grade reassignment or temporary appointment is effectuated by initially increasing the employee's current base salary by six (6) sub-steps on the grade they are currently allocated. If this figure is :

- a) below the minimum of the new implementation range they would be slotted at the minimum of the new implementation range. This identifies the employee's new base salary.
- b) above the minimum of the new implementation range they would be slotted at the closest sub-step (just on the high side) of the new grade. This identifies the employee's new base salary.
- c) The General Manager at his / her discretion, or upon the recommendation of a respective Division Manager, may grant up to three (3) additional sub-steps, based on superior performance, significant contributions made to the business unit or the Authority as a whole, or demonstration of personal enrichment and development related to and beyond the job requirement. All requests for additional sub-step placement must be justified in writing.

### 1.2 Demotion

A pay adjustment resulting in a decrease either by demotion, voluntary, reclassification, or pay grade reassignment is effectuated by initially decreasing the employee's current base salary by six (6) sub-steps on the grade they are currently allocated. If this figure is :

- d) below the minimum of the new implementation range they would be slotted at the minimum of the new implementation range. This identifies the employee's new base salary.
- e) above the minimum of the new implementation range they would be slotted at the closest sub-step (just on the low side) of the new grade. This identifies the employee's new base salary.

*APPENDIX "D"*  
Appendix E14

## Appendix E : Example - Promotions (Proposed Policy)

## SCENARIO 1.

		Step 2				Step 3				Step 4				Step 5				Step 6				Step 7	
		A	B	C	D	A	B	C	D	A	B	C	D	A	B	C	D	A	B	C	D	A	B
Position A	Grade F	25,125	25,376	25,630	25,886	26,145	26,407	26,671	26,937	27,207	27,479	27,754	28,031	28,312	28,595	28,881	29,169	29,461	29,756	30,053	30,354	30,657	30,964
Position B	Grade H	28,643	28,929	29,218	29,510	29,806	30,104	30,405	30,709	31,016	31,326	31,639	31,956	32,275	32,598	32,924	33,253	33,586	33,922	34,261	34,603	34,949	35,299

Low end of implementation ranges (both Positions A &amp; B)

Employees current grade, step and sub-step prior to promotion i.e. Grade F, Step 4, Sub-step A (\$27,207)

Step 1 : Initially move up the employees current grade by six sub-steps to identify a value i.e. Grade F, Step 5, Sub-step C (\$28,881)

Step 2 : Transpose that value to the new grade that the employee is being promoted to and to the closest sub-step "just on the high side" i.e. Grade H, Step 2, Sub-step B (\$28,929)

As this value is still BELOW the minimum of the new implementation range the employee would move to the minimum of the new implementation range i.e. Grade H, Step 3, Substep C (\$30,405) as their new base salary

## SCENARIO 2.

		Step 2				Step 3				Step 4				Step 5				Step 6				Step 7	
		A	B	C	D	A	B	C	D	A	B	C	D	A	B	C	D	A	B	C	D	A	B
Position A	Grade F	25,125	25,376	25,630	25,886	26,145	26,407	26,671	26,937	27,207	27,479	27,754	28,031	28,312	28,595	28,881	29,169	29,461	29,756	30,053	30,354	30,657	30,964
Position B	Grade H	28,643	28,929	29,218	29,510	29,806	30,104	30,405	30,709	31,016	31,326	31,639	31,956	32,275	32,598	32,924	33,253	33,586	33,922	34,261	34,603	34,949	35,299

Low end of implementation ranges (both Positions A &amp; B)

Employees current grade, step and sub-step prior to promotion i.e. Grade F, Step 5, Sub-step C (\$28,881)

Step 1 : Initially move up the employees current grade by six sub-steps to identify a value i.e. Grade F, Step 7, Sub-step A (\$30,657)

Step 2 : Transpose that value to the new grade that the employee is being promoted to and to the closest sub-step "just on the high side" i.e. Grade H, Step 3, Sub-step D (\$30,709)

As this value is ABOVE the minimum of the new implementation range the employee would stay at that value i.e. Grade H, Step 3, Sub-step D (\$30,709) as their new base salary

## Appendix F : Example - Demotions (Proposed Policy)

SCENARIO 1.

		Step 2				Step 3				Step 4				Step 5				Step 6				Step 7	
		A	B	C	D	A	B	C	D	A	B	C	D	A	B	C	D	A	B	C	D	A	B
Position A	Grade F	25,125	25,376	25,630	25,886	26,145	26,407	26,671	26,937	27,207	27,479	27,754	28,031	28,312	28,596	28,881	29,169	29,461	29,756	30,053	30,354	30,657	30,964
Position B	Grade H	28,643	28,929	29,218	29,510	29,806	30,104	30,405	30,708	31,016	31,326	31,639	31,956	32,275	32,598	32,924	33,253	33,586	33,922	34,261	34,603	34,949	35,299

Low end of implementation ranges (both Positions A &amp; B)

Employees current grade, step and sub-step prior to demotion i.e. Grade H, Step 5, Sub-step B (\$32,598)

Step 1 : Initially move down six sub-steps from the employees current salary to identify a value i.e. Grade H, Step 3, Sub-step D (\$30,709)

Step 2 : Transpose that value to the new grade that the employee is being demoted to, and to the closest sub-step "just on the low side" i.e. Grade F, Step 7, Sub-step A (\$30,657)

As this value is still ABOVE the minimum of the new implementation range management reserves the right (depending on the circumstances of the demotion) to further reduce this to the minimum.

SCENARIO 2.

		Step 2				Step 3				Step 4				Step 5				Step 6				Step 7	
		A	B	C	D	A	B	C	D	A	B	C	D	A	B	C	D	A	B	C	D	A	B
Position A	Grade F	25,125	25,376	25,630	25,886	26,145	26,407	26,671	26,937	27,207	27,479	27,754	28,031	28,312	28,595	28,881	29,169	29,461	29,756	30,053	30,354	30,657	30,964
Position B	Grade H	28,643	28,929	29,218	29,510	29,806	30,104	30,405	30,708	31,016	31,326	31,639	31,956	32,275	32,598	32,924	33,253	33,586	33,922	34,261	34,603	34,949	35,299

Low end of implementation ranges (both Positions A &amp; B)

Employees current grade, step and sub-step prior to demotion i.e. Grade H, Step 3, Sub-step D (\$30,709)

Step 1 : Initially move down six sub-steps from the employees current salary to identify a value i.e. Grade H, Step 2, Sub-step B (\$28,929). Please note (that with this scenario) this action goes below the minimum of the current grade.

Step 2 : Transpose that value to the new grade that the employee is being demoted to, and to the closest sub-step "just on the low side" i.e. Grade F, Step 5, Sub-step C (\$28,881)

As this value is still ABOVE the minimum of the new implementation range management reserves the right (depending on the circumstances of the demotion) to further reduce this to the minimum.



**GUAM WATERWORKS AUTHORITY**

*"Better Water, Better Lives."*

Gloria B. Nelson Public Service Building | 688 Route 15 | Mangilao, Guam 96913

Tel: (671) 300-6846

## **Issues for Decision**

### **Resolution No. 02-FY2018 (Formerly Resolution No. 53-FY2017)**

Relative to the Adoption of the 2017 Market Update and the Approval to Migrate to the 10<sup>th</sup> Market Percentile for the Guam waterworks Authority

#### **What is the project's objective and is it necessary and urgent?**

To adopt recommendations of utility market review and update for GWA's pay scale. In order to meet these objectives. GWA also requests the Board to accept the recommendations of the market review update for CTP positions, including a new pay scale, the refit and reset of new grades to coincide with the 2017 market data. These actions are necessary to maintain uniformity in the application of the promotion/demotion/transfer pay policy relative to CCU Resolution No. 2012-49 for all CTP positions covered under the Strategic Pay Scale, and to apply CCU Resolution No. 2012-49 to GWA business processes.

The matters covered under this resolution are necessary and urgent to address the obsolete pay grades that were in place since 2007 and to allow for a refit and reset of the new pay grades that will coincide with the 2017 market data.

#### **Where is the location?**

Within the Guam Waterworks Authority

#### **How much will it cost?**

Cost to migrate to the 2017 10th market percentile is estimated to be \$1.2M

#### **When will it be completed?**

Upon approval by the CCU, the transition to the new pay scale is anticipated to take effect January 1, 2018.

#### **What is the funding source?**

Fiscal Year 2018 Budget has been identified as the funding source for the above project.

#### **The RFP/BID responses:**

N/A



**CONSOLIDATED COMMISSION ON UTILITIES**  
Guam Power Authority | Guam Waterworks Authority  
P.O. Box 2977 Hagatna, Guam 96932 | (671)649-3002 | guamccu.org

**RESOLUTION NO. 02–FY2018**

**RELATIVE TO THE ADOPTION OF 2017 MARKET UPDATE AND THE APPROVAL  
TO MIGRATE TO THE 10TH MARKET PERCENTILE FOR THE GUAM  
WATERWORKS AUTHORITY**

**WHEREAS**, Section 8104 (c), Chapter 8, and Section 14104 (c), Chapter 14 of Title 12 of the Guam Code Annotated authorizes the Guam Waterworks Authority to establish its internal organization and management and adopt regulations for the administration of its operations; and

**WHEREAS**, under 12 G.C.A. § 14105, the Consolidated Commission on Utilities (“CCU”) has plenary authority over financial, contractual and policy matters relative to the Guam Waterworks Authority (“GWA”); and

**WHEREAS**, the Guam Waterworks Authority (“GWA”) is a Guam Public Corporation established and existing under the laws of Guam; and

**WHEREAS**, Public Law 28-159 added Subsection 7.03 to the GPA Personnel Rules and Regulations, and added Paragraph 29 to the Glossary of GWA’s Personnel Rules, item (c) authorizing the General Manager to petition the Consolidated Commission on Utilities (CCU) to amend, to include, but not limited to deleting, adding, or modifying such positions, the approved list of each Authority’s CTP positions; and

**WHEREAS**, a new Chapter 5.200 to GWA’s Personnel Rules and Regulations, item 3.0.3, authorizes the CCU to approve, disapprove, or amend, the unified pay scale at any regularly scheduled meeting; and

**WHEREAS**, a market review update of all positions and the CTP Strategic Pay scale was conducted and completed in August 2017 by Alan Searle and Associates. (Appendices A-



1 A5). The market review determined that GWA positions are below the 5<sup>th</sup> market percentile  
2 based on 2017 Market Data. In maintaining this position, GWA recommends implementation of  
3 incremental structural pay adjustments to the 10<sup>th</sup> market percentile on January 1, 2018; and  
4

5 **NOW THEREFORE BE IT RESOLVED**, the Consolidated Commission on Utilities  
6 approves and authorize as follows:  
7

- 8 1. The General Manager at GWA to implement structural pay adjustments, to the  
9 10<sup>th</sup> market percentile on January 1, 2018.

10 **RESOLVED**, that the Chairman certified and the Board Secretary attests to the adoption  
11 of this Resolution.  
12

13 **DULY AND REGULARLY ADOPTED**, this 20<sup>th</sup> day of October, 2017.  
14

15 Certified by:

Attested by:

16  
17 \_\_\_\_\_  
18 **JOSEPH T. DUENAS**  
19 Chairperson

20 \_\_\_\_\_  
21 **J. GEORGE BAMBA**  
22 Secretary

23 I, J. George Bamba, Board Secretary of the Consolidated Commission on Utilities as  
24 evidenced by my signature above do hereby certify as follows:  
25

26 The foregoing is a full, true and accurate copy of the resolution duly adopted at a regular  
27 meeting by the members of the Guam Consolidated Commission on Utilities, duly and  
28 legally held at a place properly noticed and advertised at which meeting a quorum was  
29 present and the members who were present voted as follows:  
30

31 AYES: \_\_\_\_\_

32 NAYS: \_\_\_\_\_

ABSTENTIONS: \_\_\_\_\_

ABSENT: \_\_\_\_\_

## **GUAM WATERWORKS AUTHORITY EXECUTIVE REPORT**

### **MISSION STATEMENT: The Guam Waterworks Authority SHALL**

**Provide outstanding customer service by delivering excellent water and wastewater services in a safe, reliable, responsible and cost effective manner.**

### **AUTHORITY:**

#### *12 GCA CHAPTER 14, GUAM WATERWORKS AUTHORITY*

##### *§14103. Continuation of Existence.*

*Guam Waterworks Authority (GWA) is continued in existence as a public corporation.*

##### *§ 14105. Governance of Authority.*

*All powers vested in the Authority, except as provided herein, shall be exercised by the Consolidated Commission on Utilities, as established in Chapter 79 of Title 12 of the Guam Code Annotated.*

#### *4 GCA §6303 (d) - Creation of positions.*

*GWA Personnel Rules & Regulations; Paragraph A to the Glossary of GWA's Personnel Rules - Certified, Technical, and Professional Positions (as amended by Public Law 28-159 Section 3 (c)):*

### **SUMMARY:**

The Guam Waterworks Authority owns and operates an extensive network of facilities that provides water and wastewater services to the majority of island residents. These facilities represent a significant investment and include substantial visible and underground infrastructure assets.

GWA Operates and maintains more than 200 water facilities on Guam. The facility types can generally be classified as sources, reservoirs, and waster booster pumping stations. GWA is also responsible for three public water systems. The Northern, Central and Southern Public Water Systems.

GWA provides wastewater services for Guam's general population and Andersen Air Force Base. The wastewater system consists of seven wastewater basins: Agat, Umatac - Merizo, Inajaran, Baza Gardens, Pago Socio, Northern District and Hagatna.

While these efforts support efficient and reliable utility service, they cannot abate the growing cyber and physical security threats to the Authority. GWA continues to build better business processes and optimize its assets, the roles of *all employees* have become increasingly critical to the defense of potential security breaches to the GWA infrastructure.

Security breaches and threats – both physical and cyber -impact people, information, functions and physical assets. These hazards can range from workplace violence, crime, including personal and property thefts, terrorism acts, and natural disasters to name a few.

All employees are responsible to conduct safe work practices in their working environment and to secure their work places to delay or deter threats to GWA facilities. Examples of this include, and are not limited to:

*Cashier* duties involving the ability to observe the actions and behavior of a potential adversary and alerting authorities, protecting the face-to-face cash handling process and securing customer information when conducting payment transactions using the proprietary customer service program that is interconnected to the GWA network.

*Administrative and clerical duties* involve securing and updating employee and customer data on the utility's integrated network and protecting access to this information. This also includes observance and monitoring of internal and external customers access to office business and processes.

*Finance and Accounting duties* involve responsibility for the financial records of the Authority. This includes: analyzing financial statements, long range financial planning, enhancing and monitoring internal controls, preparing annual budgets, external/internal audit functions, debt/financing proposals, managing investments, revenue collection and tracking. Accounting computer based applications used in carrying out the functions of Finance and Accounting include, but not limited to the JD Edwards Accounting Modules and Customer Care and Billing system.

*Maintenance Worker* duties involve work the maintenance of GWA facilities including facilities, treatment plants, pumping stations, wells and the administration office building. They must be cognizant to hazard conditions at these sites and apply corrective measures to minimize risks to integrity of these physical assets.

*Procurement* duties include the purchasing of materials and equipment, and the storing of equipment, materials and parts relevant to operations work such as water distribution, water production and treatment, wastewater collection and wastewater treatment plants and facilities overhauls, underground water and sewer line construction and repairs, and conducting inventory of large bulk items unique to the GWA operations. Measures are implemented to protect access to warehouses and storage areas from unauthorized persons. Additional duties include inputting and retrieving data on the utility's integrated network for accountability.


The security of GWA's assets is paramount. The whole organization is accountable for ensuring safety and preparedness of its employees when safety and security at any level is compromised.

GWA has embarked on a cybersecurity training program for all employees. GWA will also implement a physical security training program. These training programs are the initial stages of enhancing employees' awareness and knowledge of the importance of securing GWA assets and its environment.

Recently, an updated market review of all positions was conducted and determined GWA's position in the market is relatively at the 15<sup>th</sup> market percentile of the 2017 Market Data (Appendix A). The review included an adjustment of the pay scale to address obsolete pay grades that were in place since 2007, and a refit and reset of new grades to coincide with the 2017 Market Data (Appendices B and C). The proposed creation of positions were also included in the market review update (Appendices D1 - D17)

Based on the foregoing, management recognizes that all positions are critical to the safety and welfare of GWA operations. In meeting management's needs for the efficacy of operating the utility within modern industry standards, we recommend the following:

- a) To approve the proposed creation of positions (delineated in Appendices D1 – D17); and
- b) To add these newly created positions (delineated in Appendices D1 – D17) to GWA's list of Certified, Technical and Professional positions (delineated in Appendix C).
- c) To accept the recommendations of the market review update for CTP positions, including a new pay scale, the refit and reset of new grades to coincide with the 2017 market data, and implementation of a structural adjustment subject to the availability of funds (Appendices A and B).
- d) To maintain uniformity in the application of the promotion/demotion/transfer pay policy relative to CCU Resolution No. 2012-49 for all CTP positions covered under the Strategic Pay Scale, apply CCU Resolution No. 2012-49 to GPA and GWA business processes (delineated in Appendices E1 – E16).

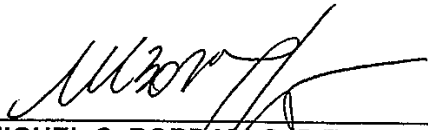  
\_\_\_\_\_  
MIGUEL C. BORDALLO, P.E.  
General Manager, GWA

9.12.17  
Date

GUAM WATERWORKS AUTHORITY  
COMPENSATION & BENEFITS STUDY  
Market Review

Executive Summary  
September 2017



ALAN SEARLE & ASSOCIATES  
*Management Consultants, Russell, New Zealand*

## **A. Background**

With the passing of public laws PL 28-113 and PL 28-159 GWA was given the mandate to implement a new market based compensation model that would aid the attraction and retention of "Certified Technical and Professional" or CTP personnel. The law was a result of concerns that the Authority was losing highly skilled personnel due to the fact that current salaries and compensation were not sufficient to attract and retain such personnel.

Through the RFP process, GWA in 2005 engaged the consulting services of Alan Searle & Associates to undertake the above compensation study. This was an extensive project involving three stages as follows :

The first stage of the study focused on job evaluation which involved applying a structured methodology of twelve (12) individual factors to assess all CTP positions. Each factor derived a point value with their sum representing the "total point" value of the position. The process was important as it re-established the internal equity of all positions based on job size. An exponential regression analysis was then undertaken to determine GWA's base salary pay line. This step was also important in that the resulting base salary pay line could eventually be compared to the market percentiles identified in Stage Two.

The second stage involved gathering external pay data on all CTP positions. The target market was the U.S. water industry and extensive data was gathered from a number of sources including the AWWA (American Water Works Association), U.S. Bureau of Labor Statistics (BLS), U.S. Department of Labor (DOL), U.S. Federal Government / Civil Service, U.S. Military, Web Based Compensation Companies, U.S. Utility Recruitment Companies and U.S. Utility Company Websites. The resulting data was analyzed and presented as market percentiles (5<sup>th</sup> through to the 95<sup>th</sup>) with the 50<sup>th</sup> market percentile being the market average. A second exponential regression analysis was then undertaken to compare GWA's base salary pay line against the market percentiles as gathered in 2008.

The results validated GWA's market vulnerability as their base salary pay line (for a large number of CTP positions) was clearly below the 5<sup>th</sup> market percentile. This was an exceptionally low position and validated the ongoing difficulties GWA had been experiencing in being able to attract and retain CTP employees. The situation at the time was further exacerbated by Gov. Guam policy (Hay methodology) that stipulated that employees on Step 10 and above receive a 3.5% increment (based on satisfactory performance) once every two (2) years. On an annualized basis this was clearly below the CPI (Consumer Price Index).

With the passing of resolution 01-FY2008 the CCU approved a transition period (beginning in fiscal year 2008) to migrate all CTP positions to a more competitive position in the market. The CCU resolution approved a five-year phase-in using the 5<sup>th</sup>, 15<sup>th</sup>, 25<sup>th</sup>, 35<sup>th</sup> and 50<sup>th</sup> market percentiles as targets for 2008 and subsequent years.

The third stage of the review focused on implementation and the transition of all CTP employees into the new compensation model. The new salary schedule has twenty-six (26) alphabetical grades each with twenty (20) numeric steps. An additional feature was the introduction of four (4) sub-steps per step which amounts to eighty sub-steps in total. Each sub-step increases base salary by 1% and was introduced to allow a performance range for GWA to ultimately pay for performance.

The outcome of the above was the identification of a specific implementation range for each CTP position. With each implementation range encompassing sixteen (16) sub-steps the final phase was to migrate all CTP employees into the new compensation model. In completing this exercise the following three implementation criteria was applied : education, experience and performance. The end result was a score (for each employee) that could be transposed to their specific implementation range and a new grade, step and sub-step identified.

#### **B. Current Review (2017)**

The current review replicates the second stage above in order to provide updated market data as at 2017. Once again the target market was the U.S. water industry and extensive data was gathered from a number of sources including the AWWA (American Water Works Association), U.S. Bureau of Labor Statistics (BLS), U.S. Department of Labor (DOL), U.S. Federal Government / Civil Service, U.S. Military, Web Based Compensation Companies, U.S. Utility Recruitment Companies and U.S. Utility Company Websites.

In summary, external pay data was gathered on 230 positions (both CTP and Non-CTP) with results once again being analyzed and presented as market percentiles (5<sup>th</sup> through to the 95<sup>th</sup>). Please note that as with the earlier study the 50<sup>th</sup> market percentile represents the market average (U.S. mainland). An exponential regression analysis was then undertaken (see Appendix A) to compare GWA's base salary pay line against the 2017 market percentiles as gathered.

#### **C. Observations / Recommendations**

In terms of recommendations the focus must be on ensuring that GWA's compensation model (cost permitting) is in the most competitive position it can be with regards the external market place. Whilst any increase in market position obviously comes at a cost this must be weighed against the Authority's ability to attract and retain competent employees.

With reference to Appendix A, GWA's market position in 2008 was extremely vulnerable with a large number of employees well below the 5<sup>th</sup> market percentile. Whilst some adjustments were made to correct the situation the market has unfortunately continued to move through to 2017. Given those early initiatives taken by the CCU we would now place GWA (with reference to Appendix A) at just below the 5<sup>th</sup> market percentile based on the 2017 market data that has been obtained.

Having determined GWA's current market position (relative to the 2017 market data) we then completed a number of cost options aimed at migrating GWA to a more competitive market position. These included migrating to the 5<sup>th</sup> (essentially a status quo option), 10<sup>th</sup>, 15<sup>th</sup>, 20<sup>th</sup> and 25<sup>th</sup> market percentiles. The costing process also included both a 5 sub-step and 7 sub-step implementation range for employee "slotting" purposes. The results are shown in Appendix B.

In undertaking the above cost analysis it also became apparent that an updated pay schedule was also required. With the current pay schedule now 10 years old, grades A, B & C have become redundant and are no longer being used. The need for an update is also reflected in the fact that some employees are approaching or have exceeded Step 20, Sub-step D.


In terms of a course of action our recommendations are as follows :

1. Consolidate GWA's compensation model to include all employees i.e. both CTP and Non-CTP employees.

Note : the need to distinguish between CTP and Non-CTP positions has become largely irrelevant as all positions are now deemed critical in providing the Authority's services. This perspective is clearly evident with both PAG and GIAA (excluding ARFF and Airport Police) now incorporating all positions in their respective compensation models.

2. Make an initial structural adjustment (cost permitting) to the 5<sup>th</sup> market percentile based on the 2017 market data. If this can be done we would recommend using the 5 sub-step implementation range cost option as "employee slotting" is closer than using the 7 sub-step cost option. As outlined earlier, this is essentially a status quo adjustment as despite being at just below the 5<sup>th</sup> market percentile this adjustment targets (in particular) those employees who are below the 5<sup>th</sup> market percentile regression line.
3. Agree on a transition plan (cost permitting) aimed at migrating GWA to a higher market percentile e.g. the 10<sup>th</sup>, 15<sup>th</sup>, 20<sup>th</sup> or 25<sup>th</sup> market percentile based on the 2017 market data. With the eventual target being the 50<sup>th</sup> market percentile (or market average within the U.S. mainland based on the prevailing market) this transition plan will continue the momentum to ensure GWA's compensation model is externally competitive.
4. Given current controls in a) annually determining the implementation range on offer re : pay for performance, and b) determining the percentage of employees who can receive the "top scores" continue to allow (for employees below the 50<sup>th</sup> market percentile of market average within the U.S. mainland) the employees eventual pay for performance adjustment to be added to their base salary. This makes computation of any future regression analysis a lot more accurate when comparing results against the prevailing market.



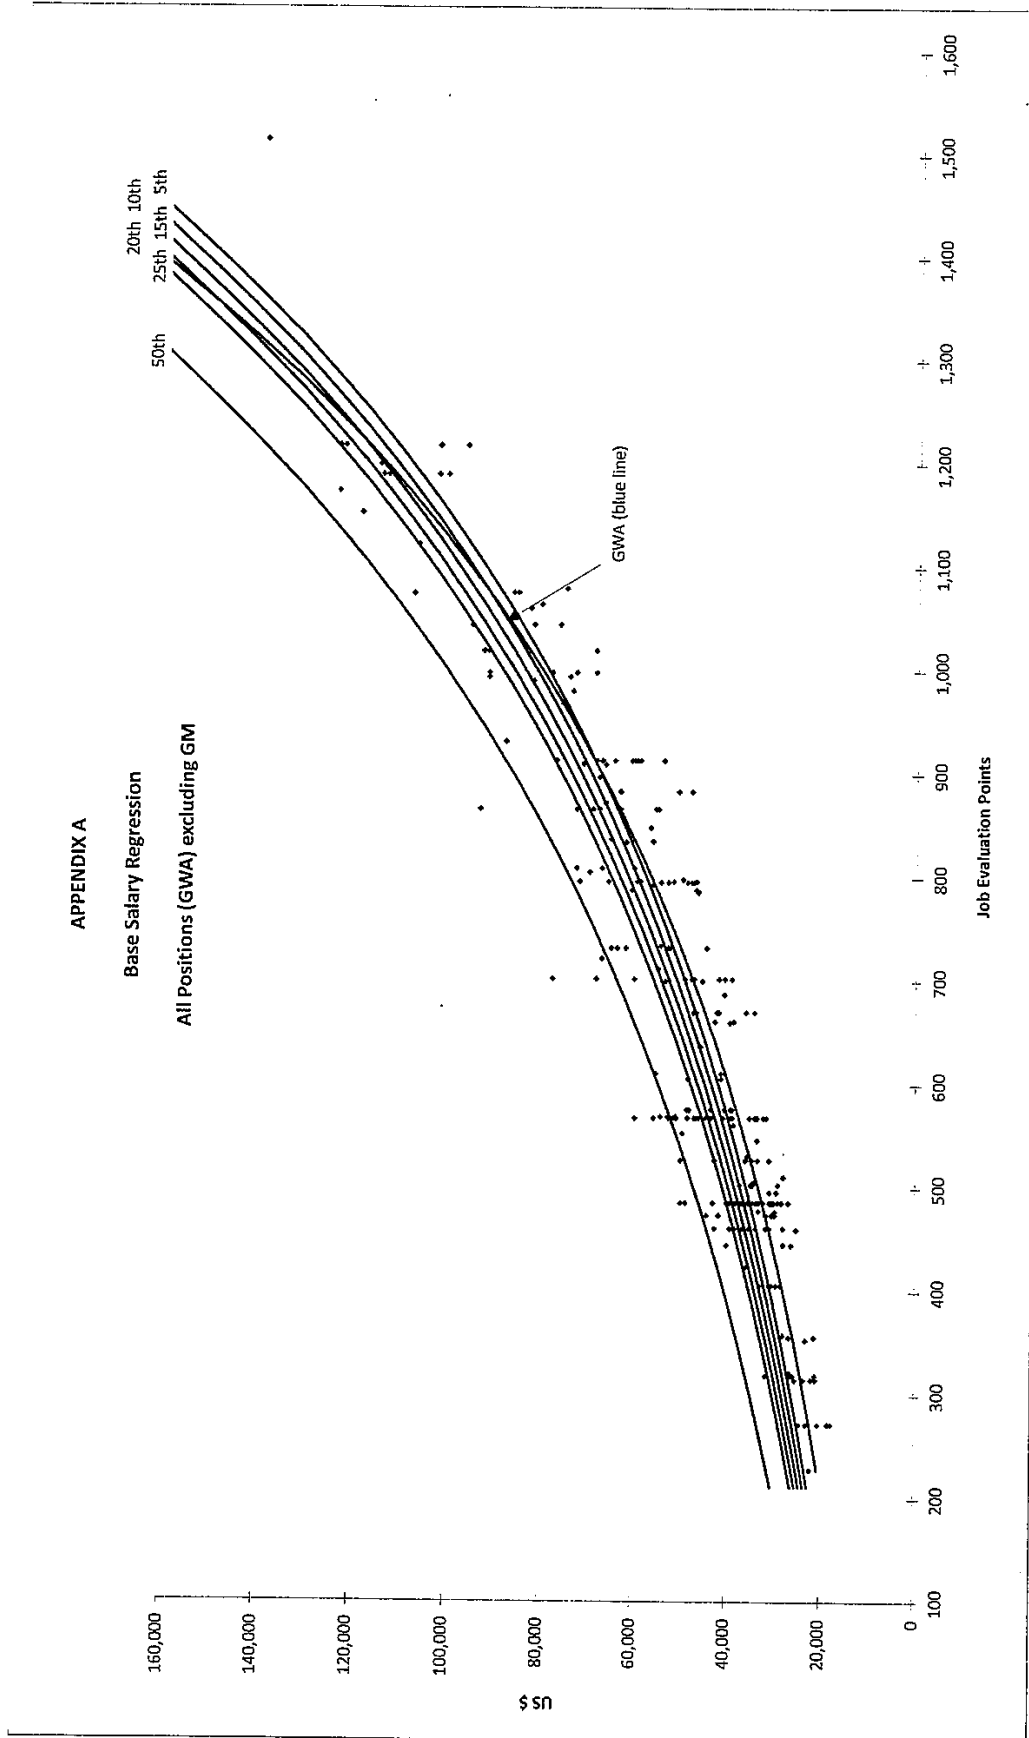

Base Salary - all GWA positions (CTP + Non CTP) excluding GM  
 Base Salary - 2017 market percentiles - 5th, 10th, 15th, 20th, 25th and 50th (U.S. Water / Wastewater Utilities)

## APPENDIX B

## ESTIMATED COST IN MIGRATING GWA TO VARIOUS MARKET PERCENTILES

## BASED ON 2017 MARKET DATA

## GWA - Seven (7) Sub-Step Implementation Range

Market Percentile 2017	Base Salary	Total Compensation (Base Salary plus Benefits)	Percentage Increase
5th	971,101	1,494,002	6.52
10th	1,258,166	1,935,640	8.44
15th	1,574,160	2,421,785	10.56
20th	1,924,266	2,960,409	12.91
25th	2,302,416	3,542,178	15.45

## GWA - Five (5) Sub-Step Implementation Range

Market Percentile 2017	Base Salary	Total Compensation (Base Salary plus Benefits)	Percentage Increase
5th	1,053,018	1,620,028	7.07
10th	1,348,839	2,075,137	9.05
15th	1,674,843	2,576,682	11.24
20th	2,034,034	3,129,283	13.65
25th	2,423,857	3,729,011	16.26

59

[illegible]

60

[illegible]

**CTP POSITIONS (GWA)**

Authority	Position	JE Points	Grade
GWA	Accountant I	670	J
GWA	Accountant II	796	K
GWA	Accountant III	913	L
GWA	Accounting Technician I	431	F
GWA	Accounting Technician II	503	G
GWA	Accounting Technician III	606	I
GWA	Administrative Aide	353	D
GWA	Administrative Assistant	527	H
GWA	Administrative Officer	611	I
GWA	Asset Man. and Maint. Information System Officer	913	L
GWA	Assistant Chief Engineer	1232	Q
GWA	Assistant Chief Financial Officer	1122	O
GWA	Assistant General Manager Collection & Distribution	1173	P
GWA	Assistant General Manager Compliance & Safety	1152	O
GWA	Assistant General Manager Production & Treatment	1173	P
GWA	Automotive Mechanic I	477	G
GWA	Automotive Mechanic II	561	I
GWA	Biologist I	590	H
GWA	Biologist II	708	J
GWA	Biologist III	848	K
GWA	Budget Analyst	779	K
GWA	Building Custodian	228	A
GWA	Buyer I	381	F
GWA	Buyer II	496	H
GWA	Buyer Supervisor I	735	J
GWA	Buyer Supervisor II	834	K

**CTP POSITIONS (GWA)**

Authority	Position	JE Points	Grade
GWA	Carpenter I	461	G
GWA	Carpenter II	543	I
GWA	Carpenter Leader	683	J
GWA	Cashier I	315	C
GWA	Cashier II	358	E
GWA	Centralized Wastewater Maintenance Superintendent	998	N
GWA	Chemist I	600	I
GWA	Chemist II	754	J
GWA	Chemist III	858	L
GWA	Chief Budget Officer	994	N
GWA	Chief Engineer, PE (GWA)	1514	R
GWA	Chief Water and Wastewater Systems Dispatcher	984	N
GWA	Clerk I	212	A
GWA	Clerk II	270	B
GWA	Clerk III	322	C
GWA	Clerk Typist I	270	B
GWA	Clerk Typist II	322	C
GWA	Clerk Typist III	346	D
GWA	Collection Agent	421	E
GWA	Collection Supervisor	795	K
GWA	Communications Manager	1060	N
GWA	Community Maintenance Worker	422	E
GWA	Computer Operations Supervisor	844	K
GWA	Computer Operator I	356	E
GWA	Computer Operator II	506	G
GWA	Computer Operator III	637	I

**CTP POSITIONS (GWA)**

Authority	Position	JE Points	Grade
GWA	Computer Technician I	479	G
GWA	Computer Technician II	575	I
GWA	Computer Technician Leader	709	J
GWA	Computer Technician Supervisor	897	L
GWA	Construction Inspector I	498	G
GWA	Construction Inspector II	622	I
GWA	Construction Inspector III	732	K
GWA	Contracts & Small Claims Administrator	798	K
GWA	Controller	1079	O
GWA	Customer Service Representative	461	G
GWA	Customer Service Representative Supervisor	795	K
GWA	Electrician I	478	G
GWA	Electrician II	569	I
GWA	Electrician Leader	712	J
GWA	Employee Development Specialist I	503	H
GWA	Employee Development Specialist II	670	J
GWA	Employee Development Specialist III	796	K
GWA	Engineer I	687	J
GWA	Engineer II	809	K
GWA	Engineer III	931	M
GWA	Engineer Supervisor	1044	O
GWA	Equipment Maintenance Superintendent	998	N
GWA	Equipment Operator-I	397	E
GWA	Equipment Operator II	445	F
GWA	Equipment Operator III	511	G
GWA	Equipment Operator IV	546	H



**CTP POSITIONS (GWA)**

Authority	Position	JE Points	Grade
GWA	Equipment Operator Leader I	644	I
GWA	Equipment Operator Leader II	661	J
GWA	Equipment Operator Supervisor	795	K
GWA	General Accounting Supervisor	1001	N
GWA	General Manager (GWA)	1734	S
GWA	GIS Analyst I	502	H
GWA	GIS Analyst II	612	J
GWA	GIS Analyst III	756	K
GWA	GIS/LIS Manager	910	L
GWA	Grants Administrator	994	N
GWA	Heavy Equipment Mechanic I	477	G
GWA	Heavy Equipment Mechanic II	561	I
GWA	Heavy Equipment Mechanic Leader	700	J
GWA	Heavy Equipment Mechanic Supervisor	909	L
GWA	Information Technology Manager	1064	O
GWA	Internal Auditor	1019	N
GWA	Inventory Management Officer	824	K
GWA	Laboratory Technician I	469	F
GWA	Laboratory Technician II	576	I
GWA	Laboratory Technician Supervisor	837	K
GWA	Land Agent I	362	E
GWA	Land Agent II	465	G
GWA	Land Agent III	531	I
GWA	Legal Secretary I	397	E
GWA	Legal Secretary II	460	G
GWA	Legal Secretary III	532	H

**CTP POSITIONS (GWA)**

Authority	Position	JE Points	Grade
GWA	Maintenance Welder I	477	G
GWA	Maintenance Welder II	557	I
GWA	Maintenance Welder III	696	J
GWA	Maintenance Worker	422	E
GWA	Management Analyst I	503	H
GWA	Management Analyst II	670	J
GWA	Management Analyst III	796	K
GWA	Management Analyst IV	913	L
GWA	Meter Reader I	319	C
GWA	Meter Reader II	406	E
GWA	Meter Reader Leader	553	H
GWA	Monitoring Laboratory Services Administrator	1074	O
GWA	Network Analyst	793	J
GWA	Network Systems Administrator	897	L
GWA	Operations & Maintenance Manager	1189	P
GWA	Payroll Clerk I	346	D
GWA	Payroll Clerk II	438	G
GWA	Payroll Clerk III	493	H
GWA	Payroll Supervisor	805	K
GWA	Personnel Assistant I	364	D
GWA	Personnel Assistant II	433	F
GWA	Personnel Services Administrator	1064	O
GWA	Personnel Specialist I	503	H
GWA	Personnel Specialist II	670	J
GWA	Personnel Specialist III	796	K
GWA	Personnel Specialist IV	913	L

**CTP POSITIONS (GWA)**

Authority	Position	JE Points	Grade
GWA	Planner / Co-ordinator I	503	H
GWA	Planner / Co-ordinator II	670	J
GWA	Planner / Co-ordinator III	796	K
GWA	Planner / Co-ordinator IV	913	L
GWA	Planner I	503	H
GWA	Planner II	670	J
GWA	Planner III	796	K
GWA	Planner IV	913	L
GWA	Plant Electrical Instrument Superintendent	1003	N
GWA	Plant Electrical Instrument Technician I	488	G
GWA	Plant Electrical Instrument Technician II	576	I
GWA	Plant Electrical Instrument Technician Leader	722	J
GWA	Program Coordinator I	503	H
GWA	Program Coordinator II	670	J
GWA	Program Coordinator III	796	K
GWA	Program Coordinator IV	913	L
GWA	Programmer Analyst I	683	J
GWA	Programmer Analyst II	910	L
GWA	Pumping Station Leader	702	J
GWA	Pumping Station Operator I	486	G
GWA	Pumping Station Operator II	568	I
GWA	Pumping Station Supervisor	866	L
GWA	Quality Control / Quality Assurance Officer	851	L
GWA	Refrigeration Mechanic I	477	G
GWA	Refrigeration Mechanic II	561	I
GWA	Refrigeration Mechanic Leader	696	J

**CTP POSITIONS (GWA)**

Authority	Position	JE Points	Grade
GWA	Right of Way Supervisor	915	L
GWA	Safety Inspector I	418	F
GWA	Safety Inspector II	539	H
GWA	Safety Inspector III	741	J
GWA	Safety Supervisor	872	K
GWA	Secretary I	378	E
GWA	Secretary I (Typist)	378	E
GWA	Secretary II	438	G
GWA	Secretary II (Typist)	438	G
GWA	Senior Engineer Supervisor, PE	1217	P
GWA	Senior Engineer, PE	1044	O
GWA	Senior Regulatory Analyst	1019	N
GWA	Sewer Plant Leader	702	J
GWA	Sewer Plant Operator I	486	G
GWA	Sewer Plant Operator II	568	I
GWA	Sewer Plant Supervisor	866	L
GWA	Shop Planner	786	K
GWA	Source Control Manager	980	M
GWA	Staff Attorney	1199	P
GWA	Storekeeper I	322	C
GWA	Storekeeper II	424	F
GWA	Supply Management Administrator	990	M
GWA	Survey Supervisor	900	L
GWA	Systems & Programming Administrator	968	L
GWA	Systems / Trouble Dispatch Supervisor	788	K
GWA	Systems Dispatcher I	660	J

**CTP POSITIONS (GWA)**

Authority	Position	JE Points	Grade
GWA	Systems Dispatcher II	788	K
GWA	Systems Dispatcher III	911	L
GWA	Technical Support Analyst	683	J
GWA	Tool Clerk	275	B
GWA	Trades Helper	272	B
GWA	Training & Development Manager	913	L
GWA	Training Specialist	503	H
GWA	Trouble Dispatcher	474	G
GWA	Trouble Dispatcher Leader	600	J
GWA	Trouble Dispatcher Supervisor	788	K
GWA	Utility Services Administrator	1075	O
GWA	Warehouse Supervisor I	724	J
GWA	Warehouse Supervisor II	803	K
GWA	Wastewater Collection Superintendent	998	N
GWA	Wastewater Construction / Maintenance Superintendent	998	N
GWA	Wastewater Maintenance Mechanic I	486	G
GWA	Wastewater Maintenance Mechanic II	568	I
GWA	Wastewater Maintenance Mechanic Leader	702	J
GWA	Wastewater Maintenance Mechanic Supervisor	866	L
GWA	Wastewater Plant Superintendent	998	N
GWA	Water & Wastewater Systems Control Dispatcher I	660	J
GWA	Water & Wastewater Systems Control Dispatcher II	788	K
GWA	Water / Sewer Maintenance Leader	702	J
GWA	Water / Sewer Maintenance Supervisor	866	L
GWA	Water / Sewer Maintenance Worker I	486	G
GWA	Water / Sewer Maintenance Worker II	568	I

**CTP POSITIONS (GWA)**

Authority	Position	JE Points	Grade
GWA	Water and Wastewater Systems Leader	702	J
GWA	Water Construction / Maintenance Superintendent	998	N
GWA	Water Distribution System Manager	998	N
GWA	Water Meter Maintenance & Repair Leader	702	J
GWA	Water Meter Maintenance & Repair Supervisor	866	L
GWA	Water Meter Maintenance & Repair Worker I	486	G
GWA	Water Meter Maintenance & Repair Worker II	568	I
GWA	Water Meter Reader I	319	C
GWA	Water Meter Reader II	406	E
GWA	Water Meter Reader Leader	553	H
GWA	Water Meter Reader Supervisor	734	J
GWA	Water Plant Leader	702	J
GWA	Water Plant Operator I	486	G
GWA	Water Plant Operator II	568	I
GWA	Water Plant Supervisor	866	L
GWA	Water Treatment Plant Superintendent	998	N
GWA	Welder I	477	G
GWA	Welder II	557	I
GWA	Welder III	696	J
GWA	Word Processing Secretary I	378	E
GWA	Word Processing Secretary II	438	G

**PROPOSED NEW POSITIONS TO ADD TO CTP LIST (GWA)**

Authority	Position	JE Points	Grade
GWA	Utility Accounting Technician I	431	F
GWA	Utility Accounting Technician II	503	G
GWA	Utility Accounting Technician III	606	I
GWA	Utility Administrative Aide	353	D
GWA	Utility Administrative Assistant	527	H
GWA	Utility Cashier I	315	C
GWA	Utility Cashier II	358	E
GWA	Utility General Accounting Supervisor	1001	N
GWA	Utility Personnel Assistant I	364	D
GWA	Utility Personnel Assistant II	433	F
GWA	Utility Storekeeper I	322	C
GWA	Utility Storekeeper II	424	F
GWA	Utility Trades Helper	272	B

Five (5) Sub-Step Implementation Range (15 <sup>th</sup> Market Percentile)											
UTILITY	STATUS	POSITION	JE	Structural Adjustment – MIN				Structural Adjustment - MAX			
				Base Salary	Grade	Step	Sub Step	Base Salary	Grade	Step	Sub Step
GWA	FILLED	Accounting Technician III	606	43,606	I	5	B	45,377	I	6	B
GWA	FILLED	Administrative Aide	353	29,366	D	4	A	30,559	D	5	A
GWA	FILLED	Administrative Assistant	527	39,323	H	5	C	40,920	H	6	C
GWA	FILLED	Cashier I	315	26,904	C	3	C	27,997	C	4	C
GWA	FILLED	Cashier II	315	30,247	E	4	A	31,475	E	5	A
GWA	FILLED	Storekeeper II	424	32,062	F	4	A	33,364	F	5	A
GWA	FILLED	Trades Helper	272	24,683	B	3	C	25,685	B	4	C

Five (5) Sub-Step Implementation Range (15 <sup>th</sup> Market Percentile)											
UTILITY	STATUS	POSITION	JE	Structural Adjustment – MIN				Structural Adjustment - MAX			
				Base Salary	Grade	Step	Sub Step	Base Salary	Grade	Step	Sub Step
GWA	NEW	Utility Personnel Assistant I	364	29,366	D	4	A	30,559	D	5	A
GWA	NEW	Utility Personnel Assistant II	433	32,706	F	4	C	34,034	F	5	C
GWA	NEW	General Accounting Supervisor	1001	82,303	N	3	D	85,645	N	4	D
GWA	NEW	Accounting Technician I	431	31,745	F	3	D	33,033	F	4	D
GWA	NEW	Accounting Technician II	503	36,076	G	5	C	37,541	G	6	C
GWA	NEW	Storekeeper I	322	26,904	C	3	C	27,997	C	4	C

## Appendix D2



Seven (7) Sub-Step Implementation Range (15 <sup>th</sup> Market Percentile)											
UTILITY	STATUS	POSITION	JE	Structural Adjustment – MIN				Structural Adjustment - MAX			
				Base Salary	Grade	Step	Sub Step	Base Salary	Grade	Step	Sub Step
GWA	FILLED	Accounting Technician III	606	42,747	I	4	D	45,377	I	6	B
GWA	FILLED	Administrative Aide	353	28,788	D	3	C	30,559	D	5	A
GWA	FILLED	Administrative Assistant	527	38,549	H	5	A	40,920	H	6	C
GWA	FILLED	Cashier I	315	26,374	3	C	A	27,997	C	4	C
GWA	FILLED	Cashier II	322	29,651	E	3	C	31,475	E	5	A
GWA	FILLED	Storekeeper II	424	31,430	F	3	C	33,364	F	5	A
GWA	FILLED	Trades Helper	272	24,196	B	3	A	25,685	B	4	C

Seven (7) Sub-Step Implementation Range (15 <sup>th</sup> Market Percentile)											
UTILITY	STATUS	POSITION	JE	Structural Adjustment – MIN				Structural Adjustment - MAX			
				Base Salary	Grade	Step	Sub Step	Base Salary	Grade	Step	Sub Step
GWA	NEW	Utility Personnel Assistant I	364	28,788	D	3	C	30,559	D	5	A
GWA	NEW	Utility Personnel Assistant II	433	32,062	F	4	A	34,034	F	5	C
GWA	NEW	General Accounting Supervisor	1001	80,682	N	3	B	85,645	N	4	D
GWA	NEW	Accounting Technician I	431	31,119	F	3	B	33,033	F	4	D
GWA	NEW	Accounting Technician II	503	35,366	G	5	A	37,541	G	6	C
GWA	NEW	Storekeeper I	322	26,374	C	3	A	27,997	C	4	C

## Appendix D3

**CONSOLIDATED COMMISSION ON UTILITIES**

**RESOLUTION NO. 2012-49**

***RESOLUTION RELATIVE TO AMENDING THE PROMOTION/DEMOTION/TRANSFER  
POLICY***

**WHEREAS**, the General Manager, Guam Power Authority petitions the Consolidated Commission on Utilities (CCU) to amend the Promotion/Demotion/Transfer Policy, and

**WHEREAS**, the CCU has the lawful authority under Public Law 28-159, Section 3.0.b to approve and amend a unified pay scale and implementation plan for employees in certified, technical, and professional positions; and

**WHEREAS**, the Guam Power Authority is a public corporation established and existing under the laws of Guam; and

**WHEREAS**, in 2007, the CCU adopted the recommendations of the Compensation and Benefits Study conducted by Alan Searle & Associates; and

**WHEREAS**, the CCU also endorsed a plan to transition GPA to the new compensation model over a five (5) year period beginning fiscal year 2008; and

**WHEREAS**, the transition plan also included a compensation formula used to determine new rates of pay upon an employee's promotion and/or demotion into another position; and

**WHEREAS**, based on the current pay policy, upon promotion, an employee's new base salary is determined by slotting the current salary into the higher pay grade closest to but not less than the current salary earned and is then awarded a further six sub-steps; and

1       **WHEREAS**, the implementation of the current pay policy distorts internal equity; and

2  
3       **WHEREAS**, when upon promotion, junior employees are slotted at the minimum range  
4 with an additional six sub-steps increase surpassing senior employees whose step placements  
5 were slotted at the minimum range at the time of a transitional movement to the next market  
6 percentile.

7  
8       **WHEREAS**, the proposed policy change corrects this problem by making a process  
9 change to when the six sub-steps is applied.

10  
11       **WHEREAS**, when an employee is being promoted the first step will be to identify a new  
12 base salary six sub-steps up from the employee's current base salary. If the new base salary is  
13 still below the minimum of the implementation range he/she is promoted to then they are slotted  
14 at the minimum of the new implementation range.

15  
16       **WHEREAS**, for demotions, the process will be applied with a six sub-step decrease  
17 down the grade prior to slotting into the new lower grade.

18  
19       **NOW THEREFORE, BE IT RESOLVED**, by the Consolidated Commission on Utilities  
20 does hereby approve and authorize as follows:

- 21  
22       1. The amendment of the Promotion/Demotion/Transfer Policy applicable to CTP  
23 positions and personnel at GPA as delineated in Appendices "D, E and F" of  
24 Exhibit 1.
- 25       2. That the Guam Waterworks Authority also review the effect of the pay policy  
26 applicable to the determination of new pay rates assigned upon a  
27 promotion/demotion/transfer of personnel in CTP positions as delineated in  
28 Appendices "D, E and F" of Exhibit 1.

**RESOLVED**, that the Chairman certified and the Board Secretary attests to the adoption of this Resolution.

**DULY AND REGULARLY ADOPTED** this 24th day of July, 2012.

**Certified by:**

**Attested by:**

**SIMON A. SANCHEZ, II**  
Chairperson  
Consolidated Commission on Utilities

**GLORIA B. NELSON**  
Secretary  
Consolidated Commission on Utilities

## SECRETARY'S CERTIFICATE

I, Gloria B. Nelson, Board Secretary of the Consolidated Commission on Utilities evidenced by my signature do hereby certify as follows:

The foregoing is a full, true and accurate copy of the resolution duly adopted at a regular meeting by the members of the Guam Consolidated Commission on Utilities, duly and legally held at a place properly noticed and advertised at which meeting a quorum was present and the members who were present voted as follows:

**AYES:**

4

**NAYS:**

0

**ABSTENTIONS:**

0

**ABSENT:**

1



GUAM POWER AUTHORITY  
HUMAN RESOURCES DIVISION  
STAFF REPORT

**I. REQUEST:**

The General Manager requests the Consolidated Commission on Utilities (CCU) to amend the Promotion/Demotion/Transfer Policy applicable to certified, technical, and professional (CTP) positions.

**II. AUTHORITY:** P.L. 28-159, Section 3.0.b.

**III. BACKGROUND:**

In March 2007, the CCU adopted the recommendations of the Compensation and Benefits Study conducted by Alan Searle and Associates. These recommendations included a comprehensive compensation methodology, a pay scale, an implementation plan and a list of positions distributed as List A and List B of certified, technical and professional positions. The scope of the study involved comparisons of all GPA positions to industry standards and the national average market conditions. This was necessary to retain employees and provide incentives to attract new ones. Further, the pay scale in effect prior to the adoption of the new pay scale was outdated and had not been revisited since its implementation in 1990.

In adopting the recommendations presented by Alan Searle and Associates, the CCU was prudent and endorsed a plan to transition GPA to the new compensation model over a five year period beginning in fiscal year 2008. The incremental transitions provide a more competitive market position for GPA. The initial structural adjustment was made to the 5th market percentile in 2008. In 2009, GPA targeted a second structural pay adjustment at the 15<sup>th</sup> market percentile. However, based on funding availability the second structural pay adjustment was allocated at the 10<sup>th</sup> market percentile. To date, most positions are on or near the 12<sup>th</sup> market percentile as a result of performance pay increments.

The recommendations adopted by the CCU also included a compensation formula that is used to determine new rates of pay upon an employee's promotion and or demotion into another position. Based on the current policy, 6% is tagged on to the new base salary in the higher grade closest to but not less than the current salary earned. At face value, the formula appeared to work well. However, in its implementation there was discrepancy overall in the slotting of new rates with regard the implementation range of a position during a transitional pay adjustment placing the new rate of pay above the minimum range creating internal inequity.

**IV. DISCUSSION:**


When moving from one market percentile to the next higher percentile, the impact in moving from a position of a lower grade and implementation pay range to a position of a higher grade and implementation pay range is significant. The result of this process is similar to a step to step movement which creates a wider gap between incumbent employees being bypassed by the newly promoted employees in the same position. It is important to note, that when moving from one market percentile to the next higher market percentile, there are incumbent employees in positions whose current salaries are below the minimum step of the implementation range. From there, their salaries will be brought up to the minimum range during the transitional and structural pay adjustment. There are also employees whose current salaries are slotted above the minimum step of the implementation range. This is where the discrepancy exists. Under the current pay policy, junior employees who are promoted are slotted above the minimum range with an additional six percent increase. Thus, exceeding current incumbents placements during a transitional movement.

The proposed amendment will provide the six percent increase from the employees current pay grade and sub-step prior to slotting into the new pay grade and sub-step of the position promoted to. This process will maintain internal equity between the positions and the gaps that exist between junior and senior employees. (See Exhibit 1 Alan Searle & Associates Report, May 2012).

**V. RECOMMENDATION:**

- a. To approve the amendment of the Promotion/Demotion/Transfer Policy applicable to CTP positions and personnel at GPA as delineated in Appendices "D, E and F" of Exhibit 1.
- b. To request that the Guam Waterworks Authority also review the effect of the pay policy applicable to the determination of new pay rates assigned upon the promotion/demotion/transfer of personnel in CTP positions as delineated in Appendices "D, E and F" of Exhibit 1.

  
Julie L. Quinata  
Personnel Services Administrator

 7/6/12  
JOAQUIN C. FLORES, P.E.  
General Manager, GPA

GUAM POWER AUTHORITY  
COMPENSATION & BENEFITS STUDY

Request to Amend  
Promotion / Demotion Policy  
May 2012



ALAN SEARLE & ASSOCIATES LIMITED

*Management Consultants, Auckland, New Zealand*

EXHIBIT "1"

Appendix E6

**INDEX**

Index	1
1. Background	2
2. Current Policy	2
3. Proposed Policy	2
4. Impact / Handling of Proposed Policy Change	3
5. Summary	4
Current Policy	
Appendix A : Current Promotion and Demotion Policy	5
Appendix B : Example of Current Policy (Promotions)	6
Appendix C : Example of Current Policy (Demotions)	7
Proposed Policy	
Appendix D : Proposed Promotion and Demotion Policy	8
Appendix E: Example of Proposed Policy (Promotions)	9
Appendix F : Example of Proposed Policy (Demotions)	10



## **GUAM POWER AUTHORITY**

### **Request To Amend Promotion / Demotion / Transfer Policy**

#### **1.0 Background**

When the compensation study for GPA and GWA was ratified a policy (Appendix A) concerning promotions, demotions and transfers was also included. However it has since been identified that under certain promotional situations employees are effectively receiving “two bites at the cake” so to speak. The certain situations referred to above are those instances where (prior to the promotion) the employee’s current base salary is below the minimum of the implementation range they are being promoted to. In this situation current policy is such that the employee is initially slotted at the minimum of the implementation range he/she is being promoted to (seen as the first “bite of the cake”) and is then awarded a further six sub-steps (seen as the second “bite of the cake”) in order to identify their new base salary. This policy whilst attractive to the employee being promoted needs to be amended in order to ensure internal relativities and equity are maintained.

Please note that the above also applies to PAG, GIAA and GCC who also have the same policy in place with regards their compensation models.

#### **2.0 Current Policy**

Current policy (to handling promotions and demotions) is outlined in Appendix A

An example of current policy relating to promotions is outlined in Appendix B

An example of current policy relating to demotions is outlined in Appendix C

#### **3.0 Proposed Policy**

The proposed policy change corrects the problem by simply making a process change to when the six sub-steps is applied. In short, when an employee is being promoted the first step will be to identify a new base

salary six sub-steps up from the employee's current base salary (grade, step and sub-step). If this new base salary is still below the minimum of the implementation range he/she is being promoted to then they are simply slotted at the minimum of the new implementation range. If on the other hand the new base salary is above the minimum of the implementation range he/she is being promoted to then they would be slotted at the closest sub-step just on the high side.

In summary, the proposed change simply applies (as an initial step) the six sub-steps to the employee's current base salary and grade. For promotions this is a six sub-step increase up the grade or for demotions it is a six sub-step decrease down the grade. This then identifies a value that can then be compared to the implementation range of the position the employee is being promoted or demoted to.

The proposed policy (to handling promotions and demotions) is outlined in Appendix D

An example of the proposed policy relating to promotions is outlined in Appendix E

An example of the proposed policy relating to demotions is outlined in Appendix F

#### **4.0 Impact / Handling of Proposed Policy Change**

Whilst some employees at GPA have benefited from existing policy in the handling of their promotion we cannot turn around now and reduce their base salaries as the policy was correctly followed at the time the promotion was calculated. However, any advantage can be brought back to a "level playing field" when GPA / GWA make their next structural adjustment in pay and move i.e. to a higher market percentile. For information purposes, both GPA / GWA are currently around the 10<sup>th</sup> - 15<sup>th</sup> market percentile compared to utilities (both electric and water) on the U.S. mainland.

The "level playing field" is achieved as follows : when the next structural adjustment is calculated we identify (which is part of the normal process) a new implementation range for every position. With regards the minimum of that range an employee's current base salary is either above or below it. So therefore the salary of an employee who (by virtue of their promotion) may have exceeded a longer serving employee in the same position are now both treated the same and depending on the implementation criteria will be slotted accordingly.



## **5.0 Summary**

Whilst current promotion policy has benefited some employees slightly the situation can be corrected.

As outlined earlier, the optimum time to make that change is when GPA / GWA make their next structural adjustment in pay and move to a higher market percentile. The process is straightforward for once the new implementation ranges have been identified (at the preferred market percentile) all employees are treated the same, and as previously outlined, depending on the implementation criteria will be slotted accordingly.

## **APPENDIX A**

### **1.1 Promotion**

- a) A pay adjustment resulting in an increase / promotion either by competition, reclassification, pay grade reassignment or temporary appointment is effectuated by identifying from the new pay grade the salary (sub-step) closest to, but not less than the salary currently being received prior to promotion plus an additional six (6) sub-steps. This identifies the new base salary.
- b) A pay adjustment where the salary received prior to promotion is below the low end of the new implementation range shall be slotted at the lowest sub-step of the new implementation range plus an additional six (6) sub-steps. This identifies the new base salary.
- c) The General Manager at his / her discretion, or upon the recommendation of a respective Division Manager, may grant up to three (3) additional sub-steps, based on superior performance, significant contributions made to the business unit or the Authority as a whole, or demonstration of personal enrichment and development related to and beyond the job requirement. All requests for additional sub-step placement must be justified in writing.

### **1.2 Demotion**

- a) A pay adjustment resulting in a decrease either by demotion, voluntary, reclassification, or pay grade reassignment is effectuated by identifying from the amended pay grade the salary (sub-step) closest to, but not more than the salary (sub-step) currently being received prior to demotion less an additional six (6) sub-steps. This identifies the new base salary.
- b) A pay adjustment where the salary received prior to demotion, voluntary, reclassification, or pay grade reassignment is below the lowest sub-step of the new implementation range shall be slotted at the lowest sub-step of the new implementation range. This identifies the new base salary.

*APPENDIX "A"*

Appendix E11

## Appendix B : Example - Promotions (Current Policy)

			Step 3						Step 4							Step 5							Step 6							Step 7							Step 8						
	C	D	A	B	C	D	A	B	C	D	A	B	C	D	A	B	C	D	A	B	C	D	A	B	C	D	A	B	C	D	A	B	C	D	A	B	C						
Position A	33,309	33,642	33,978	34,318	34,861	35,008	35,358	35,712	36,060	36,429	36,794	37,162	37,533	37,909	38,288	38,671	39,057	39,448	39,842	40,241	40,643	41,050	41,460	41,875	42,293																		
Position B	37,972	38,352	38,735	39,123	39,514	39,909	40,308	40,711	41,118	41,530	41,945	42,364	42,788	43,216	43,648	44,084	44,525	44,971	45,420	45,874	46,333	46,797	47,264	47,737	48,214																		
Position C	43,288	43,721	44,158	44,600	45,046	45,496	45,951	46,411	46,875	47,344	47,817	48,295	48,778	49,266	49,759	50,256	50,759	51,268	51,779	52,297	52,820	53,348	53,881	54,420	54,965																		

☐ Low end of implementation range

☐ Employees current grade, step and sub-step prior to promotion i.e. Grade I, Step 8, Sub-step B (\$41,875)

Step 1 : Initially move to closest sub-step on new grade (high side) i.e. Grade J, Step 5, Sub-step A (\$41,945)

☐ Step 2 : Increase by a further 6 (six) sub-steps to identify final grade, step and sub-step i.e. Grade J, Step 6, Sub-step C (\$44,525)

	Step 2					Step 3					Step 4					Step 5					Step 6					Step 7					Step 8					
	A	B	C	D	A	B	C	D	A	B	C	D	A	B	C	D	A	B	C	D	A	B	C	D	A	B	C	D	A	B	C	D	A	B	C	D
Position A	25,125	25,376	25,630	25,886	26,145	26,407	26,671	26,937	27,207	27,479	27,754	28,031	28,312	28,595	28,881	29,169	29,461	29,756	30,053	30,354	30,657	30,964	31,274	31,586	31,902											
Position B	28,643	28,929	29,218	29,510	29,806	30,104	30,405	30,709	31,016	31,326	31,639	31,956	32,275	32,598	32,924	33,253	33,586	33,922	34,261	34,603	34,949	35,299	35,652	36,008	36,368											
				1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	25	26	27	28	29	30	31	32	

☐ Low end of implementation range

☐ Employees current grade, step and sub-step prior to promotion i.e. Grade G, Step 4, Sub-step C (\$27,754)

Step 1 : As employees current base salary is below minimum initially move to low end of implementation range of new grade i.e. Grade H, Step 2, Sub-step C (\$29,218)

☐ Step 2 : Increase by 6 (six) sub-steps to identify new grade, step and sub-step i.e. Grade H, Step 4, Sub-step A (\$31,016)

## Appendix C : Example - Demotions (Current Policy)

			Step 3						Step 4						Step 5						Step 6						Step 7						Step 8					
	C	D	A	B	C	D	A	B	C	D	A	B	C	D	A	B	C	D	A	B	C	D	A	B	C	D	A	B	C	D	A	B	C					
Position A	33,309	33,642	33,978	34,318	34,661	35,008	35,358	35,712	36,069	36,429	36,794	37,162	37,533	37,909	38,288	38,671	39,057	39,448	39,842	40,241	40,643	41,050	41,460	41,875	42,293													
Position B	37,972	38,352	38,735	39,123	39,514	39,909	40,308	40,711	41,118	41,530	41,945	42,364	42,788	43,216	43,648	44,084	44,525	44,971	45,420	45,874	46,333	46,797	47,264	47,737	48,214													
Position C	43,268	43,721	44,158	44,600	45,046	45,496	45,951	46,411	46,875	47,344	47,817	48,295	48,778	49,266	49,759	50,256	50,759	51,266	51,779	52,297	52,820	53,348	53,881	54,420	54,965													

Low end of Implementation range

Employees current grade, step and sub-step prior to demotion i.e. Grade J, Step 5, Sub-step A (\$41,945)

Step 1 : Initially move to closest substep on lower grade (low side) i.e. Grade I, Step 8, Sub-step B (\$41,875)

Step 2 : Decrease by 6 (six) sub-steps to identify final grade, step and sub-step i.e. Grade I, Step 6, Sub-step D (\$39,448)

			Step 3				Step 4					Step 5				Step 6					Step 7					Step 8				
	C	D	A	B	C	D	A	B	C	D	A	B	C	D	A	B	C	D	A	B	C	D	A	B	C	D	A	B	C	
Position A	33,309	33,642	33,978	34,318	34,661	35,008	35,358	35,712	36,069	36,429	36,794	37,162	37,533	37,909	38,288	38,671	39,057	39,448	39,842	40,241	40,643	41,050	41,460	41,875	42,293					
Position B	37,972	38,352	38,735	39,123	39,514	39,909	40,308	40,711	41,118	41,530	41,945	42,364	42,788	43,216	43,648	44,084	44,525	44,971	45,420	45,874	46,333	46,797	47,264	47,737	48,214					
Position C	43,288	43,721	44,158	44,600	45,046	45,498	45,951	46,411	46,875	47,344	47,817	48,295	48,778	49,266	49,769	50,258	50,759	51,266	51,779	52,297	52,820	53,348	53,881	54,420	54,965					

Low end of Implementation range

Employees current grade, step and sub-step prior to demotion i.e. Grade J, Step 2, Sub-step D (\$38,352)

Step 1 : Initially move to closest substep on lower grade (low side) i.e. Grade I, Step 6, Sub-step A (\$38,288)

Step 2 : Decrease by 6 (six) sub-steps to identify final grade, step and sub-step i.e. Grade I, Step 4, Sub-step C (\$36,069)

Note : if six (6) sub-steps cannot be taken, take low end of Implementation range as new base salary

APPENDIX "C"  
Appendix E13

## APPENDIX D

### 1.1 Promotion

A pay adjustment resulting in a promotion either by competition, reclassification, pay grade reassignment or temporary appointment is effectuated by initially increasing the employee's current base salary by six (6) sub-steps on the grade they are currently allocated. If this figure is :

- a) below the minimum of the new implementation range they would be slotted at the minimum of the new implementation range. This identifies the employee's new base salary.
- b) above the minimum of the new implementation range they would be slotted at the closest sub-step (just on the high side) of the new grade. This identifies the employee's new base salary.
- c) The General Manager at his / her discretion, or upon the recommendation of a respective Division Manager, may grant up to three (3) additional sub-steps, based on superior performance, significant contributions made to the business unit or the Authority as a whole, or demonstration of personal enrichment and development related to and beyond the job requirement. All requests for additional sub-step placement must be justified in writing.

### 1.2 Demotion

A pay adjustment resulting in a decrease either by demotion, voluntary, reclassification, or pay grade reassignment is effectuated by initially decreasing the employee's current base salary by six (6) sub-steps on the grade they are currently allocated. If this figure is :

- d) below the minimum of the new implementation range they would be slotted at the minimum of the new implementation range. This identifies the employee's new base salary.
- e) above the minimum of the new implementation range they would be slotted at the closest sub-step (just on the low side) of the new grade. This identifies the employee's new base salary.

*APPENDIX "D"*  
Appendix E14

## Appendix E : Example - Promotions (Proposed Policy)

## SCENARIO 1.

		Step 2				Step 3				Step 4				Step 5				Step 6				Step 7	
		A	B	C	D	A	B	C	D	A	B	C	D	A	B	C	D	A	B	C	D	A	B
Position A	Grade F	25,125	25,376	25,630	25,886	26,145	26,407	26,671	26,937	27,207	27,479	27,754	28,031	28,312	28,595	28,881	29,169	29,461	29,756	30,053	30,354	30,657	30,964
Position B	Grade H	28,643	28,929	29,218	29,510	29,806	30,104	30,405	30,709	31,016	31,326	31,639	31,956	32,275	32,598	32,924	33,253	33,586	33,922	34,261	34,603	34,949	35,299

Low end of implementation ranges (both Positions A &amp; B)

Employees current grade, step and sub-step prior to promotion i.e. Grade F, Step 4, Sub-step A (\$27,207)

Step 1 : Initially move up the employees current grade by six sub-steps to identify a value i.e. Grade F, Step 5, Sub-step C (\$28,881)

Step 2 : Transpose that value to the new grade that the employee is being promoted to and to the closest sub-step "just on the high side" i.e. Grade H, Step 2, Sub-step B (\$28,929)

As this value is still BELOW the minimum of the new implementation range the employee would move to the minimum of the new implementation range i.e. Grade H, Step 3, Substep C (\$30,405) as their new base salary

## SCENARIO 2.

		Step 2				Step 3				Step 4				Step 5				Step 6				Step 7	
		A	B	C	D	A	B	C	D	A	B	C	D	A	B	C	D	A	B	C	D	A	B
Position A	Grade F	25,125	25,376	25,630	25,886	26,145	26,407	26,671	26,937	27,207	27,479	27,754	28,031	28,312	28,595	28,881	29,169	29,461	29,756	30,053	30,354	30,657	30,964
Position B	Grade H	28,643	28,929	29,218	29,510	29,806	30,104	30,405	30,709	31,016	31,326	31,639	31,956	32,275	32,598	32,924	33,253	33,586	33,922	34,261	34,603	34,949	35,299

Low end of implementation ranges (both Positions A &amp; B)

Employees current grade, step and sub-step prior to promotion i.e. Grade F, Step 5, Sub-step C (\$28,881)

Step 1 : Initially move up the employees current grade by six sub-steps to identify a value i.e. Grade F, Step 7, Sub-step A (\$30,657)

Step 2 : Transpose that value to the new grade that the employee is being promoted to and to the closest sub-step "just on the high side" i.e. Grade H, Step 3, Sub-step D (\$30,709)

As this value is ABOVE the minimum of the new implementation range the employee would stay at that value i.e. Grade H, Step 3, Sub-step D (\$30,709) as their new base salary



## Appendix F : Example - Demotions (Proposed Policy)

SCENARIO 1.

		Step 2				Step 3				Step 4				Step 5				Step 6				Step 7	
		A	B	C	D	A	B	C	D	A	B	C	D	A	B	C	D	A	B	C	D	A	B
Position A	Grade F	25,125	25,376	25,630	25,886	26,145	26,407	26,671	26,937	27,207	27,479	27,754	28,031	28,312	28,596	28,881	29,169	29,461	29,756	30,053	30,354	30,657	30,964
Position B	Grade H	28,643	28,929	29,218	29,510	29,806	30,104	30,405	30,708	31,016	31,326	31,639	31,956	32,275	32,598	32,924	33,253	33,586	33,922	34,261	34,603	34,949	35,299

Low end of implementation ranges (both Positions A &amp; B)

Employees current grade, step and sub-step prior to demotion i.e. Grade H, Step 5, Sub-step B (\$32,598)

Step 1 : Initially move down six sub-steps from the employees current salary to identify a value i.e. Grade H, Step 3, Sub-step D (\$30,709)

Step 2 : Transpose that value to the new grade that the employee is being demoted to, and to the closest sub-step "just on the low side" i.e. Grade F, Step 7, Sub-step A (\$30,657)

As this value is still ABOVE the minimum of the new implementation range management reserves the right (depending on the circumstances of the demotion) to further reduce this to the minimum.

SCENARIO 2.

		Step 2				Step 3				Step 4				Step 5				Step 6				Step 7	
		A	B	C	D	A	B	C	D	A	B	C	D	A	B	C	D	A	B	C	D	A	B
Position A	Grade F	25,125	25,376	25,630	25,886	26,145	26,407	26,671	26,937	27,207	27,479	27,754	28,031	28,312	28,595	28,881	29,169	29,461	29,756	30,053	30,354	30,657	30,964
Position B	Grade H	28,643	28,929	29,218	29,510	29,806	30,104	30,405	30,708	31,016	31,326	31,639	31,956	32,275	32,598	32,924	33,253	33,586	33,922	34,261	34,603	34,949	35,299

Low end of implementation ranges (both Positions A &amp; B)

Employees current grade, step and sub-step prior to demotion i.e. Grade H, Step 3, Sub-step D (\$30,709)

Step 1 : Initially move down six sub-steps from the employees current salary to identify a value i.e. Grade H, Step 2, Sub-step B (\$28,929). Please note (that with this scenario) this action goes below the minimum of the current grade.

Step 2 : Transpose that value to the new grade that the employee is being demoted to, and to the closest sub-step "just on the low side" i.e. Grade F, Step 5, Sub-step C (\$28,881)

As this value is still ABOVE the minimum of the new implementation range management reserves the right (depending on the circumstances of the demotion) to further reduce this to the minimum.



**GUAM WATERWORKS AUTHORITY**

*"Better Water, Better Lives."*

Gloria B. Nelson Public Service Building | 688 Route 15 | Mangilao, Guam 96913

Tel: (671) 300-6846

## **Issues for Decision**

### **Resolution No. 03- FY2018**

Relative to Approving the Construction Management Contract for Tumon No. 2, Hyundai, and Chaot No. 2 Tank and System Upgrades

#### **What is the project's objective and is it necessary and urgent?**

The project is part of the 2011 Court Order Paragraph 29 – Storage Tank/Reservoir Repair, Replacement, and Relocation Program. As a Court Order project, it is necessary and urgent to work towards meeting the Court Order deadlines. The project's objective is to provide construction management services for the construction of the Tumon No. 2, Hyundai, and Chaot No. 2 tank project. The construction management contract includes Tumon No. 2 tank with offsite upgrades, Hyundai tank, and Chaot off-site upgrades.

#### **Where is the location?**

Tumon No. 2: The tank is located on Marine Corp. Drive adjacent to the Nissan Dealership. Offsite upgrades will include PRVs on Pale San Vitores Road and Marine Corp Drive.

Hyundai: The tank is located in Barrigada Heights off South Sabana Drive.

Chaot Offsite: Work is located on Dero Road, A-Series wells, and the Chaot/Agana Height tank sites.

#### **How much will it cost?**

The fee proposal is for One Million Nine Hundred Fifty Four Thousand Eighty Nine Dollars (\$1,954,089.00). Scope of work includes Tumon No. 2 tank with offsite work, Hyundai tank, and Chaot offsite work. With a ten percent (10%) contingency included of One Hundred Ninety Five Thousand Four Hundred Eight Dollars and Ninety Cents (\$195,408.90), to bring the total authorized funding amount to Two Million One Hundred Forty Nine Thousand Four Hundred Ninety Seven Dollars and Ninety Cents (\$2,149,497.90) is \$2,149,497.90.

#### **When will it be completed?**

CM services is for 16 months. The start date is dependent on the construction contract.

#### **What is the funding source?**

The funding shall be from PW 09-11: Water System Reservoirs 2005 Improvements, PW 12-04: Agana Heights and Chaot Tank Construction, and PW 12-06: Tank Replacement Piti and Hyundai Tanks.

#### **The RFP/BID responses (if applicable):**

- RFP-02-ENG-2017
- 22 firms RFP picked up
- 7 firms submitted
- TG Engineers recommended for award



CONSOLIDATED COMMISSION ON UTILITIES  
Guam Power Authority | Guam Waterworks Authority  
P.O. Box 2977 Hagatna, Guam 96932 | (671)649-3002 | guamccu.org

**GWA RESOLUTION NO. 03– FY2018**

**RELATIVE TO APPROVING THE CONSTRUCTION MANAGEMENT CONTRACT  
FOR TUMON NO. 2, HYUNDAI, AND CHAOT NO. 2 TANK  
AND SYSTEM UPGRADES**

**WHEREAS**, under 12 G.C.A. § 14105, the Consolidated Commission on Utilities (“CCU”) has plenary authority over financial, contractual and policy matters relative to the Guam Waterworks Authority (“GWA”); and

**WHEREAS**, the Guam Waterworks Authority (“GWA”) is a Guam Public Corporation established and existing under the laws of Guam; and

**WHEREAS**, GWA is currently working on critical reservoir projects under the 2011 Court Order (“CO”) Paragraph 29 – Storage Tank/Reservoir Repair, Replacement, and Relocation Program; and

**WHEREAS**, the design of Tumon No. 2, Hyundai, and Chaot No. 2 Tank designs have been completed and are out for bid (IFB-09-ENG-2017); and

**WHEREAS**, GWA has advertised the Request For Proposals (RFP-02-ENG-2017) soliciting statement of qualifications from experienced and qualified engineering firms to provide construction management services for the Tumon No. 2, Hyundai, and Chaot No. 2 Tank and System Upgrades project; and

**WHEREAS**, RFP packages were picked up by 22 interested parties, from which GWA received proposal submittals from 7 firms before the RFP submittal deadline; and

1       **WHEREAS**, the GWA A-E Selection committee reviewed and evaluated the 7 proposals  
2 (See Exhibit A – Score Summary) and generated a short list of the top 3 firms with a  
3 recommendation to award a contract to the firm TG Engineers (See Exhibit B – GM’s  
4 Determination); and

5  
6       **WHEREAS**, TG Engineers and GWA negotiated the price for the construction  
7 management services for the Base Bid Construction (Tumon No. 2 tank/offsite, Hyundai tank,  
8 and Chaot No. 2 offsite work) to be provided in the total amount of One Million Nine Hundred  
9 Fifty Four Thousand Eighty Nine Dollars (\$1,954,089.00) (See Exhibit C – Scope of Work and  
10 Fees); and

11  
12       **WHEREAS**, GWA management seeks approval of the fee proposal amount of One  
13 Million Nine Hundred Fifty Four Thousand Eighty Nine Dollars (\$1,954,089.00), along with a  
14 ten percent (10%) contingency of One Hundred Ninety Five Thousand Four Hundred Eight  
15 Dollars and Ninety Cents (\$195,408.90), to bring the total authorized funding amount to a  
16 maximum of Two Million One Hundred Forty Nine Thousand Four Hundred Ninety Seven  
17 Dollars and Ninety Cents (\$2,149,497.90); and

18  
19       **WHEREAS**, funding for this project will be from the Bond Funds under the line items  
20 “PW 09-11 Water System Reservoirs 2005 Improvements”, “PW 12-04 Agana Heights and  
21 Chaot Tank Construction”, and “PW 12-06 Tank Replacement Piti and Hyundai Tanks”; and

22       **NOW BE IT THEREFORE RESOLVED**, the Consolidated Commission on Utilities  
23 does hereby approve the following:  
24

- 25
- 26       1. The recitals set forth above hereby constitute the findings of the CCU.
  - 27       2. The CCU finds that the terms of the fee proposal submitted by TG Engineers  
28       are fair and reasonable.
  - 29       3. The CCU hereby authorizes the management to accept the fee proposal from  
30       TG Engineers, which is also incorporated into this Resolution in its entirety.
- 31  
32

4. The CCU hereby further authorizes the management of GWA to enter into a contract with TG Engineers, in the amount of One Million Nine Hundred Fifty Four Thousand Eighty Nine Dollars (\$1,954,089.00) (Exhibit C).
5. The CCU hereby further approves the total funding amount for this project of One Million Nine Hundred Fifty Four Thousand Eighty Nine Dollars (\$1,954,089.00), along with a ten percent (10%) contingency of One Hundred Ninety Five Thousand Four Hundred Eight Dollars and Ninety Cents (\$195,408.90), to bring the total authorized funding amount to Two Million One Hundred Forty Nine Thousand Four Hundred Ninety Seven Dollars and Ninety Cents (\$2,149,497.90).
6. Funding source shall be the following:
  - PW 09-11: Water System Reservoirs 2005 Improvements
  - PW 12-04: Agana Heights and Chaot Tank Construction
  - PW 12-06: Tank Replacement Piti and Hyundai Tanks

**RESOLVED**, that the Chairman certified and the Board Secretary attests to the adoption of this Resolution.

**DULY AND REGULARLY ADOPTED**, this 20<sup>th</sup> day of October 2017.

Certified by:

Attested by:

\_\_\_\_\_  
**JOSEPH T. DUENAS**  
Chairperson

\_\_\_\_\_  
**J. GEORGE BAMBA**  
Secretary

//

//

//

**SECRETARY'S CERTIFICATE**

I, J. George Bamba, Board Secretary of the Consolidated Commission on Utilities as evidenced by my signature above do hereby certify as follows:

The foregoing is a full, true and accurate copy of the resolution duly adopted at a regular meeting by the members of the Guam Consolidated Commission on Utilities, duly and legally held at a place properly noticed and advertised at which meeting a quorum was present and the members who were present voted as follows:

AYES: \_\_\_\_\_

NAYS: \_\_\_\_\_

ABSTENTIONS: \_\_\_\_\_

ABSENT: \_\_\_\_\_

///

///

///

///

///

///

///

## EXHIBIT "A"

**GUAM WATERWORKS AUTHORITY**

Gloria B. Nelson Public Service Building • 688 Route 15 • Mangilao, Guam 96913

April 4, 2017

To: Thomas F. Cruz, P.E., Chief Engineer

From: Gloria P. Bensen  
Chairperson, Consultant Selection BoardSubject: RFP-02-ENG-2017  
Construction Management Services for the Central Guam Reservoirs (Tumon No. 2, Hyundai, and Chaot No. 2) Tank and System Upgrades  
GWA Project No. W14-006-BND

The following information is intended to document the evaluation process undertaken for the referenced solicitation.

EVALUATION COMMITTEE MEMBERS	
Name	Title
Brett Bailey, P.E.	CIP Water Engineer Supervisor
Garrett Yeoh	Senior Engineer
Marc Lopez	Associate Engineer
Vincent Pangelinan	Operations Manager

Consultant	Evaluation Score				Total	Rank
1. EMPSCO Engineering Consultants	60	74	65	73	272	6
2. SSFM	79	88	86	84	337	2
3. E.M. Chen & Associates, Inc.	65	74	60	69	268	7
4. TG Engineers, PC	80	95	92	88	355	1
5. LYON	58	76	77	80	291	4
6. AmOrient	61	75	72	77	285	5
7. Duenas, Camacho & Associates	75	78	76	84	313	3

Scores were evaluated based on sum of the individual scores. The recommendation of the evaluation committee is shown in the ranking above.

Please review and approve at your earliest convenience so that we may proceed with the notification letters.

EXHIBIT "B"


**GUAM WATERWORKS AUTHORITY**

**"Better Water. Better Lives."**

Gloria B. Nelson Public Service Building  
688 Route 15, Mangilao, Guam 96913

**MEMORANDUM**

To: Miguel C. Bordallo, P.E., General Manager

From: Thomas F. Cruz, P.E., Chief Engineer 

Subject: RFP-02-ENG-2017  
Construction Management Services for the Central Guam Reservoirs (Tumon No. 2, Hyundai, and Chaot No. 2) Tank and System Upgrades  
GWA Project No. W14-006-BND


Date: April 4, 2017

The Selection Committee has completed all necessary actions for selecting the most qualified consultant for the referenced solicitation. All proposals were reviewed and scored according to the conditions established in the solicitation. The evaluation summary sheet is attached for your information.

The committee recommends the following top three (3) firms in order of preference for the project:

1. TG Engineers, PC
2. Duenas, Camacho & Associates
3. SSFM

Concurred:

  
VINCENT E. GUERRERO  
Supply Management Administrator

4/5/17  
Date

**GENERAL MANAGER'S DETERMINATION**

Consultant Firm Selected:

TG ENGINEERS

Remarks:

  
MIGUEL C. BORDALLO, P.E.  
General Manager

4.10.17  
Date

TFC/gb 



EXHIBIT "C"



September 11, 2017

Mr. Miguel C. Bordallo, P.E.  
General Manager  
Guam Waterworks Authority  
Engineering Division  
Gloria B. Nelson Public Service Building  
688 Route 15, Mangilao, GU 96913

Attn: Mr. Thomas Cruz, P.E., Chief Engineer

**RE: FEE PROPOSAL FOR CONSTRUCTION MANAGEMENT SERVICES: TUMON NO. 2, HYUNDAI, AND CHAOT NO. 2 TANK AND SYSTEM UPGRADES GWA PROJECT NO. W14-006-BND; RFP 02-ENG-2017**

Hafa Adai Tom,

TG Engineers, PC (TGE) is pleased to submit our updated Fee Proposal for the referenced project.

1.0 PROJECT DESCRIPTION

The project is construction of the first 3-water storage tanks from the GWA Central Reservoirs project group as follows.

- Chaot No. 2 - PENDING
- Tumon No. 2 (Nissan)
- Hyundai

As requested in the email from Mr. Garrett Yeoh, dated July 14, 2017, we have evaluated 3-different Base Bid and Base Bid Plus Additive Bid scenarios. In general, we have adjusted Inspector, Office Engineer and Document Control personnel time to match the expected work requirements for each scenario.

2.0 SCOPE OF SERVICES

Please refer to the Scope of Work issued with the RFP, pages 14-26.

3.0 FEES

We estimate to complete these CM services for the fees shown as follows with the different bid scenarios. Please refer to the TGE Fee Spreadsheets attached for the time, expenses and breakdown.

BID SCENARIO	FEE ESTIMATE
<u>Base Bid</u> Chaot Tank – excluded Chaot Offsite – included Tumon No. 2 Tank and including offsite Hyundai Tank – included Hyundai Offsite – excluded	\$1,954,089.00
<u>Base Bid Plus Additive Bid 1 or 2</u> (Hyundai Offsite Part 1 or 2)	\$2,054,124.00
<u>Base Bid Plus Additive Bids 1 &amp; 2</u> (Hyundai Offsite parts 1 & 2)	\$2,088,062.00

We have included current pricing for 1-vehicle, equipment and software expenses and assume these will be updated to incorporate any increases at the project start.

#### 4.0 SCHEDULE & DELIVERABLES

As clarified in the email from Mr. Garrett Yeoh, dated July 14, 2017, we are planning on tentative construction schedules as follows.

- Chaot No. 2 = PENDING
- Chaot Offsite = 14-mos
- Tumon No. 2 = 14-mos
- Hyundai = 14-mos

#### 5.0 ASSUMPTIONS

- 5.1 The schedule assumes 14-months for construction plus 2-months of closeout and post-construction services (total 14+2 = 16-months). We will evaluate if additional time requirements are needed for closeout and post-construction tasks later in the project.
- 5.2 We have adjusted labor rates matching our annual office increases in June.
- 5.3 We have increased the number of Water Pressure Data Loggers to 25, based on a request from Garrett Yeoh.

#### 6.0 PERSONNEL SUBSTITUTION

As discussed, we are Planning on including Mr. Robert Marks for the Senior Construction Manager position. We believe Mr. Marks, leading and together with the full CM team will be an effective team arrangement.

GWA reserves the right to remove the Construction Manager, Engineers, Inspectors and any onsite staff if he/she does not perform to the GWA's expectations.


GWA Central Reservoir CM Proposal

9/11/2017

We are submitting this in electronic file format and will deliver printed copies once the final pricing is accepted

Please call Teena Barnes or myself at 647-0808 with any comments or questions.

Si Yu'os Ma'ase,  
TG Engineers, PC

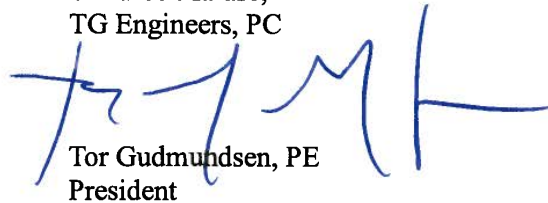A handwritten signature in blue ink, appearing to be 'TGM', is written over the printed name of Tor Gudmundsen.

Tor Gudmundsen, PE  
President

Attachments:

TGE Fee Spreadsheet  
Dated 9/11/17, 6-pages

## Guam Waterworks Authority

## Fee Proposal Spreadsheet

9/11/2017

Tumon No. 2, Hyundai, and Chaot No. 2 Tank and System Upgrades CM

Base Bid

Page 1 of 2

## PERIOD OF NOVEMBER 2017 - JUNE 2018

PHASE/ TASK	TASK DESCRIPTION	Principal	Const Mgr	Chaot Insp	Tumon Insp	Hyundai Insp	Office Engr #1	Office Engr #2	Doc Ctrl #1	Doc Ctrl #2	Sr Engr	CAD	Clerical	TOTAL COST
<b>2017 - 2018 HOURLY LABOR RATES</b>		\$221.00	\$185.00	\$74.00	\$74.00	\$74.00	\$74.00	\$74.00	\$50.00	\$50.00	\$195.00	\$106.00	\$50.00	
<b>A PRECONSTRUCTION</b>														
1.0	Design Review - Chaot No. 2													\$0
2.0	Design Review - Tumon No. 2													\$0
3.0	Design Review - Hyundai													\$0
4.0	CM QA & Const Mgmt Plans	1.0	10.0				10.0						10.0	\$3,311
5.0	CM Software Training	1.0	8.0	0.0	8.0	8.0	8.0	8.0	8.0	8.0			15.0	\$5,619
6.0	Attend Pre-Bid Meeting/Process Bid RFI's		25.0				25.0						10.0	\$6,975
7.0	Bid Analysis & Award Recommendation	1.0	25.0										10.0	\$5,346
<b>Subtotal Hours</b>		3.0	68.0	0.0	8.0	8.0	43.0	8.0	8.0	8.0	0.0	0.0	45.0	<b>\$21,251</b>
<b>B CONSTRUCTION PHASE</b>														
1.0	Project Controls	24.0	864.0	0.0	270.0	270.0	864.0	540.0	1080.0	540.0	0.0	20.0	60.0	\$395,120
	Project Correspondence													
	Submittal Review													
	Payment Requests													
	Project Meetings													
	Requests for Information													
	Claims and Disputes													
	Project Records													
2.0	Construction Inspection		216.0	0.0	810.0	810.0	216.0	0.0			0.0			\$175,824
	Onsite Inspection													
	Acceptance of Work													
	Stop Work Orders													
	Change Orders													
	Change Order Reviews													
	Design Change													
	DCVR													
<b>Subtotal Hours</b>		24.0	1080.0	0.0	1,080.0	1,080.0	1080.0	540.0	1080.0	540.0	0.0	20.0	60.0	<b>\$570,944</b>

## PERIOD OF JULY 2018 - JUNE 2019

PHASE/ TASK	TASK DESCRIPTION	Principal	Const Mgr	Chaot Insp	Tumon Insp	Hyundai Insp	Office Engr #1	Office Engr #2	Doc Ctrl #1	Doc Ctrl #2	Sr Engr	CAD	Clerical	TOTAL COST
<b>2018 - 2019 HOURLY LABOR RATES</b>		\$221.00	\$185.00	\$76.00	\$76.00	\$76.00	\$76.00	\$76.00	\$53.00	\$53.00	\$195.00	\$109.00	\$53.00	
<b>B CONSTRUCTION PHASE</b>														
1.0	Project Controls	40.0	900.0	0.0	360.0	540.0	1008.0	360.0	1440.0	720.0	0.0	20.0	80.0	\$468,608
	Project Correspondence													
	Submittal Review													
	Payment Requests													
	Project Meetings													
	Requests for Information													
	Claims and Disputes													
	Project Records													
2.0	Construction Inspection		540.0	0.0	1080.0	900.0	432.0	360.0			0.0			\$310,572
	Onsite Inspection													
	Acceptance of Work													
	Stop Work Orders													
	Change Orders													
	Change Order Reviews													
	Design Change													
	DCVR													
3.0	Construction Survey Testing													\$45,000
4.0	Project Closeout		360.0		180.0	180.0	360.0		360.0					\$140,400
	Timely Completion													
	Punchlist Development													
	Inspections													
	Training and Warranty													
5.0	Post Construction													\$0
	Final Report													
	Project Records													
	Record Drawings													
<b>Subtotal Hours</b>		40.0	1800.0	0.0	1,620.0	1,620.0	1800.0	720.0	1800.0	720.0	0.0	20.0	80.0	<b>\$964,580</b>

**Guam Waterworks Authority****Fee Proposal Spreadsheet**

9/11/2017

Tumon No. 2, Hyundai, and Chaot No. 2 Tank and System Upgrades CM

**Base Bid**

Page 2 of 2

<b>C SUBCONSULTANTS</b>		
1.0	Michael Baker International	\$30,000
2.0	QA Testing	\$60,000
3.0	Onsite Cameras	\$0
4.0	TGE Sub Admin Fee (10%)	\$9,000
<b>Subtotal - Subconsultants</b>		<b>\$99,000</b>

<b>D EXPENSES</b>					
Expense Item		Units	Quantity	Unit Cost	Subtotal
<b>A PRECONSTRUCTION</b>					
Reproduction	job	5		\$250	\$1,250
<b>B CONSTRUCTION PHASE</b>					
Reproduction	month	14		\$1,000	\$14,000
Office Supplies	month	14		\$100	\$1,400
Vehicle - Const Manager	month	14		\$1,100	\$15,400
Vehicle - Const Insp (Chaot)	month	0		\$1,100	\$0
Vehicle - Const Insp (Tumon)	month	14		\$1,100	\$15,400
Vehicle - Const Insp (Hyundai)	month	14		\$1,100	\$15,400
Vehicle - Office Engineer	month	14		\$1,100	\$15,400
Vehicle - Office Engineer	month	14		\$1,100	\$15,400
Cell Phone Service - Const Manager	month	14		\$80	\$1,120
Cell Phone Service - Const Insp (Chaot)	month	0		\$80	\$0
Cell Phone Service - Const Insp (Tumon)	month	14		\$80	\$1,120
Cell Phone Service - Const Insp (Hyundai)	month	14		\$80	\$1,120
Cell Phone Service - Office Engr (2 x @25))	month	14		\$50	\$700
EADOC Software	each	1		\$55,000	\$55,000
Panasonic Toughbook 20	each	1		\$3,900	\$3,900
Water Pressure Data Loggers	each	25		\$760	\$19,000
Vehicle - GWA	each	1		\$23,472	\$23,472
<b>C POST CONSTRUCTION</b>					
Final Report Reproduction	sets	2		\$250	\$500
As-Built Drawing Reproduction	sets	2		\$250	\$500
<b>D TGE EXPENSE FEE (10%)</b>					\$20,008
<b>Subtotal - Expenses</b>					<b>\$220,090</b>

Subtotal - A. Preconstruction	<b>\$21,251</b>
Subtotal - B. Construction Phase	<b>\$1,535,524</b>
Subtotal - C. Subconsultants	<b>\$99,000</b>
Subtotal - D. Expenses	<b>\$220,090</b>
GRT	<b>\$78,224</b>
<b>GRAND TOTAL</b>	<b>\$1,954,089</b>

## Guam Waterworks Authority

## Fee Proposal Spreadsheet

9/11/2017

Tumon No. 2, Hyundai, and Chaot No. 2 Tank and System Upgrades CM Base Bid-AB 1or2

Page 1 of 2

## PERIOD OF NOVEMBER 2017 - JUNE 2018

PHASE/ TASK	TASK DESCRIPTION	Principal	Const Mgr	Chaot Insp	Tumon Insp	Hyundai Insp	Office Engr #1	Office Engr #2	Doc Ctrl #1	Doc Ctrl #2	Sr Engr	CAD	Clerical	TOTAL COST
<b>2017 - 2018 HOURLY LABOR RATES</b>		\$221.00	\$185.00	\$74.00	\$74.00	\$74.00	\$74.00	\$74.00	\$50.00	\$50.00	\$195.00	\$106.00	\$50.00	
<b>A PRECONSTRUCTION</b>														
1.0	Design Review - Chaot No. 2													\$0
2.0	Design Review - Tumon No. 2													\$0
3.0	Design Review - Hyundai													\$0
4.0	CM QA & Const Mgmt Plans	1.0	10.0				10.0						10.0	\$3,311
5.0	CM Software Training	1.0	8.0	0.0	8.0	8.0	8.0	8.0	16.0	16.0			15.0	\$6,419
6.0	Attend Pre-Bid Meeting/Process Bid RFI's		25.0				25.0						10.0	\$6,975
7.0	Bid Analysis & Award Recommendation	1.0	25.0										10.0	\$5,346
<b>Subtotal Hours</b>		3.0	68.0	0.0	8.0	8.0	43.0	8.0	16.0	16.0	0.0	0.0	45.0	<b>\$22,051</b>
<b>B CONSTRUCTION PHASE</b>														
1.0	Project Controls	24.0	864.0	0.0	270.0	270.0	864.0	864.0	1080.0	540.0	0.0	20.0	60.0	\$419,096
	Project Correspondence													
	Submittal Review													
	Payment Requests													
	Project Meetings													
	Requests for Information													
	Claims and Disputes													
	Project Records													
2.0	Construction Inspection		216.0	0.0	810.0	810.0	216.0	216.0			0.0			\$191,808
	Onsite Inspection													
	Acceptance of Work													
	Stop Work Orders													
	Change Orders													
	Change Order Reviews													
	Design Change													
	DCVR													
<b>Subtotal Hours</b>		24.0	1080.0	0.0	1,080.0	1,080.0	1080.0	1080.0	1080.0	540.0	0.0	20.0	60.0	<b>\$610,904</b>

## PERIOD OF JULY 2018 - JUNE 2019

PHASE/ TASK	TASK DESCRIPTION	Principal	Const Mgr	Chaot Insp	Tumon Insp	Hyundai Insp	Office Engr #1	Office Engr #2	Doc Ctrl #1	Doc Ctrl #2	Sr Engr	CAD	Clerical	TOTAL COST
<b>2018 - 2019 HOURLY LABOR RATES</b>		\$221.00	\$185.00	\$76.00	\$76.00	\$76.00	\$76.00	\$76.00	\$53.00	\$53.00	\$195.00	\$109.00	\$53.00	
<b>B CONSTRUCTION PHASE</b>														
1.0	Project Controls	40.0	900.0	0.0	360.0	540.0	1008.0	1008.0	1440.0	720.0	0.0	20.0	80.0	\$517,856
	Project Correspondence													
	Submittal Review													
	Payment Requests													
	Project Meetings													
	Requests for Information													
	Claims and Disputes													
	Project Records													
2.0	Construction Inspection		540.0	0.0	1080.0	900.0	432.0	432.0			0.0			\$316,044
	Onsite Inspection													
	Acceptance of Work													
	Stop Work Orders													
	Change Orders													
	Change Order Reviews													
	Design Change													
	DCVR													
3.0	Construction Survey Testing													\$45,000
4.0	Project Closeout		360.0		180.0	180.0	360.0		360.0					\$140,400
	Timely Completion													
	Punchlist Development													
	Inspections													
	Training and Warranty													
5.0	Post Construction													\$0
	Final Report													
	Project Records													
	Record Drawings													
<b>Subtotal Hours</b>		40.0	1800.0	0.0	1,620.0	1,620.0	1800.0	1440.0	1800.0	720.0	0.0	20.0	80.0	<b>\$1,019,300</b>

**Guam Waterworks Authority****Fee Proposal Spreadsheet**

9/11/2017

Tumon No. 2, Hyundai, and Chaot No. 2 Tank and System Upgrades CM **Base Bid+AB 1or2**

Page 2 of 2

<b>C SUBCONSULTANTS</b>		
1.0	Michael Baker International	\$30,000
2.0	QA Testing	\$60,000
3.0	Onsite Cameras	\$0
4.0	TGE Sub Admin Fee (10%)	\$9,000
<b>Subtotal - Subconsultants</b>		<b>\$99,000</b>

D EXPENSES					
Expense Item		Units	Quantity	Unit Cost	Subtotal
A PRECONSTRUCTION					
Reproduction		job	5	\$250	\$1,250
B CONSTRUCTION PHASE					
Reproduction		month	14	\$1,000	\$14,000
Office Supplies		month	14	\$100	\$1,400
Vehicle - Const Manager		month	14	\$1,100	\$15,400
Vehicle - Const Insp (Chaot)		month	0	\$1,100	\$0
Vehicle - Const Insp (Tumon)		month	14	\$1,100	\$15,400
Vehicle - Const Insp (Hyundai)		month	14	\$1,100	\$15,400
Vehicle - Office Engineer		month	14	\$1,100	\$15,400
Vehicle - Office Engineer		month	14	\$1,100	\$15,400
Cell Phone Service - Const Manager		month	14	\$80	\$1,120
Cell Phone Service - Const Insp (Chaot)		month	0	\$80	\$0
Cell Phone Service - Const Insp (Tumon)		month	14	\$80	\$1,120
Cell Phone Service - Const Insp (Hyundai)		month	14	\$80	\$1,120
Cell Phone Service - Office Engr (2 x @25))		month	14	\$50	\$700
EADOC Software		each	1	\$55,000	\$55,000
Panasonic Toughbook 20		each	1	\$3,900	\$3,900
Water Pressure Data Loggers		each	25	\$760	\$19,000
Vehicle - GWA		each	1	\$23,472	\$23,472
C POST CONSTRUCTION					
Final Report Reproduction		sets	3	\$250	\$750
As-Built Drawing Reproduction		sets	3	\$250	\$750
D TGE EXPENSE FEE (10%)					\$20,058
Subtotal - Expenses				\$220,640	

Subtotal - A. Preconstruction	<b>\$22,051</b>
Subtotal - B. Construction Phase	<b>\$1,630,204</b>
Subtotal - C. Subconsultants	<b>\$99,000</b>
Subtotal - D. Expenses	<b>\$220,640</b>
GRT	<b>\$82,228</b>
<b>GRAND TOTAL</b>	<b>\$2,054,124</b>



## Guam Waterworks Authority

Tumon No. 2, Hyundai, and Chaot No. 2 Tank CM

## Fee Proposal Spreadsheet

Base Bid + AB 12

9/11/2017

Page 1 of 2

## PERIOD OF NOVEMBER 2017 - JUNE 2018

PHASE/ TASK	TASK DESCRIPTION	Principal	Const Mgr	Chaot Insp	Tumon Insp	Hyundai Insp	Office Engr #1	Office Engr #2	Doc Ctrl #1	Doc Ctrl #2	Sr Engr	CAD	Clerical	TOTAL COST
<b>2017 - 2018 HOURLY LABOR RATES</b>		\$221.00	\$185.00	\$74.00	\$74.00	\$74.00	\$74.00	\$74.00	\$50.00	\$50.00	\$195.00	\$106.00	\$50.00	
<b>A PRECONSTRUCTION</b>														
1.0	Design Review - Chaot No. 2													\$0
2.0	Design Review - Tumon No. 2													\$0
3.0	Design Review - Hyundai													\$0
4.0	CM QA & Const Mgmt Plans	1.0	10.0				10.0						10.0	\$3,311
5.0	CM Software Training	1.0	8.0	0.0	8.0	8.0	8.0	8.0	16.0	16.0			15.0	\$6,419
6.0	Attend Pre-Bid Meeting/Process Bid RF's		25.0				25.0						10.0	\$6,975
7.0	Bid Analysis & Award Recommendation	1.0	25.0										10.0	\$5,346
<b>Subtotal Hours</b>		3.0	68.0	0.0	8.0	8.0	43.0	8.0	16.0	16.0	0.0	0.0	45.0	<b>\$22,051</b>
<b>B CONSTRUCTION PHASE</b>														
1.0	Project Controls	24.0	864.0	0.0	270.0	270.0	864.0	864.0	1080.0	810.0	0.0	20.0	60.0	\$432,596
	Project Correspondence													
	Submittal Review													
	Payment Requests													
	Project Meetings													
	Requests for Information													
	Claims and Disputes													
	Project Records													
2.0	Construction Inspection		216.0	0.0	810.0	810.0	216.0	216.0			0.0			\$191,808
	Onsite Inspection													
	Acceptance of Work													
	Stop Work Orders													
	Change Orders													
	Change Order Reviews													
	Design Change													
	DCVR													
<b>Subtotal Hours</b>		24.0	1080.0	0.0	1,080.0	1,080.0	1080.0	1080.0	1080.0	810.0	0.0	20.0	60.0	<b>\$624,404</b>

## PERIOD OF JULY 2018 - JUNE 2019

PHASE/ TASK	TASK DESCRIPTION	Principal	Const Mgr	Chaot Insp	Tumon Insp	Hyundai Insp	Office Engr #1	Office Engr #2	Doc Ctrl #1	Doc Ctrl #2	Sr Engr	CAD	Clerical	TOTAL COST
<b>2018 - 2019 HOURLY LABOR RATES</b>		\$221.00	\$185.00	\$76.00	\$76.00	\$76.00	\$76.00	\$76.00	\$53.00	\$53.00	\$195.00	\$109.00	\$53.00	
<b>B CONSTRUCTION PHASE</b>														
1.0	Project Controls	40.0	900.0	0.0	360.0	540.0	1008.0	1008.0	1440.0	1080.0	0.0	20.0	80.0	\$536,936
	Project Correspondence													
	Submittal Review													
	Payment Requests													
	Project Meetings													
	Requests for Information													
	Claims and Disputes													
	Project Records													
2.0	Construction Inspection		540.0	0.0	1080.0	900.0	432.0	432.0			0.0			\$316,044
	Onsite Inspection													
	Acceptance of Work													
	Stop Work Orders													
	Change Orders													
	Change Order Reviews													
	Design Change													
	DCVR													
3.0	Construction Survey Testing													\$45,000
4.0	Project Closeout		360.0		180.0	180.0	360.0		360.0					\$140,400
	Timely Completion													
	Punchlist Development													
	Inspections													
	Training and Warranty													
5.0	Post Construction													\$0
	Final Report													
	Project Records													
	Record Drawings													
<b>Subtotal Hours</b>		40.0	1800.0	0.0	1,620.0	1,620.0	1800.0	1440.0	1800.0	1080.0	0.0	20.0	80.0	<b>\$1,038,380</b>



**Guam Waterworks Authority**  
Tumon No. 2, Hyundai, and Chaot No. 2 Tank CM

**Fee Proposal Spreadsheet**  
**Base Bid + AB 12**

9/11/2017  
Page 2 of 2

<b>C SUBCONSULTANTS</b>	
1.0 Michael Baker International	\$30,000
2.0 QA Testing	\$60,000
3.0 Onsite Cameras	\$0
4.0 TGE Sub Admin Fee (10%)	\$9,000
<b>Subtotal - Subconsultants</b>	<b>\$99,000</b>

<b>D EXPENSES</b>				
Expense Item	Units	Quantity	Unit Cost	Subtotal
<b>A PRECONSTRUCTION</b>				
Reproduction	job	5	\$250	\$1,250
<b>B CONSTRUCTION PHASE</b>				
Reproduction	month	14	\$1,000	\$14,000
Office Supplies	month	14	\$100	\$1,400
Vehicle - Const Manager	month	14	\$1,100	\$15,400
Vehicle - Const Insp (Chaot)	month	0	\$1,100	\$0
Vehicle - Const Insp (Tumon)	month	14	\$1,100	\$15,400
Vehicle - Const Insp (Hyundai)	month	14	\$1,100	\$15,400
Vehicle - Office Engineer	month	14	\$1,100	\$15,400
Vehicle - Office Engineer	month	14	\$1,100	\$15,400
Cell Phone Service - Const Manager	month	14	\$80	\$1,120
Cell Phone Service - Const Insp (Chaot)	month	0	\$80	\$0
Cell Phone Service - Const Insp (Tumon)	month	14	\$80	\$1,120
Cell Phone Service - Const Insp (Hyundai)	month	14	\$80	\$1,120
Cell Phone Service - Office Engr (2 x @25))	month	14	\$50	\$700
EADOC Software	each	1	\$55,000	\$55,000
Panasonic Toughbook 20	each	1	\$3,900	\$3,900
Water Pressure Data Loggers	each	25	\$760	\$19,000
Vehicle - GWA	each	1	\$23,472	\$23,472
<b>C POST CONSTRUCTION</b>				
Final Report Reproduction	sets	3	\$250	\$750
As-Built Drawing Reproduction	sets	3	\$250	\$750
<b>D TGE EXPENSE FEE (10%)</b>				<b>\$20,058</b>
<b>Subtotal - Expenses</b>			<b>\$220,640</b>	

Subtotal - A. Preconstruction	<b>\$22,051</b>
Subtotal - B. Construction Phase	<b>\$1,662,784</b>
Subtotal - C. Subconsultants	<b>\$99,000</b>
Subtotal - D. Expenses	<b>\$220,640</b>
GRT	<b>\$83,587</b>
<b>GRAND TOTAL</b>	<b>\$2,088,062</b>

## **SCOPE OF WORK**

### **Construction Management Services for the Tumon No. 2, Hyundai, and Chaot No. 2 Tank and System Upgrades**

#### **A. CONSTRUCTION DESCRIPTION:**

The proposer will provide construction management (CM) services on behalf of GWA for construction of Tumon No. 2, Hyundai, and Chaot No. 2 water system improvement projects. The projects are located at several different sites.

The following are the general description of water system improvements to be completed at each location:

##### **1. PW 09-11: Tumon No. 2**

- Demolition of existing facilities, including 1 MG steel tank, yard piping, vaults, and appurtenances.
- Installation of new piping from Route No. 1 to the new Tumon No. 2 tank.
- Construction of a new 1 MG concrete tank.
- Off-site improvements, to include new pressure reducing valves, flow meters, and vaults.
- SCADA

##### **2. PW 12-06: Hyundai**

- Demolition of existing facilities, including 1 MG steel tank, yard piping, vaults, and appurtenances.
- Construction of a new 1 MG concrete tank.
- Installation of new transmission lines.
- Construction of the new Hyundai booster station.
- Refurbishment of the Barrigada booster station.
- Off-site improvements, to include new pressure reducing valves, flow meters, and vaults.
- SCADA

##### **3. PW 12-04: Chaot No. 2**

- Construction of a new 0.5 MG concrete tank.
- Modification to the central chlorination system at the Chaot and Agana Heights tank sites.
- Off-site improvements, to include new pressure reducing valves, flow meters, and vaults.
- Disconnection of A-series deep wells to the distribution line.
- Commissioning of the Sinajana-Agana Heights system, which includes the Chaot No. 1, and Chaot No. 2, and Agana Heights tanks, booster station, deep wells, SCADA, and chlorination.
- SCADA

#### **B. GENERAL CONSTRUCTION MANAGEMENT SCOPE OF WORK**

The CM will provide all services relating to the daily field observation, inspection, testing, supervision, management, coordination, and compliance monitoring for the construction projects. The projects generally consists of geo-technical ground improvements, demolition of existing tank structures, construction of pre-stressed concrete tanks conforming to AWWA/ANSI D110 for Type I Wire- and Strand- Wound, Circular Prestressed Concrete Water Tanks (site adapted for each location), installation of new water lines, construction and refurbishment of booster pump stations, chlorination systems,

electrical, instrumentation and control, SCADA controls, plus all associated utilities for each site. Additionally, GWA seeks pre-construction services including constructability review prepared by others.

The construction management, testing, and field observation services for the tank replacement projects will require general construction management and observation, as well as specialized inspection and testing.

In addition to general construction management duties, the specialized inspection and testing will include, but not limited to:

- Concrete placement
- Concrete anchors/Adhesive anchoring systems/Expansion bolts
- Grading
- Excavation
- Compaction grouting
- Compaction testing
- Pre-stressing operations
- Concrete cylinder testing
- Shotcrete application
- High strength bolting
- Earthwork/Soil analysis
- Instrumentation and SCADA
- Hydrostatic testing
- Disinfection
- System commissioning

In general, the proposer will be the CM as an independent contractor Owner's Representative of GWA whose primary function are to:

- Keep GWA advised and informed as to project progress and cost
- Manage the change process
- Disclose any information relevant to GWA's interest
- Make proactive recommendations to GWA for action to maintain progress and achieve the project schedule and budget
- Act in the best interest of GWA

The CM shall administer the Contract, except that the CM is not authorized to make any decisions on the behalf of GWA that materially affect the intent of the design or financially obligate GWA in any manner.

### **C. PRE-CONSTRUCTION PHASE SERVICES**

#### **1. Design Document Review**

The CM shall perform review of the design documents. The CM will provide redline mark-up of the plans and specifications and annotated comments. The review will also verify that the design is clearly presents and poses no potential construction related conflicts or deficiencies which may lead to substantive changes to the design, schedule, or cost of the

project. Review will identify any contractual and technical deficiencies and contradictions in the construction documents.

**Deliverables (electronic pdf files and hard copies):**

- Final Design Review Report

**2. CM Quality Assurance**

The Construction Management consultant and/or sub-consultants shall have experience in managing the construction of concrete water reservoirs conforming to AWWA design and construction guidelines or similar concrete construction, construction of water lines, booster pump stations, and all relevant water utility work.

The CM will review, record, and comment on submittal on Quality Control Plan submitted by the Construction Contractor. The CM will develop, implement, and maintain a Quality Assurance Plan for civil, structural, electrical, mechanical, and instrumentation elements including specialized work related to the construction of concrete water reservoirs conforming to AWWA/ANSI D110 Type I Wire- and Strand- Wound, Circular Prestressed Concrete Water Tanks.

The CM Quality Assurance shall incorporate all the required testing listed Section D. Construction Phase Services, 16 and 18.

The CM will file contractor certifications: review, file, and submit inspection test results; and assess substantial completion.

Content of the Quality Assurance Plan will include the following at the minimum:

- Documentation of site conditions prior to beginning construction
- Review of approved submittals from the Contractor prior to fabrication or installation of materials and equipment
- Inspection, observation, and documentation of daily field work
- Monitoring of the Contractor's Quality Control Plan
- In-plant fabrication and/or witness testing at place of manufacture (where applicable)
- Reports and record keeping
- Non-conforming and deficient work resolution process
- Monitoring the Construction Contractor's implementation of their Quality Control Plan
- Complete list of specialized inspections for the tank structure and under tank

It is important to note that the CM is responsible for monitoring the Contractor's compliance with the Contract Documents, but not responsible for the Contractor's means and methods the Contractor may use to perform the work.

**Deliverables (electronic pdf files and hardcopies):**

- Quality Assurance Plan

**3. Construction Management Plan**

The CM will develop and implement the Construction Management Plan (CM Plan) including guidelines for project organization and coordination in the field, standard daily operations, change order procedures, safety, quality, schedule, and cost control. The CM Plan sets forth the procedures and approach for the construction of the project. The CM Plan will serve the CM, the Owner's Representative, and Contractors by defining the project, project team members and their roles, coordination among team members, procedure, key milestones, and schedule constraints. By establishing these parameters early in the project, the CM Plan will help control resources and costs, establish communication and coordination between the CM, Constructor, and GWA.

**Deliverables (electronic pdf files and hardcopies):**

- Construction Management Plan

**4. Contract Bidding**

Upon receipt of the construction bid packages, the CM will review the bid packages and provide GWA with a recommendation and/or concurrence of the proposed selected Contractor. Recommendation shall include document review to ensure compliance with all bid requirements and procurement regulations, bid analysis, and contractor selection.

**Deliverables (electronic pdf files and hardcopies):**

- Technical Memorandum(s) – Document Review, Bid Analysis, and Contractor Selection

**D. CONSTRUCTION PHASE SERVICES**

**1. Project Records and Document Control**

These services and tools shall be provided by the CM to insure that the project is efficiently managed and constructed according to the terms of the Contract and the Request for Proposal. The function is concerned with proper collection and organization of construction documents, gathering data regarding project progresses, producing progress reports, and monitoring time, cost, and quality.

The CM will use a construction management and project collaboration applications, such as Bentley EADOC, Procore Construction Project Management, NewForma Project Center, to track communication, design documents, construction documents, finances, and reporting. GWA shall approve the software before implementation.

- Communication documents: Memos, daily inspector logs for both contractor and CM, meeting minutes, and all other relevant documentation
- Construction documents: Submittals, RFIs, testing results, photo logs, special inspection, change orders, corrective actions, punch list, various construction logs, payment applications, wage rate reporting, and all other relevant documentation
- Design documents: Specifications, drawings, permits, bid documents, contract documents, and all other relevant documentation

The CM will use Primavera P6 project management software to track the Contractor's project schedule, construction cost, resource tracking, and cost management.

**2. Daily Construction Reports**

The onsite inspectors shall maintain a log of material deliveries, daily site production, site condition, field orders, progress photos, material testing, special inspections, documentation of delays, non-conformance, punch lists, and other material and work facts and issues regarding the prosecution of the work. The daily reports and logs shall be available to GWA project team for review at any time via the project management software.

**3. Progress Photo Log and Live Video Feed**

The CM shall prepare and retain a construction progress photo log in an organized album with phases of the project clearly labeled. The photo log shall capture all phases of the project – pre-construction, construction, and post-construction. The photo log shall be digital.

The CM shall provide 24 hour monitoring camera(s) to be installed at each project sites to allow for continuous monitoring of the project work. The camera system will allow for remote view and playback functions. Monthly progress videos shall be submitted to GWA.

**4. Submittal and Shop Drawings**

The CM shall review and act on (approve or reject) all submittals required by the Contract documents. The CM shall review and provide comments regarding shop drawings, work drawings, material submittals, traffic control plan, safety plan, demolition plan, and all other submittals for conformance with the Contract documents. CM reviewer shall be a competent person. In the event of a Contractor request for a time extension or material or equipment substitution, the CM shall make a recommendation to GWA regarding the substitution. The GWA Chief Engineer or his authorized representative will approve the substitution.

**5. Contractor Project Schedules**

The CM shall review the Contractor's work schedule for accuracy and for efficient sequencing of the work. The CM will direct the Contractor to make any changes deemed necessary and coordinate approval of the revised schedule with GWA. Any delays shall be documented and notified to GWA and the Contractor when actual progress is behind schedule. The CM shall adhere to the requirements set forth in the Contract document for contractor project schedule tracking and review.

**6. Payment Request**

The CM shall receive and process payment requests from the Contractor. Payment requests shall be reviewed compliance with the Contract document and with the actual work completed. Upon completion of the review, the CM shall make any necessary adjustments, certify, and forward the request to GWA for processing of the payment. The CM shall submit their review, recommendation, acceptance, or rejection within 5 working days of receipt from the Contractor.

**7. Payroll Report**

The CM shall also review any payroll submittals required by the Contract documents including prevailing wage submissions. At the minimum, the Contractor and its

subcontractors shall provide bi-weekly pay records for each of its employees on the project. The proposer will also conduct random employee interviews to verify the pay request information. Upon completion of the review, the CM shall require the Contractor to make any necessary adjustments, certify, and forward the Payroll report along with the pay request to GWA for processing.

#### **8. Project Meetings**

The CM shall schedule, arrange, and conduct conferences and meeting as required for clear communication of the Contract requirements and adherence to project schedules.

The CM shall arrange for a weekly progress meeting with the Contractor and GWA to discuss progress of work, Contract requirements, and other issues related to the administration and prosecution of work. The CM shall prepare meeting minutes for all progress meetings with contractors, sub-contractors, GWA, and all other parties. The meeting minutes shall include action items from week to week until it has been completed.

The CM shall arrange meetings between the Contractor and GWA, and other parties such as GEPA and DPW as necessary to address project issues that require decisions that cannot be made by the CM or to resolve regulatory concerns.

#### **9. As-Built Drawing Reviews**

After each weekly meeting, the CM shall review the Contractor's Review drawings to ensure that they are current and capture any deviations from the original plan set.

The CM shall maintain a separate set of red-line as-built drawing on site. Drawings shall be available for GWA at any time. Monthly as-builts documents shall be uploaded to the project management software system.

#### **10. Request for Information**

Track all Request for Information and maintain an RFI log. Coordinate receipt of answers from other sources. Provide RFI response with GWA's input regarding any aspect of the Contract documents, which includes the plans and technical specifications.

#### **11. General Compliance Monitoring**

The CM shall evaluate and ensure Contractor compliance with all local and federal labor laws applicable to the Project. Any violations shall be immediately reported to GWA. Compliance monitoring shall include but not limited to the following:

- Regulations and Laws: Monitor compliance with Territorial and/or Federal laws, regulations, and rules.
- Labor laws: Monitor Contractor and subcontractor procedures to verify legal status of employees on site. Verify bi-weekly compliance with labor requirements for federally funded projects including posting of wage rate schedules at the job site and safety requirements.
- Licensure: Confirm that the Contractor and its subcontractor and their workers have all required licenses and ensure that said licenses are valid throughout the terms of the Contract.

- Permit Compliance: Monitor and track Contractor's compliance in obtaining required permit and approvals.
- Insurance: Review Contractor's insurance documents submitted to GWA for compliance with Contractor requirements. Track insurance documents, ensure insurance is valid throughout the term of Contract and maintain insurance certificate log.

## **12. Claims and Disputes**

The CM shall promptly the GWA regarding any issues that arise during construction of the Project that could result in claims and/or disputes. The CM shall provide the following services to assist GWA with the resolution of claims and disputes:

- Claim Records: Maintain copies of all verbal and written communications, submittals, testimony, photos, and meetings regarding a potential dispute and promptly submit all originals to the Chief Engineer and Attorney for GWA.
- Claims Reviews & Interpretation: Reviews claims submitted by the Contractor, provide GWA with interpretation of Contract drawings and specifications and provide written recommendations to GWA regarding the solution of the dispute. At the outset of the Contract, the CM shall work with the Contractor to provide pricing for equipment, material, personnel, and other relevant considerations as specified in the bid. Prices agreed upon shall be used in any subsequent Change Order. No amounts shall be paid except for actual losses incurred by the Contractor through no fault of their own or for risks not allocated to the Contractor under the bid.

## **13. Change Order Negotiations and Review**

Prepare independent cost estimates and negotiate change orders with the Contractor subject to GWA approval (final approval of negotiated change orders can only be made by the GWA General Manager).

Track all change orders and maintain a change order log. Provide change order evaluations, negotiations, and recommendations for approval by GWA. Change orders shall not be made when the Contractor has assumed such risk in the bid. Change orders may include requests for additional payments for differing site conditions and the CM shall utilize the bid document to determine if a change order is warranted. CM shall submit change order requests and supporting documentation to GWA for approval within 5 working days of receipt from the Contractor wherever practical.

The CM shall maintain copies for all approved change orders (originals to be provided to GWA) and insure that subsequent pay requests accurately represent these change orders. Approved change orders shall be administered by the CM along with other work elements according to the provisions of this scope of work.

## **14. Design Changes and Verification Request**

As directed by GWA, prepare changes to the Contract technical documents (design and specifications) required to address a change order. GWA will direct the CM to make design changes only when changes are deemed by the GWA Chief Engineer and the Engineer of



Record to have no material effect on the original intent of the design. All other design changes shall be forwarded to the Engineer of Record for processing.

If the request for change will materially change the original design, the CM shall coordinate with the Engineer of Record to accomplish the necessary design changes. The CM shall prepare a design change/verification request (DCVR) for submission to and for the approval of the Engineer of Record. If the required changes to the design are not covered within the original design scope of service, the CM will prepare a design scope amendment; solicit a fee proposal for the amendment on behalf of GWA, and assist with the negotiations.

### 15. Construction Monitoring, Special Inspection, and Quality Control Monitoring

The CM shall provide full time inspection observation and special inspection services to ensure that the work is accomplished in accordance with the Contract documents. A full time Resident Engineer shall be assigned to manage all sites and will be at one of the sites during normal working hours unless attending project related meetings or during holidays, vacation, or sick days.

The CM shall provide full time construction inspector staff at each of the 3 sites to monitor the construction. The Resident Engineer and onsite field staff shall have demonstrable experience (satisfactory to GWA) relative to the discipline and type of work being performed. Project field staff shall review project documents, conduct daily observations, special inspections (where applicable), prepare and submit Daily Observation and Special Inspection Reports; communicate deficiency issues and resolve with Contractor; and update Non-Compliance log.

In addition to general compliance inspections, the CM shall provide Special Inspections services in accordance with IBC 2009, Chapter 17 by a person with demonstrable experience (satisfactory to GWA) related to concrete placement, structural field welding, fielding welding of reinforcement, concrete anchoring, expansion bolts, shotcrete application, high strength bolting, reinforcing steel placement, pre-stressing operations, grading, excavation, backfilling, foundation probing and injection, and other operations that require special inspections. The Special Inspections staff shall be approved by GWA before inspection.

### 16. Testing (Quality Assurance)

Contractor Testing: Schedule, observe, approve or reject, and document testing required under the Contract to be performed by the Contractor.

Construction Quality Assurance Testing: The CM shall provide, at the minimum, the following CQA testing to monitor the Contractor's independent testing firm:

SPECIAL TESTING	STANDARD	FREQUENCY
Concrete Tests:	ASTM C-39	10% of Contractor's
<ul style="list-style-type: none"> <li>Pipe encasement: Inlet piping, outlet piping, overflow piping, drain line piping, wash down piping</li> <li>Tank foundation</li> </ul>		

<ul style="list-style-type: none"> <li>• Tank wall</li> <li>• Tank roof slab</li> <li>• Tank column</li> <li>• Tank column footing</li> <li>• Shotcrete</li> <li>• Vaults</li> <li>• Detention basin: footing and walls</li> <li>• Electrical and communication encasement</li> <li>• Electrical and communication hand hold</li> </ul>		
Compaction grouting	ASTM C-1019	10% of Contractor's
Compaction testing: <ul style="list-style-type: none"> <li>• Over Excavation: Bottom of Over Excavation, Type G – Crushed Aggregate, Top of Type H – Drain Rock, Type E – Certification of Observation</li> <li>• Vaults: First lift, middle lift, and final lift.</li> <li>• Electrical Hand Holes: First lift, middle lift, and final lift</li> <li>• Communication Hand Holes: First lift, middle lift, and final lift</li> <li>• Detention Basin: Footing</li> <li>• Pavement: Ribbon gutter and pavement</li> </ul>	ASTM D-698 ASTM D-6938	10% of Contractor's
Soil and Aggregate Analysis <ul style="list-style-type: none"> <li>• Type G – Crushed Aggregate</li> <li>• Type H – Drain Rock</li> <li>• Type E – Pea Gravel</li> <li>• Type I – Backfill Material</li> </ul>	ASTM C-136 ASTM C-117 ASTM C-40 ASTM D-1140 ASTM D-1183 ASTM D-4318	10% of Contractor's
All other required testing for Contract conformance.		

## 17. Acceptance

The CM shall promptly reject, orally, or in writing, any construction work that does not fully comply with Contract documents. Within 24 hours of notification to the Contractor that work elements have been rejected, the CM shall provide a written description of the deficiency to the GWA Chief Engineer for his/her concurrence. When concurrence has been obtained, the Contractor shall be directed to correct the work. The CM shall promptly advise the GWA Project Manager or the GWA Chief Engineer if the Contractor fails to correct or remove the defective work.

The CM shall issue written stop work orders to the Contractor and immediately provide GWA with a copy for a portion of or the entire Contract non-compliance issues as follows:

- If condition of work or Contractor actions threatens the health and safety of Contractor personnel, GWA representatives, or public in such cases, stop work orders may be oral depending on the circumstances with written stop work order to follow.
- With prior notification and approval of the GWA Chief Engineer or Project Manager in all other cases.

#### **18. Construction Survey Services (Quality Assurance)**

The CM shall conduct survey and field measurements as necessary to verify that the work is located according to the plans and specifications. Changes to the horizontal and vertical alignments and elevations shall be made only with the approval of the GWA Chief Engineer.

- Pipeline Alignments and Location of Structures: Spot check Contractor's construction staking to verify the pipeline alignments and structure locations are as called for on the plan and specifications and in order to insure that the work and is location within lawful and approved Rights-of-Way and easements.
- Elevations: Spot check with Contractor's elevations for foundations, pads, pipe line inverts, backfill thickness, manholes, and other structures for which vertical elevations is a critical design element.
- Construction Survey Quality Assurance: The CM shall provide, at the minimum, the following CQA survey to monitor the Contractor's independent survey firm:

##### Under Tank Piping

- a. Inlet piping & top of flange
- b. Outlet piping & top of flange
- c. Over flow piping & top of flange
- d. Drain line piping & top of flange
- e. Wash down piping & top of flange
- f. Ring drain, high points and outlets

##### Over Excavation

- a. Bottom of over excavation
- b. Top of Type G – fine aggregate
- c. Top of Type H – drain rock

##### Tank Foundation

- a. Top of formwork

##### Vaults

- a. Top inlet vault footing formwork
- b. Top inlet vault roof slab formwork
- c. Top outlet vault footing formwork
- d. Top outlet vault roof slab formwork
- e. Top drain vault footing formwork
- f. Top drain vault roof slab formwork
- g. Top electrical hand hold
- h. Top communication hand hold
- i. PRSV

Pavement

- a. Ribbon gutter formwork
- b. Pavement formwork

Water Line

- a. Invert of newly installed pipe
- b. Location of fittings
- c. Utility nodes, such as vertical and horizontal bends in pipes
- d. Exposed utilities
- e. New chambers, manholes, vaults, or structures

Bench Marks

- a. Establish bench marks on the top of all vaults, top of footing at water height gauge, overflow, drain, and outlet

**19. Project Closeout (Punch List and Project Closeout Inspections)**

Throughout the construction of the project, prepare and maintain a list of defects and deficiencies in the work which must be corrected by the Contractor prior to final acceptance of work. The list shall be provided to all members of the pre-final and final inspection team. The list shall be revised after inspections to reflect additional items identified during the inspection. Coordinate with the Contractor to ensure that all punch list items have been completed. When all items have been completed, inform GWA in writing recommending that the work be accepted.

Schedule, arrange, and conduct interim, pre-final, and final inspections of work with Contractor, GWA, GEPA, DPW, and other stakeholders in this project.

- Preliminary Inspection: Preliminary inspections shall be arranged as necessary for specific work elements that require the certification and approval of other agencies
- Pre-final Inspection: A pre-final inspection shall be conducted after substantial completion of the work
- Final Inspection: The final inspection shall be conducted after correction of pre-final inspection punch list items.

**20. Train and Warranty Periods**

The CM shall coordinate with the Contractor to schedule and conduct startup training and standard maintenance procedures required by the Contract document.

The CM shall maintain a copy of the warranties and compile associated Manufacturer and Contractor warranty documents. Warranty information shall be included in the final project report. All original warranty documents shall be provided to GWA along with Lien Release Information from the Contractor.

**21. Equipment**

The CM shall provide GWA with 15 water pressure data loggers, batteries, lock boxes, chains, padlocks, and associated fittings. The water pressure data loggers shall be USB downloading, water resistant case, delay start feature, and 0-300 PSI range.

The CM shall provide GWA with a Panasonic Toughbook 20 or approved equal. Windows 10 Pro shall be the operating system.

## **E. POST CONSTRUCTION SERVICES**

### **1. Final Report**

The CM shall prepare a final report after written acceptance of the work by GWA. The final report shall include a narrative documentation of all significant design and construction events and issues and shall become a historical record for the project. The Final Report shall include:

- All communication documentation
- All design documentation
- All construction documentation
- Warranty information
- Operation and maintenance information
- Asset management registry

#### **Deliverables (electronic pdf files and 5 hard copies):**

- CM Final Report

### **2. Record Drawings**

After the conclusion of the project, the CM shall review and approve the official record drawings prepared by the Contractor. Record drawings shall be marked and sealed by a professional engineer licensed on Guam in accordance with Guam PEALS regulations.

#### **Deliverables (electronic pdf files and 5 hard copies):**

- As-Built Record Drawings





# General Manager's Report

## GPWA CCU Board Meeting, October 17, 2017

## Operations Update



### Production

Monthly Production Summary - August 2017				
Deep Wells		35.5	MGD	
Active wells =	94	of 120		
Avg days in operation =	30.11	days		
Total Production =	1,102,007	Kgals		
Springs		0.22	MGD	
Avg days in operation =	31	days		
Total Production =	6912	Kgals		
Ugum Surface Water Plant		2.1	MGD	
Avg days in operation =	31	days		
Total Production =	65,037	Kgals		
Tumon Maui Well		1.05	MGD	
Avg days in operation =	31	days		
Total Production =	32,534	Kgals		
		1,206,489	Kgals	38.9 MGD

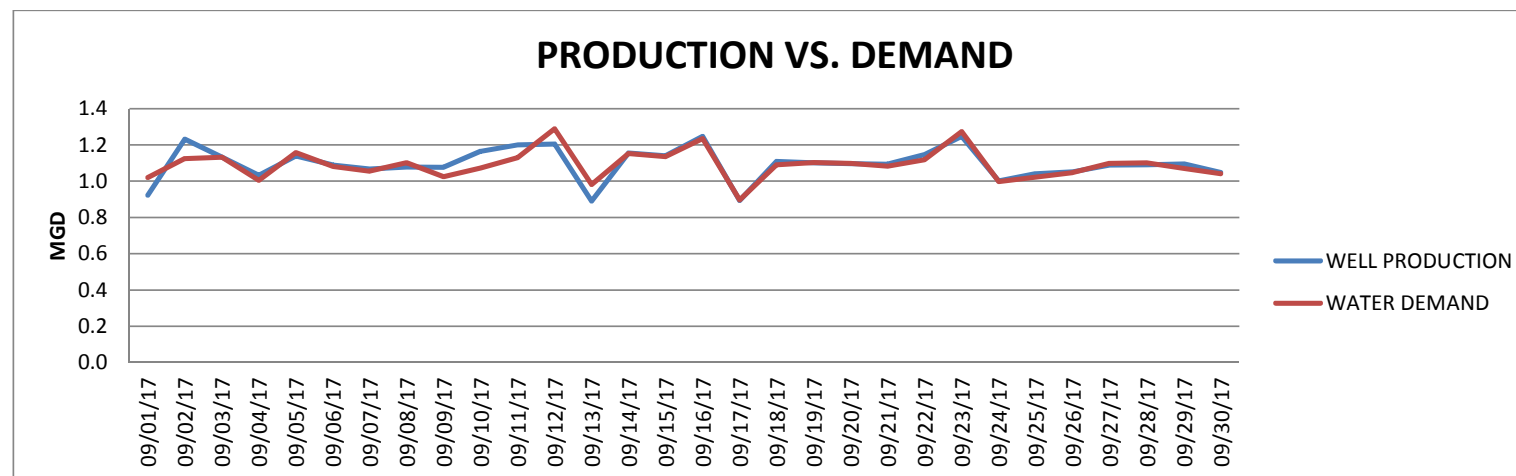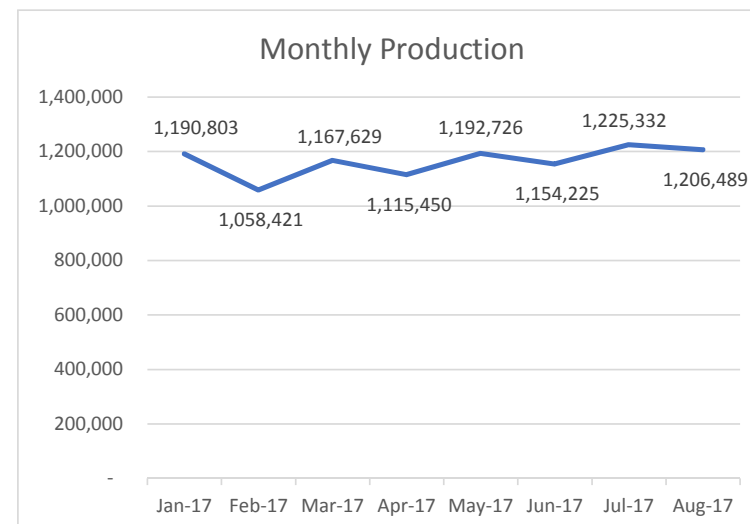

## Distribution


Monthly Distribution Summary - August 2017				
Water Booster Pump Stations				
District	No. of Stations	Total Pumps	Pumps Operating	% Operational
Northern	11	21	20	95.2%
Central	7	15	12	80.0%
Southern	7	15	15	100.0%
	25	51	47	92.2%

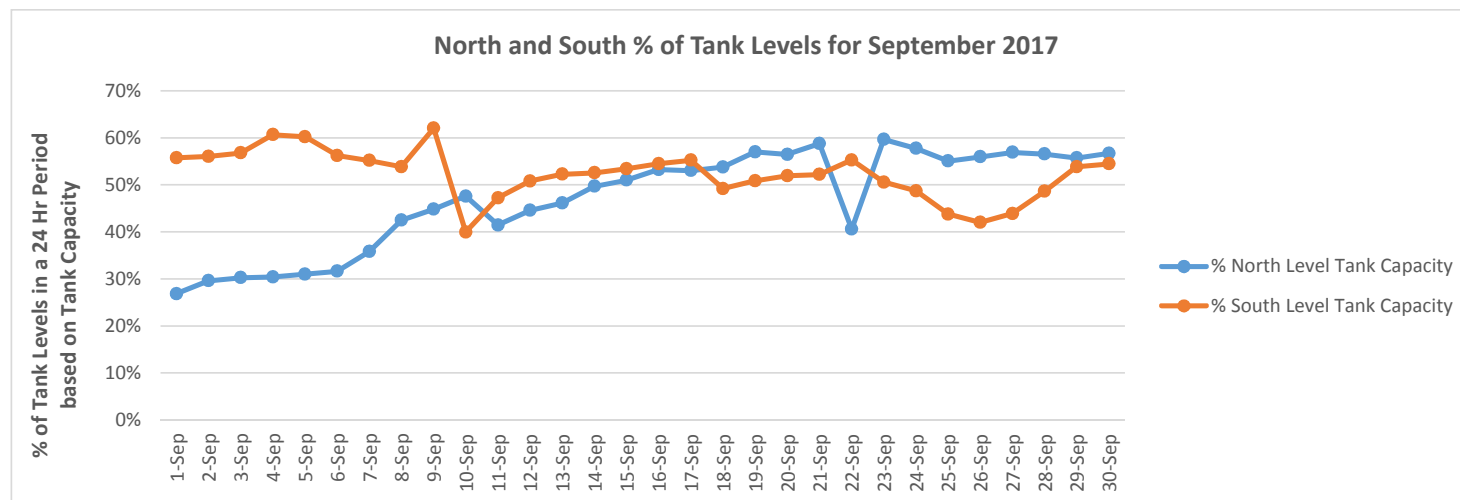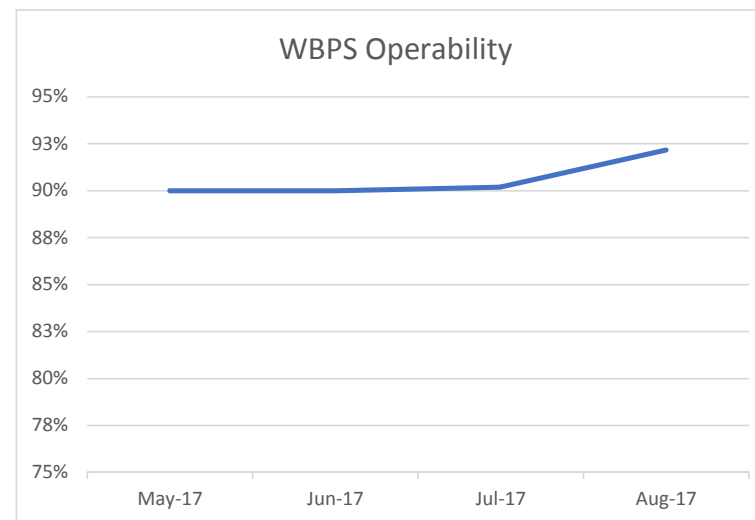



## Wastewater Collections

Monthly Collections Summary - August 2017*					
Wastewater Pump Stations					
	District	No. of Stations	Total Pumps	Pumps Operating	% Operational
	Northern	22	52	51	98.1%
	Central	29	65	62	95.4%
	Southern	25	51	50	98.0%
		76	168	163	97.0%

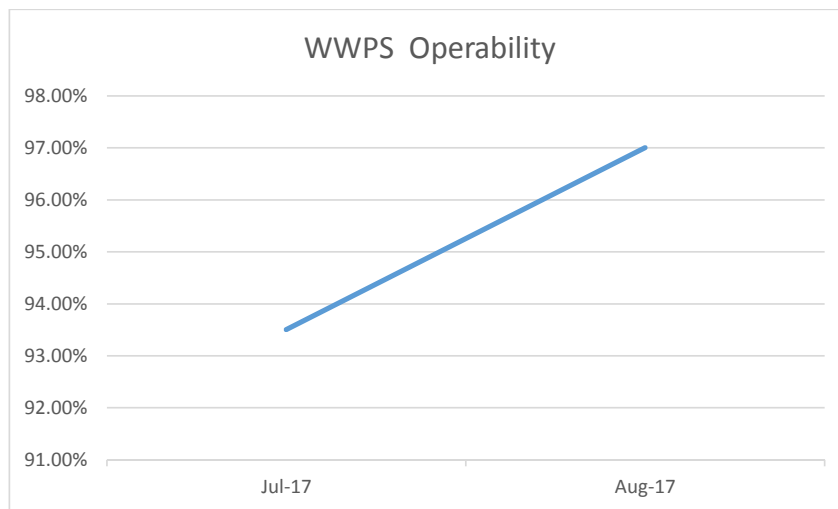


## Wastewater Treatment

**Monthly Wastewater Treatment Summary - August 2017**


## WW Treatment Plants - Flows

	Facility	Avg. Daily Flows	Sludge (lbs)	Sludge Disp. (\$)
	Hagatna	6.57	694,420	\$ 62,498
	Northern	5.77	690,200	\$ 62,118
	Agat	1.16		
	Baza	0.29		
	Umatac	0.30		
	Inarajan	0.08		
		14.17	1,384,620	\$ 124,616

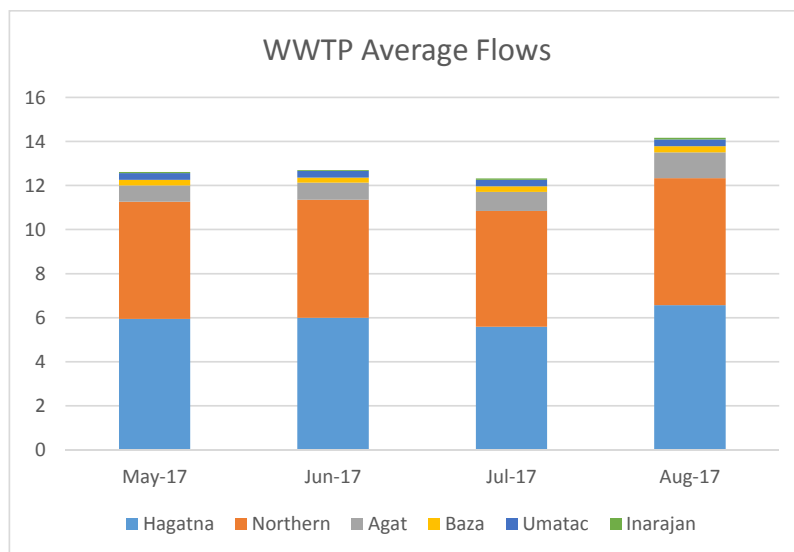



## Asset Management

**PM to CM Ratio as of October 06, 2017**

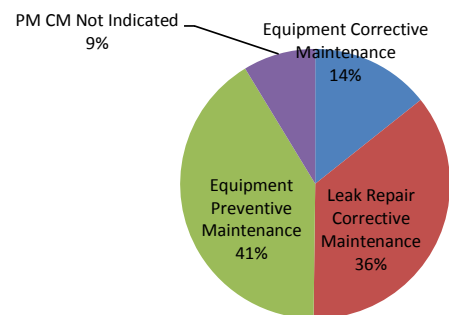

**PM to CM Work Order Completion Ratio as of October 06, 2017**

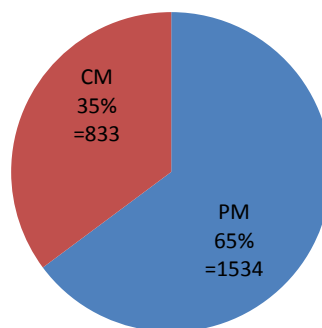

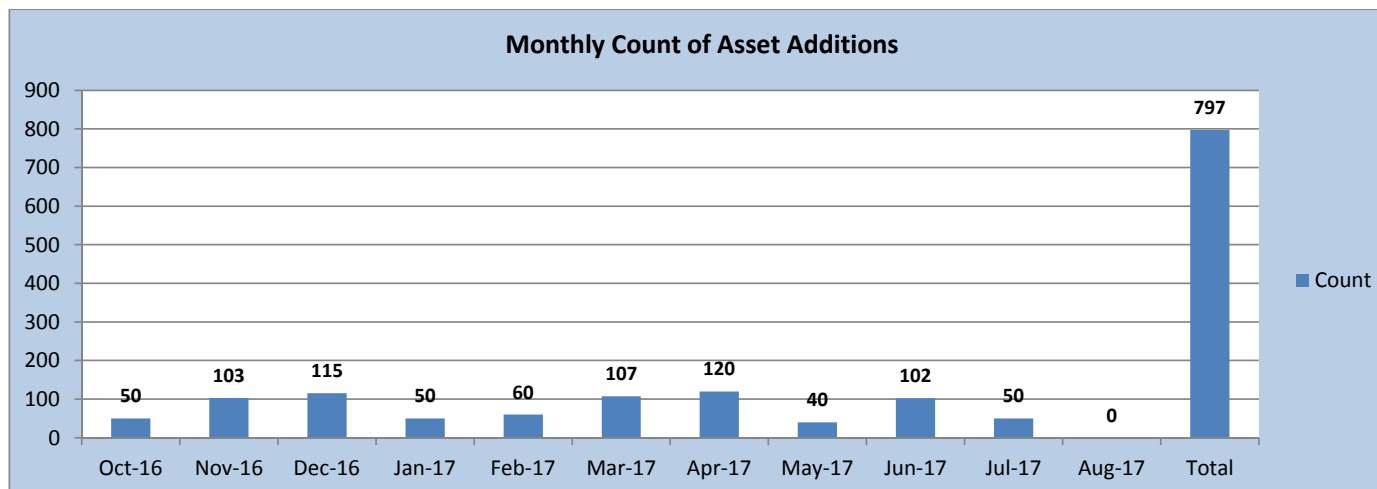

#### On-Going Asset Management Activities

- Ongoing routine asset condition assessment for all water and wastewater assets and update asset registry.  
**Goal:** once a year for critical assets and every three years for non-critical.
- Risk identification based on asset condition
- Improved PM scheduling
- Establishment of an Asset Management System based on ISO 5500 standards through effective and efficient management of GWA assets.

### Operational Issues

- Recovery from Heavy weather events affecting production for Yigo and Barrigada/Tiyan areas – in progress
  - Completed well pullouts for the following wells (since 8-29-17):
    - M-21 @ ~200 gpm
    - Y-12 @ ~235 gpm
    - AG-2 @ ~500 gpm
    - EX-11 @ ~210 gpm
    - F-6 @ ~150 gpm
  - M-6 Pullout on-going
  - Joint GWA-GPA Deep Well Task Force has increased its efforts to improve system resilience to these events.
  - Northern Reservoir Daily Capacity increased from low of 20% at end of August to 56% as of September 21<sup>st</sup>.

### Meter Changeout NC/LC Accounts

- As of September 16, 2017:
  - Field activities completed: 4934
  - Meter changeouts: **3406** (Crews verified 1528 meters did not require changeout)
  - Field activity reports created for completed changeouts: 1936
  - Accounts backbilled: 382 (as of 9/16/17)
- Week of 9/10/17 through 9/16/17
  - Field Changeouts: 369
  - Field activity reports pending posting: 481
  - Meter Test Facility field activity reports pending posting: 91
- Meter Inventory
  - In stock: 2715
  - Programmed: 256

### Marbo (Andy-South) Wells – Status


- Correspondence initiated with GSA
- Surveyor has provided sketch for parceling (under GWA review)
- Technical descriptions pending for submission to GSA

#### One Guam Update

- Tumon Maui Well: The quarterly inspection is rescheduled for Tuesday, October 10, to document the status of the system.
- Santa Rosa Tank: Working on the MOU for the Intertie at Santa Rosa Tanks.
- Agat Santa Rita WWTP: Miguel Bordallo submitted the request for the in-kind consideration for use of permanent easement . DOD is reviewing the request.
- Other:
  - Nimitz Hill : GWA will be receiving the infrastructure easement for returned federal lands in Nimitz Hill.
    - NAVFAC will prepare the deed for the easements. The map for the sewer lines is completed; waiting on the water lines.
    - GWA will be getting 3 meters along the transmission lines.
  - ACEORP Priority: Maui Well (Tamuning)-GWA will be requesting the ACEORP Maui well to be transferred to GWA. Inspection and sampling will be scheduled before the transfer of the property.

## Court Order

	Items	On-time Items Completed/Continuous	Items Delayed	Completed Late	Items on Schedule	Performance %
Court order total	93	79	2	8	4	97.8%

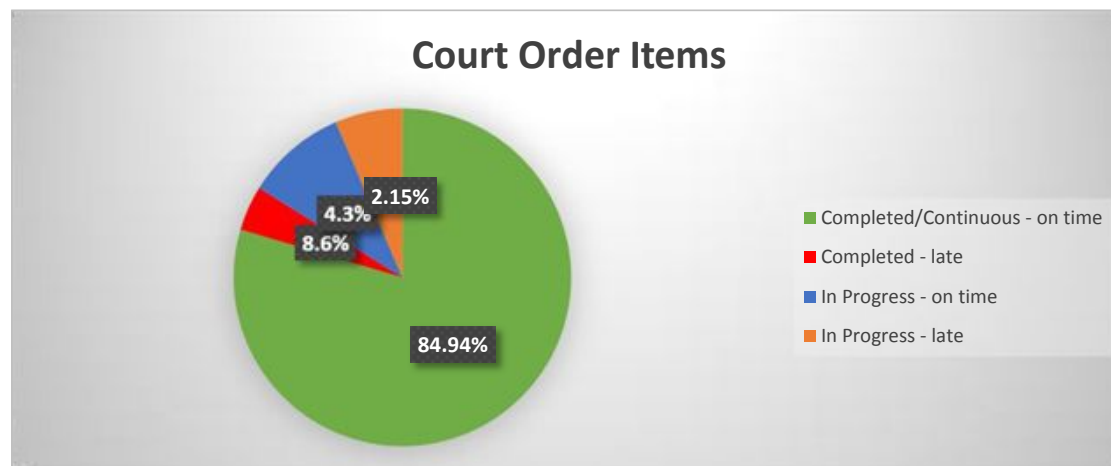

## Status Information

- 2 items delayed
  - CI Residual Monitors
  - Meters
- Final Date to complete all Court Order items is December 31, 2020.
- Overflow or Bypass events reported to USEPA:
  - Umatac By Pass 09/09/17 – (10/06/17 ended) – restarted 10/09/17 – continues.
  - Ypaopao Lift Station Wet Well – 10/03/17– instrument problem with rain
  - Harmon Lift station – 10/03/17 – heavy rain
  - Southern Link Lift Station – 10/04/17 – instrument problem
  - Santa Maria Ave. Santa Rita, sewer overflow – heavy rain – 10/04/17
  - Aga Dr. Santa Rita, sewer overflow – heavy rain - 10/09/2017

## CIP Summary

### CIP Summary: Project Encumbrance

	2010 Bond		2013 Bond		2016 Bond			
	Funded	Complete	Funded	Complete	Funded	Complete	Total CIP Projects	%
Potable Water	28	17	21	7	20	0	35	49%
Wastewater	16	13	7	3	8	1	22	31%
Electrical Engineering	5	5	6	1	5	0	10	14%
Miscellaneous Eng'g Support	2	0	3	1	4	1	4	6%
<b>Totals</b>	<b>51</b>	<b>35</b>	<b>37</b>	<b>12</b>	<b>37</b>	<b>2</b>	<b>71</b>	<b>100%</b>
% of Total CIP by Fund Source	72%		52%		52%			

### CIP Summary: Project Amounts

	2010 Bond		2013 Bond		2016 Bond			
	Funded	%	Funded	%	Funded	%	Total CIP Projects	%
Potable Water	\$ 41,903,305	48%	\$ 58,317,117	42%	\$ 64,647,830	46%	\$ 164,868,252	45%
Wastewater	\$ 36,009,577	41%	\$ 73,837,883	53%	\$ 60,227,170	43%	\$ 170,074,630	46%
Electrical Engineering	\$ 1,748,118	2%	\$ 3,395,000	2%	\$ 8,750,000	6%	\$ 13,893,118	4%
Miscellaneous Eng'g Support	\$ 7,741,000	9%	\$ 3,775,000	3%	\$ 6,394,460	5%	\$ 17,910,460	5%
<b>Totals</b>	<b>\$ 87,402,000</b>	<b>100%</b>	<b>\$ 139,325,000</b>	<b>100%</b>	<b>\$ 140,019,460</b>	<b>100%</b>	<b>\$ 366,746,460</b>	<b>100%</b>
Funds Encumbered to date	\$ 83,153,000	95%	\$ 129,294,000	93%	\$ 60,060,000	43%		
% of Total CIP Funding	23.8%		38.0%		38.2%			

CIP Funds Encumbered



CIP Funding Summary





## SRF Grant Summary


## SRF Grant Summary - Projects

	Procurement	In-Progress	Complete	Totals	%
Design	0	10	2	12	39%
D-B	0	3		3	10%
Const	1	6		7	23%
CM	2	7		9	29%
<b>Totals</b>	3	26	2	31	
<b>%</b>	10%	84%	6%		


## SRF Grant Summary - Contract Amounts

	Procurement	In-Progress	Complete	Totals	%
Design	\$ -	\$ 10,490,197	976,151	\$ 11,466,348	33%
D-B	\$ -	\$ 3,502,453		\$ 3,502,453	10%
Const	\$ -	\$ 17,043,244		\$ 17,043,244	49%
CM	\$ 584,725	\$ 1,989,176		\$ 2,573,901	7%
<b>Totals</b>	\$ 584,725	\$ 33,025,070	\$ 976,151	\$ 34,585,946	
<b>%</b>	2%	95%	3%		

SRF Grant Summary - Projects

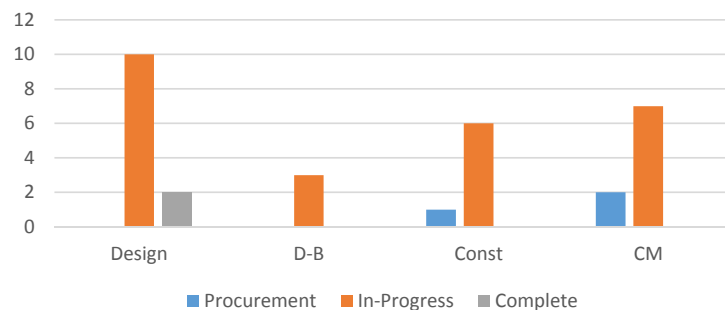

SRF Grant Summary - Contract Amounts

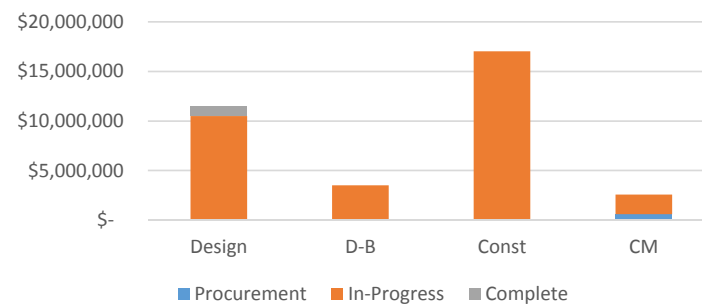

## OEA Grant Summary

- Grant application submitted for remainder of funding; OEA meeting schedule in early October
- NDWWTP Upgrades
  - Kick-off and Technical Review Meeting conducted end of August
  - Currently conducting WW sampling and characterization study
- Outfall Diffuser
  - 30% Design received August 30th – under review
  - GWA assisting with CCTV inspection of old outfall for bypass use
- Interceptor
  - Bridging Documents for Design-Build procurement received September 1<sup>st</sup> ; Under GWA review
  - Right-of-entry documents required (ALC and Navy) for completion of environmental documents
- NGLA Monitoring Wells
  - Design conference schedule for early October
  - Design in progress; GWA waiting for review set - 30% due November 2017

Action Item	Date (Target)	Date (Actual)	Status	Remarks
Project Funds Available	July-16	AUG-30-16	Completed	
Land Acquisition	Jan-17	Jan-17 (Compensation Pending)	Pending	Survey complete, appraisals complete – under review
Procure PM/CM Firm	Jan-17	Jan-17 (NTP Issued Feb 10th)	Completed	
Procure Design Firm	Jul-17		Completed	Contract issued; kickoff pending
Design -- 30/60/90/Final -- Review	Jun-18		On-target	Project design schedule under review by PM/CM
NEPA Analysis and Determination	Feb-17		Delayed	USEPA work on-going; procurement of contractor completed
Procure Construction Firm	Dec-18		On-target	
Construction Complete/Commence Operations	Nov-21		On-target	
Sewer line connection from MCB to GWA infrastructure	Jul-19		On-target	
MCB Initial Operating Capability	Jul-22		On-target	


## Land Acquisition Summary

GWA Facility	Location	Gov. or Private Property	Land Acquisition Status
	Ugum	Private	GWA reviewing change order proposal.
	Property Adjacent to Southern Link	Private	GWA started acquisition process on 12/23/2016. Property ownership vested in GWA 08/11/2017.
	Astumbo	Gov't. - CLTC	GWA and DLM working together on Land Registration process. Abstract of Title sent to GWA for review 06/26/17. Pending technical description from DLM survey division. GWA reviewing technical description document - 10/02/17.
	Piti	Private	GWA consultants drafting Letter of Intent for private property owners. GWA consultants to draft Letter of Interest to Parks & Rec for possible use of portion of park area for Booster Pump Station 09/18/17.
	A-12	Private	GWA in process of correcting title issue.
Expansion of the Northern District Wastewater Treatment Plant (NDWWTP)	Dededo	Gov't - GALC	Lot Parceling Survey Map sent to DLM for review and comments 08/07/17. Appraisal Reports completed 08/11/17. Appraisal services requested for Cornerstone Valuation 09/29/17.
Deep Well	Y-8	Gov't. - CLTC	DCA currently working on severance property map.
	AG-12	Dept. of Agriculture/ Manhita Farms	Land Registration Map submitted to DLM for review and comments 09/29/17.
Booster Pump Station	Brigade	Private	Pending Escrow revised buyers settlement statement for release of purchase price funding through Finance 10/11/17.


## NRW – Update

- Water Audit update on-going
  - Production rates are being reviewed for accuracy and refined
  - Unmetered, Authorized uses are being quantified
  - Meter and billing inaccuracies are being reviewed and refined

## Leak Repair Summary

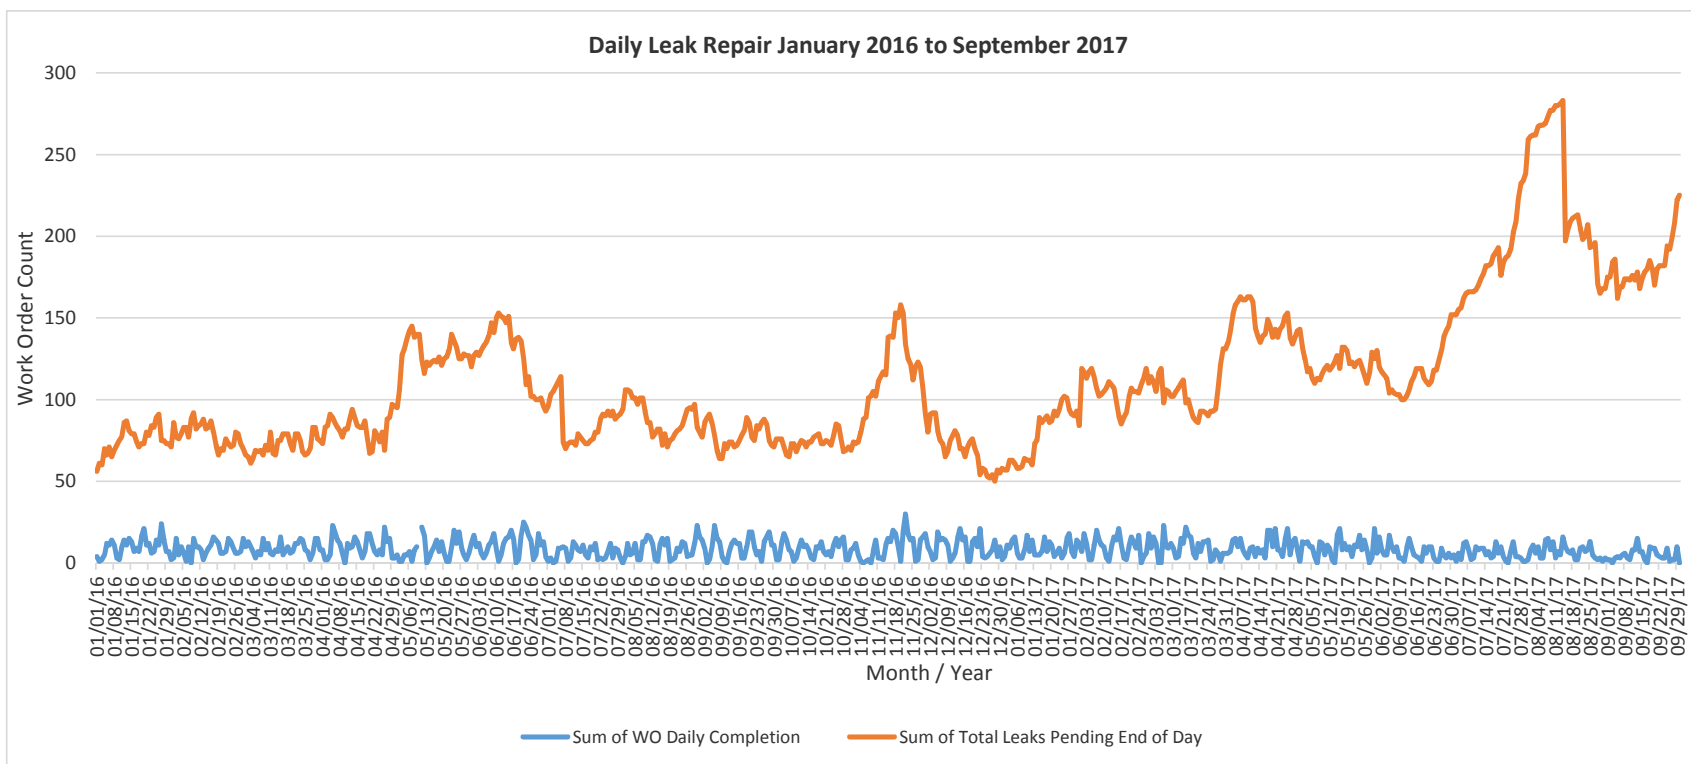



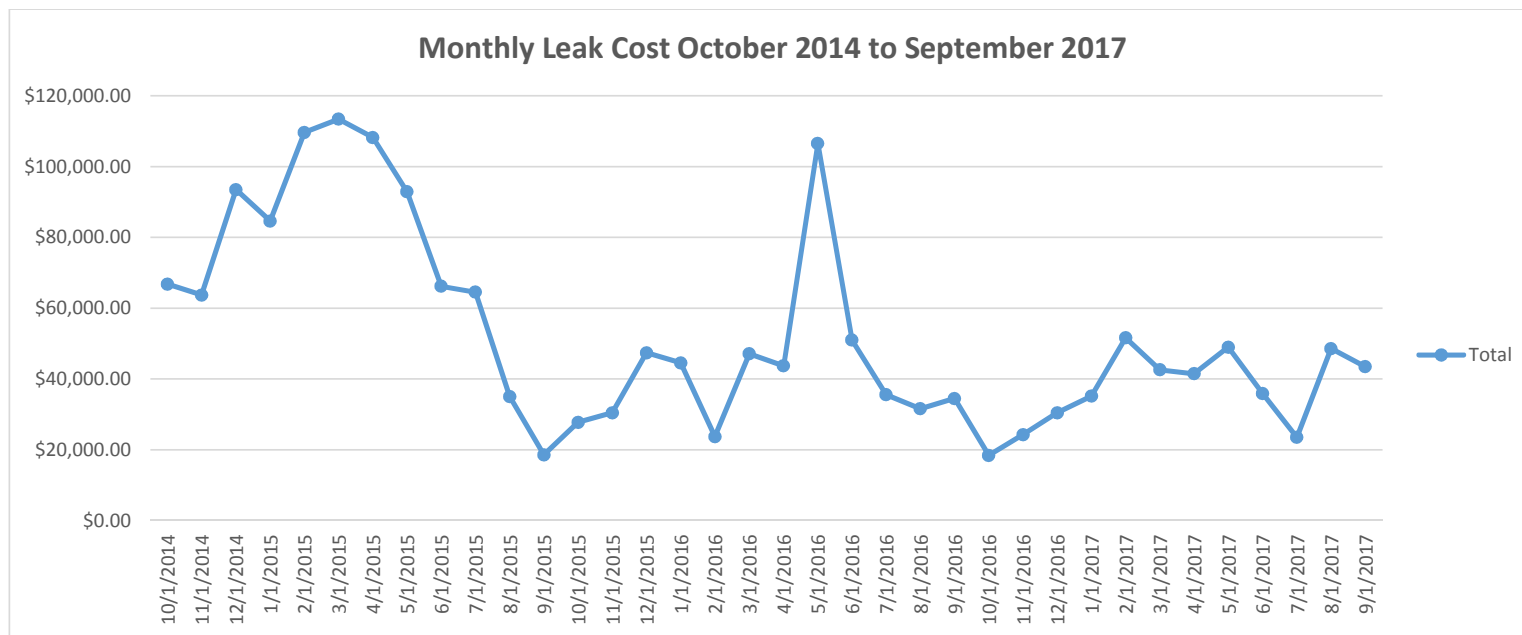

**Assumptions:**

1. Leak rate = 4 gpm
2. Cost per kgal = \$4.00

# GWA October 17, 2017 Work Session - DIVISION REPORTS

## GWA Utility Services Division Monthly Status Report Month ending Sept 30, 2017

UTILITY SERVICES DIVISION UNITS & ACTIVITIES:		WEEKLY AVERAGE AUG 2017	AUG 2017 MONTHLY TOTAL	WEEK ENDING: 9/9/2017	WEEK ENDING: 9/16/2017	WEEK ENDING: 9/23/2017	WEEK ENDING: 9/30/2017	WEEKLY AVERAGE SEPT 2017	SEPT 2017 MONTHLY TOTAL
<b>Collections Unit</b>									
I.	Number of accounts cut for nonpayment:	64	322	48	80	22	57	52	207
II.	Number of accounts restored for nonpayment:	58	288	45	44	35	53	44	177
III.	Number of No water reports responded to:	2	12	4	1	2	5	3	12
IV.	Number of Secure/Unsecure valve reports responded to:	2	11	2	4	2	3	3	11
V.	Number of Verify reads responded to:	2	10	0	2	0	5	2	7
VI.	Number of new pay plans negotiated for <b>active</b> accounts :	166	831	197	189	117	139	161	642
VII.	Number of active pay plans negotiated and ongoing :	835		755	967	1068	1224	1004	
VIII.	Number of <b>inactive</b> accounts with a payment arrangement:	0		2	2	2	2	2	
IX.	Number of broken payment plans:	70	349	84	61	77	60	71	282
<b>Customer Service Unit</b>									
I. Service Delivery Points:									
a. GBN Public Service Building – Fadian									
i.	Total Customers Assisted :	262	1311	242	226	251	251	243	970
ii.	Total Abandoned Requests :	24	118	26	29	43	26	31	124
iii.	Average Wait Time:	11 minutes		14 minutes	13 minutes	9 minutes	9 minutes	11 minutes	
iii.	Average Service Time:	13 minutes		13 minutes	13 minutes	12 minutes	13 minutes	13 minutes	
iv.	Breakdown by request type:								
1.	Apply for water	61	304	64	62	55	64	61	245
2.	Restore water cut for no	7	36	8	13	15	13	12	49
3.	Terminate Water	21	104	18	16	22	26	21	82
4.	Copy of Bill	38	191	29	27	35	28	30	119
5.	Billing Dispute	69	343	58	50	75	70	63	253
6.	Billing Dispute follow up	3	17	2	5	2	0	2	9
7.	General Questions & Ot	37	183	32	31	31	34	32	128
8.	Report a water leak	2	11	4	2	1	3	3	10
9.	Report water theft	0	1	0	0	0	0	0	0
10.	Payment Arrangement	28	138	30	34	23	23	28	110
b. Julale Satellite Office – Hagatna									
i.	Total Customers Assisted :	230	1152	209	214	244	275	236	942
ii.	Total Abandoned Requests :	19	96	25	1	7	9	11	42
iii.	Average Wait Time:	7 minutes		8 minutes	5 minutes	4 minutes	5 minutes	7 minutes	
iii.	Average Service Time:	12 minutes		10 minutes	11 minutes	10 minutes	10 minutes	12 minutes	
iv.	Breakdown by request type:								
1.	Apply for water	52	258	31	44	41	54	43	170
2.	Restore water cut for no	10	51	7	19	13	14	13	53
3.	Terminate Water	23	115	13	9	19	26	17	67
4.	Copy of Bill	39	197	60	37	55	49	50	201
5.	Billing Dispute	57	284	44	51	61	66	56	222
6.	Billing Dispute follow up	3	15	0	1	1	1	1	3
7.	General Questions & Ot	24	119	19	28	25	29	25	101
8.	Report a water leak	0	2	1	3	4	1	2	9
9.	Report water theft	0	0	0	0	0	0	0	0
10.	Payment Arrangement	29	144	34	29	26	37	32	126

# GWA October 17, 2017 Work Session - DIVISION REPORTS

## GWA Utility Services Division Monthly Status Report Month ending Sept 30, 2017


UTILITY SERVICES DIVISION UNITS & ACTIVITIES:		WEEKLY AVERAGE AUG 2017	AUG 2017 MONTHLY TOTAL	WEEK ENDING: 9/9/2017	WEEK ENDING: 9/16/2017	WEEK ENDING: 9/23/2017	WEEK ENDING: 9/30/2017	WEEKLY AVERAGE SEPT 2017	SEPT 2017 MONTHLY TOTAL
c. Upper Tumon Satellite Office – Upper Tumon									
i.	Total Customers Assisted :	296	1482	276	315	310	323	306	1224
ii.	Total Abandoned Requests :	10	52	35	6	7	17	16	65
iii.	Average Wait Time:	12 minutes		13 minutes	12 minutes	14 minutes	11 minutes	12 minutes	
iii.	Average Service Time:	11 minutes		4 minutes	9 minutes	14 minutes	12 minutes	11 minutes	
iv.	Breakdown by request type:								
	1. Apply for water	67	337	56	67	69	79	68	271
	2. Restore water cut for no	8	42	11	9	14	7	10	41
	3. Terminate Water	22	108	26	26	32	33	29	117
	4. Copy of Bill	54	272	64	73	60	52	62	249
	5. Billing Dispute	72	359	66	74	59	88	72	287
	6. Billing Dispute follow up	2	11	1	1	4	3	2	9
	7. General Questions & Ot	36	178	23	33	38	30	31	124
	8. Report a water leak	3	13	2	8	4	5	5	19
	9. Report water theft	0	0	0	1	0	1	1	2
	10. Payment Arrangement	32	162	28	24	29	25	27	106
II. Customer Call Center									
a.	Calls Recieved :	467	2336	367	362	284	426	360	1439
b.	Calls Immediately Answered :	102	508	318	345	277	408	337	1348
c.	Calls Abandoned	95	477	55	54	54	103	67	266
d.	Calls Handled by Voice mail:	270	1349	50	72	70	59	63	251
e.	Average duration of calls answered:	14 minutes		16 minutes	14 minutes	15 minutes	15 minutes	14 minutes	
III. Customer Emails:									
a.	Emails Recieved :								
i.	customers@guamwaterworks.org	47	237	50	29	33	46	40	158
	Breakdown by request type (email):								
	1. Apply for water	3	16	7	1	3	3	4	14
	2. Terminate Water	2	9	0	1	1	2	1	4
	3. Copy of Bill	2	11	2	2	3	0	2	7
	4. Billing Dispute & follow up	10	48	6	6	7	14	8	33
	5. General Questions & Other	14	69	18	15	9	14	14	56
	6. Report a water leak	3	16	12	1	6	3	6	22
	7. Report water theft	1	4	0	0	0	0	0	0
	8. Online services inquiry	5	23	5	3	4	10	6	22
ii.	realtors@guamwaterworks.org	4	19	0	0	0	0	0	0
b.	Emails Replied (both):	37	183	38	16	13	33	25	100



# GWA October 17, 2017 Work Session - DIVISION REPORTS

## GWA Utility Services Division Monthly Status Report Month ending Sept 30, 2017

UTILITY SERVICES DIVISION UNITS & ACTIVITIES:	WEEKLY AVERAGE AUG 2017	AUG 2017 MONTHLY TOTAL	WEEK ENDING: 9/9/2017	WEEK ENDING: 9/16/2017	WEEK ENDING: 9/23/2017	WEEK ENDING: 9/30/2017	WEEKLY AVERAGE SEPT 2017	SEPT 2017 MONTHLY TOTAL
			9/9/2017	9/16/2017	9/23/2017	9/30/2017		
IV. Saturday Services: 9AM TO 1PM ONLY	21		26	19	16	27	22	
a. VISITS: Breakdown by request type:								
1. Apply for water	4		3	5	2	4	4	
2. Restore water cut for non payment	0		1	1	0	1	1	
3. Terminate Water	0		2	0	2	1	1	
4. Copy of Bill	4		6	7	5	7	6	
5. Billing Dispute	5		9	2	5	9	6	
6. Billing Dispute follow up	0		0	0	0	0	0	
7. General Questions & Other	3		2	0	0	2	1	
8. Report a water leak	0		0	0	1	0	0	
9. Report water theft	0		0	0	0	0	0	
10. Payment Arrangement	4		3	4	1	3	3	

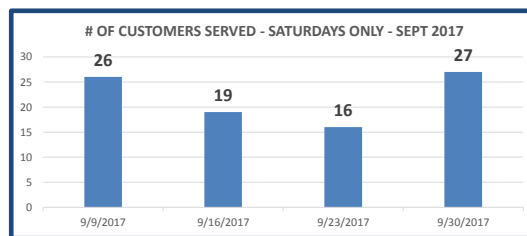

b. CALLS TO CALL CENTER (Saturday services only):

9/9/2017	9/16/2017	9/23/2017	9/30/2017
27	16	22	54




# GWA October 17, 2017 Work Session - DIVISION REPORTS

## GWA Utility Services Division Monthly Status Report Month ending Sept 30, 2017

UTILITY SERVICES DIVISION UNITS & ACTIVITIES:	WEEKLY AVERAGE AUG 2017	AUG 2017 MONTHLY TOTAL	WEEK ENDING: 9/9/2017	WEEK ENDING: 9/16/2017	WEEK ENDING: 9/23/2017	WEEK ENDING: 9/30/2017	WEEKLY AVERAGE SEPT 2017	SEPT 2017 MONTHLY TOTAL
<b>Dispute Resolution &amp; Document Control</b>								
I. Dispute Resolution:								
a. Number of disputed accounts resolved:	18	90	9	13	16	9	12	47
b. Number of disputed accounts under review:	179	895	179	179	179	179	179	716
II. Document Control:								
a. Number of field activities posted :	454	2269	402	349	351	319	355	1421
b. Number of field activities pending:	434	2168	373	388	460	580	450	1801
<b>Disconnect/Reconnect Unit</b>								
I. Number of field activities received:	304	1521	262	249	290	320	280	1121
II. Number of field activities completed:	303	1517	317	257	289	288	288	1151
III. Number of field activities pending field action:	5	24	2	4	3	10	5	19
<b>Meter Reading Unit</b>								
I. Number of meters read:								
a. Electronically Read Meters:	9977	49883	9014	10652	10376	12836	10720	42878
b. Manually Read Meters:	80	402	39	43	39	64	46	185
II. Unread meters (Meters scheduled to be read but not read):	2	10	27	92	25	107	63	251
III. Number of data logs received:	47	237	25	22	38	35	30	120
IV. Number of data logs retrieved:	48	239	19	31	27	13	23	90
V. Number of data logs pending field action:	6	28	0	0	4	5	2	9
VI. Communication Errors/Reprogramming requests received (from CSU):			0	0	0	10		
VII. Number of estimated readings (for the week):	34	172	18	16	32	158	56	224
a. Reasons for Estimations:								
i. Cant locate meter:	2	11	0	1	6	4	3	11
ii. Temporary Obstruction	6	30	0	2	0	0	1	2
iii. Vicious Dog	1	3	0	0	1	3	1	4
iv. Flooded meter	1	4	1	7	2	14	6	24
v. Corrective action requested (database corrections needed)	1	3	0	0	0	1	0	1
vi. Possible changed out meter:	15	75	14	0	15	122	38	151
vii. Communication/Programming error (code 92's):			2	3	4	8	4	17
viii. Other:	1	3	1	3	4	6	4	14
VII. Electronic Read Percentage: (for the week):	99%	99%	98%	99%	99%	99%	99%	99%
VIII. Leak flags recorded from customer's private line:			921	1291	1235	1294	1185	4741
<b>Revenue Protection Unit</b>								
I. Number of Inactive Still Consuming Reports rec'd & investigated:	0	1	3	1	1	3	2	8
II. Number of Illegal Connection reports rec'd & investigated:	1	5	2	0	0	0	1	2
III. Meter Replacement Project – Post 2010 Metron Farnier & Sensus Status Report (as of Sept 30 2017):								

METER TYPE	COUNT
SENSUS	2
METRON	
FARNIER	0
	2

### a. Account & Meter Type Count :

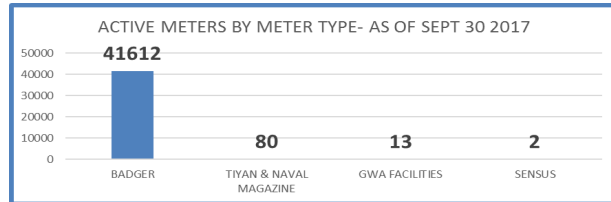



## **Engineering Monthly Report October 2017**

**Prepared By:  
Thomas Cruz, P.E. Chief Engineer**

## Table of Contents

Section	Description	Page
A	Summary Table of 2010, 2013 and 2016 Bond	3
B	Projects Procurement	5
C	CIP Water Section	8
D	CIP Wastewater Section	13
E	CIP Engineering Support	16
F	GIS Section	17
G	Permits Section	18
H	SRF Project Status Report	19

## A. Summary Table of 2010, 2013 and 2016 Bond Potable Water

CIP #	CIP Description	2010 Bond Allotment	% encumbered	% available	2013 Bond Allotment	% encumbered	% available	2016 Bond Allotment	% encumbered	% available
PW 05-01	Ground Water Disinfection	\$ 500,000.00	100.00%	0.00%	\$ -	N/A	N/A	\$ -	N/A	N/A
PW 05-03	Santa Rita Springs Booster Pump Rehab Phase II	\$ -	N/A	N/A	\$ 100,000.00	100.00%	0.00%	\$ -	N/A	N/A
PW 05-05	*A Series Well Transmission Line	\$ 518,143.96	100.00%	0.00%	\$ 400,000.00	100.00%	0.00%	\$ -	N/A	N/A
PW 05-06	Water Booster Pump Station	\$ 500,000.00	100.00%	0.00%	\$ 1,861,000.00	99.49%	0.51%	\$ 4,139,000.00	0.00%	100.00%
PW 05-07	Water Replacement Program	\$ 10,300,000.00	99.84%	0.16%	\$ 999,000.00	99.75%	0.25%	\$ 4,501,000.00	3.33%	96.67%
PW 05-08	Barrigada Tank Repair/Replacement	\$ 5,450,000.00	99.92%	0.08%	\$ 4,987,000.00	99.32%	0.68%	\$ 1,013,000.00	0.00%	100.00%
PW 05-09	Leak Detection	\$ 200,000.00	100.06%	-0.06%	\$ 20,000.00	96.25%	3.75%	\$ 1,180,000.00	0.00%	100.00%
PW 05-10	Potable Water System Planning	\$ 200,000.00	100.00%	0.00%	\$ 624,000.00	100.00%	0.00%	\$ 2,276,000.00	20.93%	79.07%
PW 05-11	Implement Ground Water Rule	\$ 1,700,000.00	100.00%	0.00%	\$ 1,000,000.00	100.00%	0.00%	\$ -	N/A	N/A
PW 05-12	Brigade II (Ugum Lift) BPS Upgrade	\$ 1,700,000.00	18.03%	81.97%	\$ -	N/A	N/A	\$ -	N/A	N/A
PW 05-13	Deep Well Rehabilitation	\$ 548,000.00	100.00%	0.00%	\$ 200,000.00	100.00%	0.00%	\$ 250,000.00	0.00%	100.00%
PW 05-14	New Deep Wells at Dow n Hard	\$ 638,252.85	76.11%	23.89%	\$ 810,000.00	0.00%	100.00%	\$ 1,190,000.00	0.00%	100.00%
PW 05-15	Rehabilitation of Asan Springs	\$ 900,000.00	37.87%	62.13%	\$ -	N/A	N/A	\$ -	N/A	N/A
PW 05-16	Master Meters	\$ 1,600,000.00	99.44%	0.56%	\$ 784,000.00	99.88%	0.12%	\$ 3,616,000.00	0.00%	95.81%
PW 09-01	Ugum Water Treatment Plant Intake	\$ 700,000.00	99.47%	0.53%	\$ 982,000.00	100.00%	0.00%	\$ 18,000.00	0.00%	100.00%
PW 09-02	Water Wells	\$ -	N/A	N/A	\$ 4,200,000.00	46.77%	53.23%	\$ 2,500,000.00	13.60%	86.40%
PW 09-03	Water Distribution System	\$ 3,174,748.00	100.00%	0.00%	\$ 11,151,000.00	79.08%	20.92%	\$ 49,000.00	0.00%	100.00%
PW 09-04	Pressure Zone Realignment	\$ -	N/A	N/A	\$ 431,000.00	99.95%	0.05%	\$ 1,141,000.00	0.00%	100.00%
PW 09-06	Central Water Distribution System 2005	\$ 900,000.00	91.67%	8.33%	\$ -	N/A	N/A	\$ -	N/A	N/A
PW 09-08	Mechanical/Electrical Equipment	\$ 1,200,000.00	100.00%	0.00%	\$ 430,000.00	99.60%	0.40%	\$ 100,000.00	0.00%	100.00%
PW 09-09	Water Reservoir Internal/External	\$ 2,000,000.00	73.20%	26.80%	\$ -	N/A	N/A	\$ -	N/A	N/A
PW 09-10	Water Reservoir Internal/External	\$ -	N/A	N/A	\$ -	N/A	N/A	\$ 800,000.00	0.00%	100.00%
PW 09-11	Water System Reservoirs 2005 Improvements	\$ 1,050,000.00	100.00%	0.00%	\$ 13,878,000.00	99.06%	0.94%	\$ 28,350,000.00	9.32%	90.68%
PW 11-01	Distribution System Upgrades	\$ 474,159.85	100.00%	0.00%	\$ -	N/A	N/A	\$ -	N/A	N/A
PW 11-02	Ugum Water Treatment Plant Reservoir	\$ -	N/A	N/A	\$ 90,000.00	0.00%	100.00%	\$ -	N/A	N/A
PW 12-01	Water Audit Program & Water Loss Control Plan	\$ 100,000.00	78.46%	21.54%	\$ -	N/A	N/A	\$ 1,000,000.00	0.00%	100.00%
PW 12-02	Production Plan / Reduce Navy Purchases	\$ 100,000.00	100.00%	0.00%	\$ -	N/A	N/A	\$ -	N/A	N/A
PW 12-03	Hydraulic Assessment of Tanks	\$ 500,000.00	100.00%	0.00%	\$ -	N/A	N/A	\$ -	N/A	N/A
PW 12-04	Agana Heights & Chao Tanks	\$ 4,700,000.00	100.00%	0.00%	\$ 3,280,000.00	8.51%	91.49%	\$ 1,220,000.00	0.00%	100.00%
PW 12-05	Tank Major Repair Yigo #1, Mangilao #2, Astumbo#1	\$ 1,900,000.00	95.16%	4.84%	\$ 11,605,000.00	99.99%	0.01%	\$ 1,895,000.00	96.15%	3.85%
PW 12-06	Tank Replacement Piti & Hyundai	\$ -	N/A	N/A	\$ -	N/A	N/A	\$ 7,409,830.00	0.00%	100.00%
PW 12-07	Assessment of Malojlo Elevated & Yigo Elevated	\$ 200,000.00	100.00%	0.00%	\$ 485,117.00	100.00%	0.00%	\$ -	N/A	N/A
PW 12-08	Public Water System Asset Inventory/ Condition Assessment	\$ 100,000.00	100.00%	0.00%	\$ -	N/A	N/A	\$ -	N/A	N/A
PW 12-09	Public Water System GIS & Mapping	\$ 50,000.00	100.00%	0.00%	\$ -	N/A	N/A	\$ -	N/A	N/A
PW 14-01	Fire Hydrant Replacement Program	\$ -	N/A	N/A	\$ -	N/A	N/A	\$ 2,000,000.00	0.00%	100.00%
		\$ 41,903,304.66			\$ 58,317,117.00			\$ 64,647,830.00		

## Wastewater

CIP #	CIP Description	2010 Bond Allotment	% encumbered	% available	2013 Bond Allotment	% encumbered	% available	2016 Bond Allotment	% encumbered	% available
WW 05-04	Wastewater System Planning	\$ 1,500,000.00	100.00%	0.00%	\$ 651,000.00	100.00%	0.00%	\$ 349,000.00	89.68%	10.32%
WW 05-05	Wastewater Vehicles	\$ 235,000.00	100.00%	0.00%	\$ -	N/A	N/A	\$ -	N/A	N/A
WW 05-07	NDWWTP - Chlorine Tanks	\$ 250,000.00	100.00%	0.00%	\$ -	N/A	N/A	\$ -	N/A	N/A
WW 09-01	Lift station upgrades	\$ -	N/A	N/A	\$ 946,000.00	84.08%	0.06%	\$ 2,404,000.00	12.21%	87.79%
WW 09-06	Wastewater Collection System Rep/ Rehabilitation	\$ 1,105,000.00	99.93%	0.07%	\$ 780,000.00	97.55%	2.45%	\$ 2,920,000.00	0.00%	100.00%
WW 09-08	Facilities Plan/Design for Baza Gardens WWTP	\$ 1,250,000.00	100.00%	0.00%	\$ -	N/A	N/A	\$ -	N/A	N/A
WW 09-10	Facilities Plan/Design for Agat-Santa Rita WWTP	\$ 899,630.00	100.00%	0.00%	\$ -	N/A	N/A	\$ -	N/A	N/A
WW 11-03	Baza Gardens STP Replacement	\$ 1,301,947.00	24.27%	11.57%	\$ 3,114,883.00	99.97%	0.03%	\$ 29,400,170.00	99.31%	0.69%
WW 11-04	Facilities Plan/Design for Umatac-Merizo WWTP	\$ 900,000.00	100.00%	0.00%	\$ 473,000.00	100.00%	0.00%	\$ 527,000.00	47.44%	52.56%
WW 11-08	Agat/Santa Rita STP Replacement	\$ 2,218,000.00	99.91%	0.09%	\$ 67,200,000.00	99.43%	0.57%	\$ 3,000,000.00	14.91%	85.09%
WW 12-01	Northern District WWTP Primary Treatment Upgrade	\$ 11,750,000.00	100.00%	0.00%	\$ -	N/A	N/A	\$ -	N/A	N/A
WW 12-02	Biosolids Management Plan	\$ 200,000.00	100.00%	0.00%	\$ -	N/A	N/A	\$ -	N/A	N/A
WW 12-03	Agana WWTP Interim Measures	\$ 11,500,000.00	100.00%	0.00%	\$ 673,000.00	100.00%	0.00%	\$ 827,000.00	0.00%	100.00%
WW 12-04	I&I SSES Southern	\$ 800,000.00	100.00%	0.00%	\$ -	N/A	N/A	\$ -	N/A	N/A
WW 12-05	I&I SSES Central	\$ 850,000.00	100.00%	0.00%	\$ -	N/A	N/A	\$ -	N/A	N/A
WW 12-06	I&I SSES Northern	\$ -	N/A	N/A	\$ -	N/A	N/A	\$ -	N/A	N/A
WW 12-07	Umatac Merizo Replacement	\$ 250,000.00	100.00%	0.00%	\$ -	N/A	N/A	\$ 20,800,000.00	93.12%	0.74%
WW 12-08	Wastewater System GIS & Mapping	\$ -	N/A	N/A	\$ -	N/A	N/A	\$ -	N/A	N/A
WW 12-09	Wastewater Facility Back Up Power	\$ -	N/A	N/A	\$ -	N/A	N/A	\$ -	N/A	N/A
WW 12-10	Wastewater System Asset Inventory	\$ -	N/A	N/A	\$ -	N/A	N/A	\$ -	N/A	N/A
WW 17-01	Wastewater Sewer System Expansion									
WW 17-02	Northern District WWTP Secondary Treatment Upgrade	\$ 1,000,000.00	0.00%	100.00%						
		\$ 36,009,577.00			\$ 73,837,883.00			\$ 60,227,170.00		

**Electrical Engineering Support**

CIP #	CIP Description	2010 Bond Allotment	% encumbered	% available	2013 Bond Allotment	% encumbered	% available	2016 Bond Allotment	% encumbered	% available
EE-05-02	SCADA Pilot Project	\$ 61,950.00	100.00%	0.00%	\$ -	N/A	N/A	\$ -	N/A	N/A
EE-09-01	Wastewater Pumping Station Electrical Upgrade	\$ -	N/A	N/A	\$ 620,000.00	16.13%	83.87%	\$ 100,000.00	0.00%	100.00%
EE-09-02	Electrical Upgrade - Water Wells	\$ 354,226.63	100.00%	0.00%	\$ 1,500,000.00	100.00%	0.00%	\$ 650,000.00	76.92%	23.08%
EE-09-03	Electrical Upgrade - Water Booster	\$ -	N/A	N/A	\$ 2,000.00	0.00%	100.00%	\$ 323,000.00	0.00%	100.00%
EE-09-04	Electrical Upgrade - Water Booster	\$ -	N/A	N/A	\$ 200,000.00	0.49%	99.51%	\$ -	N/A	N/A
EE-09-05	Electrical Upgrade - Other Water	\$ -	N/A	N/A	\$ 150,000.00	40.47%	59.53%	\$ -	N/A	N/A
EE-09-06	SCADA Improvements - Phase I	\$ 250,000.00	100.00%	0.00%	\$ -	N/A	N/A	\$ -	N/A	N/A
EE-09-07	SCADA Improvements - Phase 2	\$ 1,056,986.00	100.00%	0.00%	\$ -	N/A	N/A	\$ -	N/A	N/A
EE-09-08	SCADA Improvements - Phase 3	\$ 24,955.71	100.00%	0.00%	\$ 923,000.00	99.93%	0.07%	\$ 1,177,000.00	36.76%	63.24%
EE-09-09	SCADA Improvements - Phase 4	\$ -	N/A	N/A	\$ -	N/A	N/A	\$ 6,500,000.00	0.00%	100.00%
		\$ 1,748,118.34			\$ 3,395,000.00			\$ 8,750,000.00		

**Miscellaneous Engineering Support**

CIP #	CIP Description	2010 Bond Allotment	% encumbered	% available	2013 Bond Allotment	% encumbered	% available	2016 Bond Allotment	% encumbered	% available
MC-05-01	Laboratory Modernization	\$ -	N/A	N/A	\$ 1,173,000.00	100.00%	0.00%	\$ 1,127,000.00	100.00%	0.00%
MC-05-02	Land Survey	\$ 500,000.00	99.94%	0.06%	\$ 2,000.00	0.00%	100.00%	\$ 1,998,000.00	63.09%	36.91%
MC-09-01	General Plant Improvements	\$ 7,241,000.00	99.58%	0.42%	\$ 2,600,000.00	99.48%	0.52%	\$ 2,769,460.00	53.31%	46.69%
MC-15-01	Information Technology Intergration Improvements	\$ -			\$ -			\$ 500,000.00	40.70%	59.30%
		\$ 7,741,000.00			\$ 3,775,000.00			\$ 6,394,460.00		

	2010 Bond Allotment	2013 Bond Allotment	2016 Bond Allotment
CIP Water	\$ 41,903,304.66	\$ 58,317,117.00	\$ 64,647,830.00
CIP Wastewater	\$ 36,009,577.00	\$ 73,837,883.00	\$ 60,227,170.00
CIP Electrical	\$ 1,748,118.34	\$ 3,395,000.00	\$ 8,750,000.00
CIP Miscellaneous	\$ 7,741,000.00	\$ 3,775,000.00	\$ 6,394,460.00
	\$ 87,402,000.00	\$ 139,325,000.00	\$ 140,019,460.00

Bond Fund	Construction Fund Amount (\$M)	Estimated # of months fund available for use	Total Funds encumbered to date (\$M)	% of fund used	Rate of Spending: (\$M) per year
2005	\$82.930	82 *	\$82.930	100.00%	12.14
2010	\$87.402	81 **	\$83.354	95.37%	12.35
2013	\$139.325	44 **	\$129.294	92.80%	35.26
2015	\$140.019	14	\$61.728	44.09%	52.91
	* - End date November 2013 via CCU Resolution 06-FY2014				
	** - Includes month of September 2017				

## **B. Projects Procurement**

### Percentage Key:

- |               |  |
|---------------|--|
| 100%          | Approved by GM   |
| 99%           | Signature required from either Accounting/Legal/GM                   |
| 98%           | Processing engineering service or construction contract (with legal) |
| 95%           | Request for CCU approval (GM/engineering)                            |
| 90%           | A/E fee negotiation or contractor bid evaluation (engineering)       |
| 80%           | Selected A/E or Conducted bid opening (engineering)                  |
| 70%           | Advertised RFP/IFB (engineering)                                     |
| 60%           | RFP/IFB Package under legal review                                   |
| 50%           | RFP/IFB Package completed (engineering)                              |
| Less than 50% | Project Scope of work development in progress                        |
- Red text anywhere indicates a change from the last report.

### **BOX KEY FOR PROCUREMENT:**

<b>(Type of Procurement)</b> (Relevant CIP NO. or Funding Source)	<b>(Project Title)</b>	
(Percentage complete for procurement)	<b>Activities/Notes:</b> (see percentage key above)	<b>Consultant</b> (listed when selected)
Project Description	Summary of project description	

<b><u>BID PACKAGE</u></b> PW 09-02	<b>New Well Construction</b>	
<50% Complete	<b>Activities/Notes:</b> GWA engineering continuing discussion with Dept. of Agriculture and lessee on options of acquisition of property for well site at AG-10. Internal GWA discussions underway for survey and appraisal services.	
Project Description:	The project is to construct three new production wells for GWA as well as installation of a water main to connect the new production wells to the Ysengsong Reservoirs.	

<b><u>RFP</u></b> PW 09-02	<b>New Well Construction (Construction Management)</b>	
<50% Complete	<b>Activities/Notes:</b> SOW being developed	
Project Description:	The work performed under this project procurement shall consist of Construction Management and Inspection Services for the construction of up to three (3) new production wells for GWA. GWA plans to increase source water production to improve system redundancy that allows for operating the water production wells more effectively. The overall goal of the Construction Manager (CM) is to manage the entire construction process so that the project can be delivered efficiently and professionally.	

<b><u>RFP</u></b> PW 12-04, PW 12-06 AND PW 09-11	<b>Central Tank Phase I (Chaot #2, Tumon #2, Hyundai) Construction Management</b>	
95% Complete	<b>Activities/Notes:</b> GWA seeking CCU approval of contract in October meeting.	
Project Description:	The work performed under this project procurement shall consist of Construction Management and Inspection Services for the construction of three water reservoirs; 0.5MG Chaot #2, 1MG Tumon #2 (Nissan) and 1MG Hyundai. The overall goal of the Construction Manager (CM) is to manage the entire construction process so that the project can be delivered efficiently and professionally.	

<b><u>BID PACKAGE</u></b> PW 12-04, PW 12-06 AND PW 09-11	<b>Central Tank Phase I (Chaot #2, Tumon #2, Hyundai) Construction</b>	
70% Complete	<b>Activities/Notes:</b> Bid opening rescheduled to October 27th.	
Project Description:	The work performed under this project procurement shall consist of Construction of three water reservoirs; 0.5MG Chaot #2, 1MG Tumon #2 (Nissan) and 1MG Hyundai. Some piping work off site from the reservoir is also required to ensure the reservoirs function optimally.	

<b><u>BID PACKAGE</u></b> PW 14-01	<b>Fire Hydrant Replacement Phase I</b>	
<50% Complete	<b>Activities/Notes:</b> Bid package being prepared.	
Project Description:	The work performed under this project consist of replacing all know dry barrel fire hydrants down to the lateral as well as any defective wet barrel fire hydrant. Where necessary the gate valve for the fire hydrant may also be replaced.	

<b><u>RFP</u></b> WW 09-01	<b>Yigo SPS Flood Protection and Rehabilitation Design</b>	
50% Complete	<b>Activities/Notes:</b> SOW being finalized by engineering. Work to obtain PO to advertise.	
Project Description:	The work performed under this project procurement shall consist of a design services to implement storm water mitigation measures to protect the facility during extreme weather as well as rehabilitate the facility to provide better redundancy and operate efficiently.	



<b>RFP</b> PW 09-11	<b>Northern and Southern Tank Phase I (Santa Rosa, Sinifa, Santa Rita) Construction Management</b>	
90% Complete	<b>Activities/Notes:</b> GWA negotiating scope and fee with highest rank firm.	
Project Description:	The work performed under this project procurement shall consist of Construction Management and Inspection Services for the construction of three water reservoirs; 1MG Santa Rosa, 1MG Sinifa and 1MG Santa Rita. The overall goal of the Construction Manager (CM) is to manage the entire construction process so that the project can be delivered efficiently and professionally.	

**BOX KEY FOR PROJECT:**

<b>(Type of Project)</b> (Relevant CIP NO.)	<b>(Project Title)</b> (Contractor or consultant)	<b>Start Date:</b> (month and year)
(Percentage complete for project)	<b>Activities/Notes:</b> (brief description of activity)	<b>Completion Date:</b> (month and year)
(Court Order Paragraph No.)	(Project type)	
Project Description	Project Description Narrative	

**C. CIP Water Section**

<b>INSPECTION</b> CIP PW 05-02	<b>Inspection &amp; Maintenance Repairs to GWA Island-Wide Steel Water Tank Reservoirs Phase 2 (DCA)</b>	<b>Start Date:</b> April 2010
80% Complete	<b>Activities/Notes:</b> Still waiting for Quotes for tank bypass/take down for Umatac #1 and Pigua. Supplier for Agat/Umatac tank by-pass ordered and installed wrong controller, sill requires contractor to rectify. Testing occurred for Malojloj tank take down, Ops to shut valve, another by-pass is needed. Working on plan for Kaiser, Windward and Agat #1 take down.	<b>Completion Date:</b> Anticipate December 2021
CO 38C	Engineering inspection services	
Project Description:	The Court Order requires GWA to inspect all active and in some cases inactive water reservoirs. The inspection results will allow GWA to determine if a reservoir requires repair or replacement.	

<b>DESIGN</b> CIP PW 05-12	<b>Brigade II BPS Upgrade (EM Chen)</b>	<b>Start Date:</b> April 2012
100% complete (Basis of Design) 0% (Design)	<b>Activities/Notes:</b> GWA still awaiting conveyance deed from escrow company. Design not started until property fully acquired.	<b>Completion Date:</b> Due to property acquisition issues GWA anticipate February 2018
N/A	Engineering design services	
Project Description:	The design project is intended to assess system water supply feed from the north as well as Ugum WTP and the water demands downstream from the Brigade BPS so as to reconfigure the piping into the BPS and resize the pumps to meet system head requirements.	

<b>DESIGN / BUILD</b> CIP PW 12-04	<b>Reservoirs 2005 Improvements, Chaot &amp; Agana Heights Reservoirs (GSI Construction)</b>	<b>Start Date:</b> April 2013
99% Complete	<b>Activities/Notes:</b> Warranty work complete at both reservoirs. Remaining work is deep well flow meter replacement.	<b>Completion Date:</b> Due to delays from contractor new anticipate completion is

		September 2017
CO 38B	Design/Construction services	
Project Description:	The project is to replace the existing 1.0MG steel reservoirs with 0.5MG concrete tanks at the Chaot and Agana Heights reservoir locations. The contractor shall also link certain A-series wells to the reservoir via SCADA.	

<b>DESIGN</b> CIP PW 12-05	<b>Yigo and Astumbo 2MG Tank Design Project (Lyons)</b>	<b>Start Date:</b> September 2013
99% complete	<b>Activities/Notes:</b> Design firm to provide RFI support during the construction.	<b>Completion Date:</b> January 2016
CO 9 (b)(4)	Engineering design services	
Project Description:	Develop the construction documents for two (2) 2.0 million-gallon (MG) nominal capacity concrete reservoirs in the Yigo service zones and one (1) 2.0 MG reservoir in the Astumbo service area. The design services will consist of preparation of plans, specifications, and estimates (PS&E), including Basis of Design, design calculations, construction schedule, topographical survey, property mapping, geotechnical engineering, cultural resource inventory and evaluation of historic resources, hazardous materials survey, construction documents, design drawings in Auto CAD (latest version), and relevant permits. Other services will include construction bid support service, meetings, and response to request for interpretation/information during construction. The consultant is required to incorporate and modify existing GWA concrete reservoir specifications to meet the project objective.	

<b>DESIGN</b> PW 09-11	<b>Northern and Southern Guam Reservoir Design (TG Engineers)</b>	<b>Start Date:</b> May 2015
60% Complete	<b>Activities/Notes:</b> Santa Rosa – 100% design in hand. Santa Rita – 100% design in hand. Inarajan – Land procurement second site related to new BPS's still on-going. Sinifa – 100% design in hand. Ugum – GWA still in discussion with re-evaluation and discussion with property owner of alternative property on-going.	<b>Completion Date:</b> Update: Due to property acquisitions issues for Piti and Tumon #1, design completion 6 months after property issue resolved.
CO 29 (b)(4)	Engineering design services	
Project Description:	The design services will consist of preparation of plans, specifications, and estimates (PS&E), which includes Basis of Design, design calculations, hydraulic modeling (EPANET), computational fluid dynamic modeling (CFD), construction schedule, topographical survey, property research, property mapping, geotechnical engineering, cultural resource inventory and evaluation of historic resources, hazardous materials survey, construction documents, design drawings in Auto CAD, relevant permit, construction bid support service, and response to request for interpretation/information during construction. The tank locations are Ugum, Santa Rita, Santa Rosa, Inarajan and Sinifa.	

<b>DESIGN</b> PW 12-04	<b>Central Guam Reservoirs Design (GHD Inc.)</b>	<b>Start Date:</b> May 2015
65% Complete	<b>Activities/Notes:</b> Chaot #2 – Bid rescheduled 10/20/17. Tumon #2 – Bid rescheduled 10/20/17. Hyundai - Bid rescheduled 10/20/17. Piti – GWA still evaluating alternative solutions to storage needs in Piti area. Manenggon – Geotech work complete. 60% design near complete. Tumon #1 – GWA working on land issues.	<b>Completion Date:</b> Update: Due to property acquisitions issues for Piti and Tumon #1, design completion 6 months after property issue resolved.
CO 29 (b)(4)	Engineering design services	
Project Description:	The design services will consist of preparation of plans, specifications, and estimates (PS&E), which includes Basis of Design, design calculations, hydraulic modeling (EPANET), computational fluid dynamic modeling (CFD), construction schedule, topographical survey, property research, property mapping, geotechnical engineering, cultural resource inventory and evaluation of historic resources, hazardous materials survey, construction documents, design drawings in Auto CAD, relevant permit, construction bid support service, and response to request for interpretation/information during construction The tank locations are Hyundai, Pulantat, Chaot #2, Tumon #2, Piti and Tumon #1.	

<b>CONSTRUCTION</b> PW 09-03	<b>Line Replacement Phase IV (Giant Construction)</b>	<b>Start Date:</b> 02/14/16
60% Complete	<b>Activities/Notes:</b> Contractor working in Santa Rita (Santa Rosa Subd.) and still working on ROW/easement issue along Famha Rd. Making reconnections/finalizing in Agafa Gumas, Chalan Agoan and Perez Gardens, Machanao.	<b>Completion Date:</b> 02/06/18
	Construction Services	
Project Description:	The project is intended for a contractor to replace existing water lines that have been found by operations to be leaking and/or are causing service delivery to less than what GWA is required to provide. The project will replace water mains and ten known locations throughout the island and there is a component within the bid where line replacement work for unknown locations is accounted for.	

<b>DESIGN</b> PW 05-15	<b>Asan Spring Rehabilitation Design (HDR)</b>	<b>Start Date:</b> August 24, 2016
10% Complete	<b>Activities/Notes:</b> GWA receive approval from Parks Service start design field investigation work.	<b>Completion Date:</b> Due to delays from the Park Services related to property access the anticipated completion of the design is February 2018.
	Engineering design services	
Project Description:	- Perform site visits and condition assessment for site conditions to	

	<p>determine demolition and rehabilitation requirement, process equipment condition, structural condition, and electrical system. Site condition assessment shall include all disciplines to execute the project.</p> <ul style="list-style-type: none"> <li>- Review and validate the current property boundary information to confirm the available space for the project development.</li> <li>- Perform an environmental impact study and prepare all required permits as needed.</li> <li>- Perform an archeological and historical resources study to identify potential impact to the project, prepare all required permits as needed.</li> <li>- Coordinate with Guam Historic Resources Division State Historic Preservation Office (SHPO) on historical resources study. Prepare all necessary reports and documents as required by SHPO.</li> <li>- Coordinate with Guam Department of Agriculture, Division of Aquatic and Wildlife Resources (DAWR) on vegetation clearance. Prepare all necessary reports and documents required by DAWR.</li> <li>- Identify the existing and projected service area, period of design.</li> <li>- Identify and recommend conceptual water treatment system.</li> <li>- Perform a Class 4 engineering cost estimate according to the American Association of Cost Engineers (AACE) International Cost Estimate Classification System for construction fee. Cost must include all disciplines, permit, construction and administration that are necessary to execute the project. All costs will be in current dollars and escalated to the estimated midpoint of construction.</li> </ul>
--	--

<b><u>CONSTRUCTION</u></b> PW 09-11, PW 12-05	<b>Yigo/Astumbo Tank Construction (Pernix)</b>	<b>Start Date:</b> 12/1/16
40% Complete	<b>Activities/Notes:</b> Yigo #1 core wall #1 through #6 complete. Yigo #2 preparing main foundation. Austombo #1 preparing main foundation.	<b>Completion Date:</b> 02/06/18
	Construction Services	
Project Description:	This project will involve construction of two (2) 2MG concrete tanks and Booster Pump Station at the Yigo site and a one (1) 2MG concrete tank at the Astumbo site. Work will involve new pipe line, valves, electrical controls, pumps and motors, site drainage, paving, generator for the BPS, SCADA, etc.	

<b><u>CONSTRUCTION MANAGEMENT</u></b> PW 09-11, PW 12-05	<b>Yigo/Astumbo Tank Construction Management (GHD)</b>	<b>Start Date:</b> December 2016
35% complete	<b>Activities/Notes:</b> Processing submittals and on-site inspection	<b>Completion Date:</b> February 2018
N/A	Construction Management services	
Project Description:	The work performed under this project procurement shall consist of Construction Management and Inspection Services for the demolition of existing steel elevate and ground tanks as well as the construction of the 2MG concrete tanks at the Yigo tank location and Astumbo tank location. The overall goal of the Construction Manager (CM) is to manage the entire construction process so that the project can be	

	delivered efficiently and professionally.
--	---

**D. CIP Wastewater Section**

<b>DESIGN</b> WW 11-08	<b>Agat-Santa Rita WWTP Replacement (DCA)</b>	<b>Start Date:</b> October 2014
99% Complete	<b>Activities/Notes:</b> Design complete. Services during construction on-going through Nov 2017. <b>GWA working on contract amendment to extend services until construction completion.</b>	<b>Completion Date:</b> Nov. 2015 (design); April 2017 (construction)
CO 11	Engineering design services	
Project Description:	The engineering design consultant is required to design a new wastewater treatment facility that will meet secondary treatment limits. The new facilities will incorporate provisions for redundancy to improve reliability and facilitate operations and maintenance activities at the existing facility	

<b>INSPECTION</b> 2010 BOND WW 12-05 2010 BOND WW 05-04 2013 BOND WW 05-04	<b>SSES Central Sewer System (HDR)</b>	<b>Start Date:</b> November 2014
98% Complete	<b>Activities/Notes:</b> Draft final report submitted. GWA final review on-going.	<b>Completion Date:</b> Anticipate June 2017
CO 8 (c)	Engineering Inspection Services	
Project Description:	Work specifically required includes data analysis, development of hydraulic modeling, and development of an SSES fieldwork plan, manhole inspections, smoke testing, CCTV inspection and preparation of a Project Report.	

<b>CONSTRUCTION MANAGEMENT</b> WW 11-08	<b>Agat Santa Rita WWTP CM (GHD)</b>	<b>Start Date:</b> November 2014
100% (PH 1) 100% Complete (PH 2, Part 1) <b>52% Complete (PH 2, Part 2)</b>	<b>Activities/Notes:</b> Typical CM inspections on-going.	<b>Completion Date:</b> December 2017
CO 11	Construction Management services	
Project Description:	The work performed under this project procurement shall consist of Construction Management and Inspection Services for the construction of the Agat Santa Rita WWTP Phase II project. GWA plans to replace the existing wastewater treatment plant for a new plant that can meet permit limits. The overall goal of the Construction Manager (CM) is to manage the entire construction process so that the project can be delivered efficiently and professionally.	

<b>CONSTRUCTION</b> WW 11-08	<b>Agat Santa Rita WWTP Phase II (Sumitomo Construction)</b>	<b>Start Date:</b> January 2016
Part 1 of Phase II- 100% Complete Part 2 of Phase II- 52% complete	<b>Activities/Notes:</b> Due to heavy rains in September/October work slow. Contractor still working on second ditch, second clarifier, off site water line, headworks, UV building, aerobic digester tank and equalization basin.	<b>Completion Date:</b> Phase A: 12/31/16 Phase B: 12/31/17
CO 11	Construction services	
Project Description:	This project includes construction of the head works, clarifier, oxidation ditches and UV disinfection and administration facilities. Rehabilitation work at the existing WWTP will also occur to ensure the wastewater can be pumped to the new plant. The new plant will also tie into the Tipalao SPS.	

<b>DESIGN</b> WW 09-08, WW11-03	<b>Baza Gardens Cross Island Sewer Design (DCA)</b>	<b>Start Date:</b> 02/05/16
100% Phase I 100% Phase II 100% Phase III	<b>Activities/Notes:</b> DCA providing engineering design services during construction.	<b>Completion Date:</b> 12/31/16
CO 11	Engineering design services	
Project Description:	The intent of this project for an engineering firm to prepare design drawings and specification for a sewer conveyance from the Baza Garden WWTP to the new Agat Santa-Rite WWTP. The design will take into account growth in the Baza Gardens/Talofofo areas as wells as new connection along the Route 17 route.	

<b>DESIGN</b> WW 11-04	<b>Toguan River Sample Collection for Umatac WWTP (EA Engineering and Science)</b>	<b>Start Date:</b> 03/16/16
99% Complete	<b>Activities/Notes:</b> GWA still awaiting comments expected from USEPA and GEPA.	<b>Completion Date:</b> Anticipate completion 09/30/17
	Engineering services	
Project Description:	The scientific/engineering firm will perform surface water sampling, wastewater treatment plant discharge monitoring and site observation at Toguan River and Umatac-Merizo Wastewater Treatment Plant (UMWWTP). The goal of this sampling and monitoring effort is to better understand the characteristics of the effluent and the receiving water, which will be used to determine the necessary plant upgrades	

<b>DESIGN</b> WW 09-06	<b>Bayside SPS Improvements Design (EMPSCO)</b>	<b>Start Date:</b> July 29, 2016
99% Complete	<b>Activities/Notes:</b> Design consultant continuing to work on Army Corp of Engineers permit. GWA received 100% design and under review.	<b>Completion Date:</b> Due to issue with ACOE anticipate October 2017 for design only.
	Engineering design services	
Project Description:	The intent of this project for an engineering firm to prepare design	



	drawings and specification to upgrade the Bayside Sewer Pump Station given the facility is in major disrepair and the adjacent river is eroding away the access road to the facility which is causing maintenance challenges.
--	---

<b>CONSTRUCTION</b> WW 09-08, WW 11-03	<b>Baza Gardens Cross Island Road Sewer Conveyance Construction Phase I (BME and Sons)</b>	<b>Start Date:</b> October 2016
18% Complete	<b>Activities/Notes:</b> Excavation for wet wall complete, flowable fill concrete poured for base. Continue force main installation along Route 17 and Route 5. continue manhole and gravity line installation along Route 17.	<b>Completion Date:</b> Phase I: 03/01/18
	Construction services	
Project Description:	The work performed under this project consist of construction of 14,714' of gravity main, 2,767' of force main and sewer pump station #3 next to the Aplacho River in Santa Rita.	

<b>CONSTRUCTION MANAGEMENT</b> WW 09-08 WW 11-03	<b>Baza Gardens Cross Island Road Sewer Conveyance (Construction Management) (SSFM)</b>	<b>Start Date:</b> December 5, 2016
18% (PH 1) 25% (PH 2) 5% (PH 3)	<b>Activities/Notes:</b> Field inspection, project coordination and invoice review on-gong.	<b>Completion Date:</b> April 2018
	Construction Management services	
Project Description:	The work performed under this project shall consist of Construction Management and Inspection Services for the construction of gravity main, force mains and sewer pump station as well as an equalization basin at the Baza Garden WWTP.	

<b>CONSTRUCTION</b> WW 09-08, WW 11-03	<b>Baza Gardens Cross Island Road Sewer Conveyance Construction Phase II (BME and Sons)</b>	<b>Start Date:</b> March 2017
25% Complete	<b>Activities/Notes:</b> Excavating wet well at new SPS. Continue force main installation along Route 17.	<b>Completion Date:</b> Phase II: 03/16/18
	Construction services	
Project Description:	The work performed under this project consist of construction of 1,767' of gravity main, 14,400' of force mains and sewer pump station #2 along Route 17.	

<b>CONSTRUCTION</b> WW 09-08, WW 11-03	<b>Baza Gardens Cross Island Road Sewer Conveyance Construction Phase III (Sumitomo Construction)</b>	<b>Start Date:</b> June 2017
5% Complete	<b>Activities/Notes:</b> Construction permit still with DPW.	<b>Completion Date:</b> Phase III: 03/16/18
	Construction services	

Project Description:	The work performed under this project consist of construction of, but not limited to, 10,481' of force mains and sewer pump station at existing WWTP, equalization tanks, stand-by generator, improved headworks, grit removal system, and associated equipment.
----------------------	--

<b>CONSTRUCTION</b> WW 11-04	<b>Umatac Merizo WWTP Design Build Improvements Project (CoreTech)</b>	<b>Start Date:</b> June 2017
5% Complete	<b>Activities/Notes:</b> Initial design work on-going. Coordination with operation for field survey on-going.	<b>Completion Date:</b> December 31, 2018
	Construction services	
Project Description:	The project is intended to improve the aeration basin, construct a new sewer pump station, regrade the overland field, construct a new effluent storage tank and disinfection facility. The overland percolation basin will undergo regarding work to ensure appropriate distribution of effluent through the whole basin.	

<b>CONSTRUCTION MANAGEMENT</b> WW 11-04	<b>Umatac Merizo WWTP Design Build Improvements Project (SSFM Inc)</b>	<b>Start Date:</b> September 7, 2017
5%	<b>Activities/Notes:</b> Establishing communication links with project management team and contractor.	<b>Completion Date:</b> December 31, 2018
	Construction Management services	
Project Description:	The work performed under this project procurement shall consist of Construction Management and Inspection Services for the improvements works at the aeration basin, new sewer pump station, overland field improvements, effluent storage tank. The overall goal of the Construction Manager (CM) is to manage the entire construction process so that the project can be delivered efficiently and professionally.	

<b>DESIGN</b> OEA GRANT	<b>Design Services for the Upgrade of the Northern District WWTP (DCA)</b>	<b>Start Date:</b> August 8, 2017
5% Complete	<b>Activities/Notes:</b> Preliminary survey work on-going.	<b>Completion Date:</b> December 2018.
	Engineering design services	
Project Description:	The work performed under this project procurement shall consist of engineering design services for the conversion of the existing WWTP to secondary treatment. The design will require the existing plant to stay operational and the designer will use the new 17 acres GWA acquired to place new headworks, oxidation ditches and UV disinfection systems.	

## **E. CIP Engineering Support**

<b>DESIGN</b> EE 09-08	<b>SCADA System for Water and Wastewater Facilities Phase A-1 (AECOM)</b>	<b>Start Date:</b> June 2015
99% complete	<b>Activities/Notes:</b> IFB package being prepared for advertising	<b>Completion Date:</b> Anticipate March

	early November.	2017 January 2019 (Bid and Construction Support)
N/A	Engineering design services	
Project Description:	The A/E firm will design an integrated, robust and secure Supervisory Control and Data Acquisition (SCADA) system for GWA's water and wastewater systems, and to provide support services during bid and construction. The 22 sites will consist of a combination of water facilities such as production wells, reservoirs, booster pump station and wastewater sites include sewer treatment plants and sewer pump stations. Executed by approved change orders, number of sites in original design scope has changed from 22 sites to 19 sites and design of High Water Alarm for 20 critical sewer pump stations has been added. Scope also includes bid and construction support of the design-build project of GPWA SCADA EMS project.	

<b>DESIGN</b> MC 05-01	<b>New GWA Lab Design Project (Laguana Architects)</b>	<b>Start Date:</b> June 2015
100% complete	<b>Activities/Notes:</b> Design complete however services continue into construction phase.	<b>Completion Date:</b> February 2016
N/A	Engineering design services	
Project Description:	The design firm is required to review all laboratory activities GWA's lab staff conduct for water and wastewater analysis after which they are to develop design drawing and specification to be bid out for construction. The design firm shall also take into account power and water needs to ensure the facility is self-sufficient.	

<b>CONSTRUCTION</b> MC 05-01	<b>New GWA Lab Construction (Mega United Construction)</b>	<b>Start Date:</b> NTP issued August 18, 2016
95% Complete	<b>Activities/Notes:</b> GWA working on Change Order to extend completion date to November 25 due to rain delays and issues with H2B workers leaving.	<b>Completion Date:</b> Change Order moved complete to November 2017
	Construction services	
Project Description:	The project will involve construction of a new building at the GWA Upper Tumon compound to house the laboratory section. The facility will include office, laboratory and storage space for the lab employees. The facility will also include a back-up generator.	

## **F. GIS Section**

<b>MAPPING</b> MC 05-02	<b>Island Wide Survey- (Duenas, Camacho &amp; Ass.)</b>	<b>Start Date:</b> December 2007
91% complete	<b>Activities/Notes:</b> Surveyor near complete with Task #12 which involves DW M-08. Task #13 was developed to address the registration maps for Barrigada tanks. Task #14 encumber complete contract value with goal to complete all work and	<b>Completion Date:</b> New anticipated complete is December 2017

	spending by December 2017.	
	Survey services	
Project Description:	The contracted land surveyor is required to conduct title research, property valuation and mapping of property boundaries where GWA facilities are located but the lot is not registered under GWA's name.	
<b>MAPPING</b> MC 05-02	<b>Island Wide Survey PH II - (Duenas, Camacho &amp; Ass.)</b>	<b>Start Date:</b> August 30, 2017
5% complete	<b>Activities/Notes:</b> Marbo Wells area survey mapping complete. Surveyor working on first set of property to prepair property maps for parceling.	<b>Completion Date:</b> December 2018
	Survey services	
Project Description:	The work performed under this project procurement shall consist of a professional land surveyor conducting field work to mark corners of existing government properties as a means of severing out portions of the larger property to be deeded to GWA. Surveyor shall also prepare all necessary maps and documents for recording at DLM	

## G. Permits Section

### PERMITS MONTHLY REPORT 2017

	2017								
Description	Jan	Feb	Mar	Apr	May	June/July	Aug	Sept	Oct
Building Permit	27	11	13	17	23	27	27	27	12
Occupancy Permit	64	10	17	5	25	28	28	30	13
New Installation	11	5	10	15	15	33	33	25	17
Sewer Application	10	5	4	3	4	3	3	7	5
Sewer Inspection	6	0	1	0	1	0	0	1	1
Private Utility Acceptance	0	0	0	0	0	0	0	0	0
Relocation of Water Meter	1	0	1	0	0	0	0	0	0
Tapping-Water	4	2	2	0	3	8	8	0	0
Tapping-Sewer	3	2	2	1	3	5	5	0	0
Clearance-Water	15	13	15	2	20	26	26	11	1
Clearance-Sewer	15	13	15	2	20	26	26	11	0
Highway Encroachment	59	3	27	6	20	12	12	25	4
Verification of Utilities	12	15	2	5	1	8	8	7	0
Fire Flow Test	1	0	0	0	0	3	3	1	3
Schedule Water Outage	1	0	0	0	0	0	0	0	0

## **H. SRF Project Status Report**

- Projects listed below that are noted to be in the procurement phase will follow the “Percentage Key” below.

Percentage Key:

100%	Approved by GM
99%	Signature required from either Accounting/Legal/GM
98%	Processing engineering service or construction contract (with legal)
95%	Request for CCU approval (GM/engineering)
90%	A/E fee negotiation or contractor bid evaluation (engineering)
80%	Selected A/E or Conducted bid opening (engineering)
70%	Advertised RFP/IFB (engineering)
60%	RFP/IFB Package under legal review
50%	RFP/IFB Package completed (engineering)
Less than 50%	Project Scope of work development in progress

- Red text anywhere indicates a change from the last report.
- Cells highlighted in green  indicate contract amount certified and project active.

GWA October 17, 2017 Work Session - DIVISION REPORTS

Project	Project Description	Project Manager	Grant Expiration Date	Phase		Start Date (NTP Issued)	Anticipated Completion Date	Contract Amount (+) change orders	Contractor	Status as of 10/16/17	
Grant Number M96902611-5											
1	Northern District SSES & I/I Study	Sanitary sewer system evaluation study (SSES) and inflow and infiltration (I/I) study designed to evaluate high I/I areas within the Northern sewer basin with the goal of identifying projects to eliminate them.	J. Davis	9/30/2017	Design	1	10/10/2014	2/29/2016	\$ 792,980	Stanley	100% Complete.
					Construction				The project does not involve construction.		
					Const. Mgmt						
2	Southern SSES Rehabilitation (Agat-Santa Rita-Umatac-Merizo)	Rehabilitation of segments of sewer lines in Umatac, Merizo, Agat, and Santa Rita where the Sanitary Sewer Evaluation Study recommends rehabilitation.	Brown & Caldwell	9/30/2017	Design				The design was previously completed under bond funding.		
					Construction	1	10/30/2015	2/28/2017	\$ 1,395,471	Reliable Builders	<ul style="list-style-type: none"><li>CIPP quality issues found during April 2017 GWA warranty period CCTV inspection.</li><li>On 8/28, issued contractor letter from GM requiring completion of CIPP repairs by 10/31.</li><li>Need to determine who will provide inspection services during the work.</li><li>BC met with RBI on 9/29. RBI agreed to final CCTV requirement and is scheduling Todo Mauleg to do the work.</li></ul>
					Const. Mgmt	1	11/10/2015	3/30/2017	\$ 211,722	TG Engineers	<ul style="list-style-type: none"><li>Awaiting CM release of claims and final invoice to close the CM contract.</li></ul>
3A	Asan-Adelup-Hagatna RT1 Sewer Line Rehabilitation and Replacement	Rehabilitation of sewer lines from the War in the Pacific Asan Park to the Governor's Complex in Adelup. This line is asbestos concrete that is dilapidated and some areas have disintegrated crowns.	Brown & Caldwell	9/30/2017	Design	2	12/11/2015	3/30/2017 for Design requirements	\$ 1,702,903	HDR	<ul style="list-style-type: none"><li>HDR submitted rebid docs to B&amp;C. See Project 3B below.</li></ul>
4A	RT2 Agat War in the Pacific Sewer Line Rehabilitation and Replacement	Rehabilitation of a large segment of sewer line fronting the War in the Pacific Park in Agat that has collapsed.	Brown & Caldwell	9/30/2017	Design	3	11/17/2015	3/30/2017 for Design requirements	\$ 316,681	SSFM	SSFM providing services during bidding process as well as construction phase.
5	Brown & Caldwell Project Management	Brown & Caldwell to provide program management services and support.	T. Cruz	9/30/2017	Design	4	3/24/2015	2/28/2019	\$ 1,089,850	B&C	Project underway.
					Construction				The project does not involve construction.		
					Const. Mgmt						
6	Wastewater, Water and Source Water System Master Plan Upgrade	Update of the existing water and wastewater master plan while factoring in military integration and secondary treatment plant options.	Brown & Caldwell	9/30/2017	Design	5	7/6/2015	11/30/2017 (revised due to financial workshop)	\$ 2,623,300	B&C	<ul style="list-style-type: none"><li>Working on Financial plan revisions based on workshop input.</li><li>Updating all volumes to incorporate review comments.</li></ul>
					Construction				The project does not involve construction.		
					Const. Mgmt						

GWA October 17, 2017 Work Session - DIVISION REPORTS

7A	Groundwater Wells Rehabilitation (F-3, A-2, A-7, A-12, D-5)	Rehabilitation of existing deep wells and/or in cases where pipe column needs replacing, wells will be re-drilled. The deep wells to be rehabilitated are A-2, A-7, A-12, D-5, & F-3.	Brown & Caldwell	9/30/2017	Design	6	5/27/2016	10/31/2017 (for design only)	\$ 1,758,247	AECOM	<ul style="list-style-type: none"><li>Latest schedule shows 100% design submittal on 10/27.</li><li>A-2: Design rate of 250 gpm (34.6 ft drawdown). Proceeding toward 100% design.</li><li>A-12: Design rate of 200 gpm (45.5 ft drawdown). Proceeding toward 100% design. Bobbie C. working on property procurement.</li><li>A-7: CO #4: BC/GWA directed AECOM to remove 100% design work from scope for A-7.</li><li>D-5: Design rate of 125 gpm (39 feet drawdown). Proceeding toward 100% design.</li><li>F-3: Driller completed drilling, pump testing complete. APDI noted 200 gpm - but waiting on final testing report.</li></ul>
8A	Tumon Sewer Hot Spots	Investigation, evaluation, and repair of possible solutions, to long plaguing issues where sewer overflows are known to occur in Tumon San Vitores.	Brown & Caldwell	9/30/2017	Design	7	6/24/2016	10/30/2017 for design only	\$ 572,089	TG Engineers	<ul style="list-style-type: none"><li>TGE 100% design scheduled for October 31.</li><li>TGE reviewing comments and working on final plans/specs.</li></ul>
9	Critical Sewer Pump Stations (7 stations)	Rehabilitation of various components of 7 pump stations that were identified to by the CDM design team: Macheche, Ypaopao, Astumbo 1, Fujita, Santa Ana, Southern Link, and Route 1.	CDM	9/30/2017	Design				The design will be incorporated into the design/build package.		
			J. Davis		Design/Build	1	8/8/2016	12/30/2017	\$ 1,505,760	ProPacifc	Contractor experienced delays in deleivery of equipment. GWA working on Proposaed Change order with contractor to extend completion date and additional work.
					Const. Mgmt	2	9/9/2016	12/30/2017	\$ 299,519.00	Stanley	CM work ongoing. GWA working on Change Order proposal to extend contract to match contruction activities.
10	Sewer Pump Station High Water Alarm Systems (20 stations)	This project will design and installed telemetry equipment/SCADA type alarms that will alert when pump station failure occurs.	C. Yam	9/30/2017	Design				The design will be incorporated into the design/build package.		
					Design	8	8/12/2016	02/30/2017	\$ 183,171	AECOM	Design complete
					Construction	5	4/5/2017	9/30/2017	\$ 1,444,888	Pacific Rim	Major installation work is completed. GPA continues to work on providing Network Connectivity to each site. Testing and Commissioning is on-going.
					Const. Mgmt	3	02/30/2017	9/30/2017	\$ 145,186	EMSPCO	CM working with contractor on submittals.
11	Sewer Pump Station Backup Power (2 stations)	Construction of the housing and installation of new generators for the Casimero pump station (Mongmong) and the Namo pump station (Yona central).	B. Cruz	9/30/2017	Design				The design will be incorporated into the design/build package.		
					Design/Build	2	6/24/2016	9/30/2017	\$ 362,693	ProPacifc	Substantial completion letter submitted to contractor. Punch list items on-going.
					Const. Mgmt				B. Cruz is the construction manager.		

GWA October 17, 2017 Work Session - DIVISION REPORTS

12A	RT4 Relief Sewer Line Rehabilitation and Replacement	Rehabilitation of sewer lines that are located from Agana McDonalds to Marine Drive that have been known to overflow due to structural issues.	Brown & Caldwell	9/30/2017	Design	9	3/1/2016	4/22/2017	\$ 794,000	AECOM	AECOM to provided services during bidding process.
13	Groundwater Wells Rehabilitation (D-3, D-17, D-18, D-22, M-9)	Rehabilitation of existing deep wells and/or in cases where pipe column needs replacing will be re-drilled. D-3, D-17, D-18, D-22, and M-9.	Brown & Caldwell	9/30/2017	Design				The design was previously completed under bond funding.		
					Construction	2	8/19/2016	10/31/2017	\$ 6,149,647	Pacific Rim	<ul style="list-style-type: none"> <li>Electrical issue with GPA inspection. Kurt met with GPA Oct 6 to discuss the way forward. GPA can get us power, but need permit submittal first. Was planned for submittal 10/12</li> <li>D-03 316 SS Tapping Sleeve due next week required to complete tie in to system.</li> <li>Issues discovered by Brett of contractor using duct tape on wells. Contractor began removing this week.</li> <li>General construction nearing completion. Pump test at D-17/22 completed, and D-03 underway.</li> </ul>
					Const. Mgmt	4	3/22/2016	10/31/2017	\$ 798,503	EA	CO#3 for CM under review (~\$155K); Returned to EA for revisions. Will need to go up to CCU for approval.
14	Southern SSES Sewer Rehabilitation (Baza Gardens-Talofofo)	Rehabilitation of segments of sewer lines in Windward Hills, Talofofo area where the Sanitary Sewer Evaluation Study recommends rehabilitation.	Brown & Caldwell	9/30/2017	Design				The design was previously completed under bond funding.		
					Construction	3	8/2/2016	7/2/2017	\$ 1,189,815	ProPacific	<ul style="list-style-type: none"> <li>Contractor submitted letter requesting to continue CIPP work with Todo Mauleg has the authorized CIPP subcontractor.</li> <li>GWA response allowed PPBC to work until 10/27, or be terminated for default.</li> <li>Santa Rita Wetland area (drawing AG-101):</li> <li>PPBC continually bypass pumping through the wetland area, due to collapse of CIPP liner.</li> <li>Liner removal work ongoing. Contractor awaiting CIPP liner materials.</li> <li>Baza Gardens area: Contractor conducting lateral repairs.</li> </ul>
					Const. Mgmt	5	7/29/2016	5/28/2017	\$ 289,096	EMPSCO	CM CO #3: With GWA Finance. Provides CM additional funds due to continued contractor delays.
15A	Tamuning Sewer Hot Spots	Sewer rehabilitation for lines at Winner Apartments, Segund Leon Guerrero, and behind Guam Premium Outlets.	Brown & Caldwell	9/30/2017	Design	10	9/9/2016	10/31/2017 (for design only)	\$ 663,629	TG Engineers	<ul style="list-style-type: none"> <li>TGE submitted draft letter on land issues for New Plaza Market; submitted to GWA on 8/30. Bobbie Cruz waiting for concurrence to send to property owner.</li> <li>TGE 100% design scheduled for October 31.</li> <li>TGE reviewing comments and working on final plans/specs.</li> </ul>



GWA October 17, 2017 Work Session - DIVISION REPORTS

16A	Talofofo Sewer Pump Stations (4 stations)	Design and construction of 4 sewer lift stations in the Talofofo village where sewer lines are installed but never completed.	J. Davis	9/30/2017	Design (for Talofofo and Chalan Pago PS)	11	8/17/2016	11/30/2017	\$ 478,000	EMPSCO	GWA received 100% design for Talafofo for review and comment. GWA still waiting for Chalan Pago 100%.
17A	Chalan Pago Sewer Pump Station	Design and construction of sewer lift stations and gravity lines in Scott Laguana, Santa Cruz Street Chalan Pago.	J. Davis	9/30/2017	Design		8/17/2016	11/30/2017	The design will be included with the Talofofo Pump Station design project.		
18A	Water Hydraulic Model (SCADA ready instruments to update Model)	Design and construction of instrumentation at key water sites in the Barrigada service area necessary to update GWA Water hydraulic model.	Barbara Cruz	9/30/2017	Design	12	8/3/2016	3/15/2017	\$ 491,498	GHD	100% design under review.
19	Macheche Hill Sewer Rehabilitation/ Replacement	Rehabilitation of sewer lines on Macheche road. Segments of this sewer line has collapsed recently and is consider a high priority.	J. Davis	9/30/2017	Design-Build	3	8/29/2016	12/31/2017	\$ 1,634,000	Giant Const.	Installation of manholes and gravity line on-going. 840lf of 1,986lf installed. Contractor working to connect new force main.
					Const. Mgmt	6	9/16/2016	12/31/2017	\$ 245,150	Am Orient	CM working with contractor on submittals.
20	Asan-Adelup-Hagatna Rt. 1 Sewer Line Rehabilitation and Replacement Emergency Repairs	Rehabilitation of sewer line in Asan that collapsed and which is current fitted with a temporary pumping system.	Brown & Caldwell	9/30/2017	Design						Design cost covered under 3A above.
					Construction	4	3/8/2017	5/31/2017	\$ 2,470,658		<ul style="list-style-type: none"><li>CO#2 approved 9/19.</li><li>Phase I:<ul style="list-style-type: none"><li>\$ Work on 222' section on going; completed ~100 LF and backfilled.</li><li>\$ 40-60 LF open trenched with pipe being installed.</li><li>\$ Currently scheduled to have all pipe in the ground by end of October, but backfill and asphalt could go into second week of November.</li><li>\$ Contractor indicating may ask for extension.</li></ul></li><li>Phase II:<ul style="list-style-type: none"><li>\$ Downstream pipe of new MH installed and backfilled.</li><li>\$ New MH in process; PRC looking for approved coating.</li><li>\$ Upstream pipe mostly installed, except beside valve box.</li></ul></li></ul>
					Const. Mgmt	7	1/24/2017	5/31/2017	covered under 3A		<ul style="list-style-type: none"><li>CO#3 (for HDR CM) submitted to GWA 10/5; HDR currently beyond time and short on budget until CO processed.</li></ul>
Grant Number M96902615-1											
3B	Asan-Adelup-Hagatna RT1 Sewer Line Rehabilitation and Replacement	Rehabilitation of sewer lines from the War in the Pacific Asan Park to the Governor's Complex in Adelup. This line is asbestos concrete that is dilapidated and some areas have disintegrated crowns.	Brown & Caldwell	9/30/2021	Construction		10/16/2016	4/30/2018			Procurement 70%. GWA received flash drives with rebid docs on 10/12 from B&C; legal reviewing EJCDC.
					Const. Mgmt		6/30/2017	12/30/2018			Procurement 90%. CM scope and fee proposal received 6/23 (\$698K); due to canceling of bid GWA will repackaging bid therefore scope and fee will need to be refined.
4B	RT2 Agat War in the Pacific Sewer Line Rehabilitation and Replacement	Rehabilitation of a large segment of sewer line fronting the War in the Pacific Park in Agat that has collapsed.	Brown & Caldwell	9/30/2021	Construction	6	8/31/2017	10/1/2018	\$ 4,392,765		<ul style="list-style-type: none"><li>Contractor pursuing building permit, HEP, etc.</li></ul>
					Const. Mgmt	8	9/19/2017	10/1/2018	\$ 584,725		Procurement 100%, Contract executed September 15, NTP issued September 19. CM participated in site visit 10/10/17.

GWA October 17, 2017 Work Session - DIVISION REPORTS

7B	Groundwater Wells Rehabilitation (F-3, A-2, A-7, A-12, D-5)	Rehabilitation of existing deep wells and/or in cases where pipe column needs replacing, wells will be re-drilled. The deep wells to be rehabilitated are A-2, A-7, A-12, D-5, & F-3.	Brown & Caldwell	9/30/2021	Construction		3/23/2017	4/30/2018			
					Const. Mgmt		3/23/2017	4/30/2018			
8B	Tumon Sewer Hot Spots	Investigation, evaluation, and repair of possible solutions, to long plaguing issues where sewer overflows are known to occur in Tumon San Vitores.	Brown & Caldwell	9/30/2021	Construction		3/23/2017	3/22/2018			
					Const. Mgmt		3/23/2017	3/22/2018			
12B	RT4 Relief Sewer Line Rehabilitation and Replacement	Rehabilitation of sewer lines that are located from Agana McDonalds to Marine Drive that have been known to overflow due to structural issues.	Brown & Caldwell	9/30/2021	Construction		4/23/2017	10/31/2018			Procurement 70%, Bid opening extended to 10/27 due to DPW comments and EJCDC.
					Const. Mgmt		4/23/2017	10/31/2018	\$ 647,000		Procurement 90%, EMPSCO submitted revised fee (\$647K). B&C recommending award pending award of construction contract.
15B	Tamuning Sewer Hot Spots	Sewer rehabilitation for lines at Winner Apartments, Segund Leon Guerrero, and behind Guam Premium Outlets.	Brown & Caldwell	9/30/2021	Construction		4/29/2017	4/30/2018			
					Const. Mgmt		4/29/2017	4/30/2018			
16B	Talofofo Sewer Pump Stations (4 stations)	Design and construction of 4 sewer lift stations in the Talofofo village where sewer lines are installed but never completed.	J. Davis	9/30/2021	Construction		4/29/2017	4/30/2018			
					Const. Mgmt		4/29/2017	4/30/2018			
17B	Chalan Pago Sewer Pump Station	Design and construction of sewer lift stations and gravity lines in Scott Laguana, Santa Cruz Street Chalan Pago.	J. Davis	9/30/2021	Construction		4/29/2017	4/30/2018			
					Const. Mgmt		4/29/2017	4/30/2018			
18B	Water Hydraulic Model (SCADA ready instruments to update Model)	Design and construction of instrumentation at key water sites in the Barrigada service area necessary to update GWA Water hydraulic model.	C. Huntington	9/30/2021	Construction		2/1/2017	9/30/2017			
					Const. Mgmt		2/1/2017	9/31/2017			

# DASHBOARD


## FY 2017 Budget vs Actual (\$000)

Category	Description	Budget FY17	Actual FY17	Variance
Rate Based Revenues	Water	\$70,467	\$65,756	(\$4,711)
	Wastewater	40,549	38,063	(2,486)
	Total	111,016	103,819	(7,197)
Operations & Maintenance	Salaries & Benefits	26,209	22,743	(3,466)
	Power	12,742	12,076	(665)
	Water Purchases	8,117	7,309	(808)
	A&G	10,447	8,849	(1,598)
	Contractual	4,295	4,234	(62)
	Total	\$81,152	\$72,669	(\$8,482)

## Key Financial Ratios (\$000)

Category	FY17	FY16
Accounts Payable \$\$/Days	\$5,897 / 59 days	\$4,909 / 53 days
Accounts Receivable \$\$/Days	\$18,024 / 51 days	\$16,709 / 51 days
Days Cash On Hand	184 days	178 days
Annual Debt Service (Revenue Bonds)	\$24,563	\$22,225
Debt Service Coverage (Bond/PUC)	1.94 / 2.40	2.33 / 2.54




## Debt as a Percent to Gross Revenue

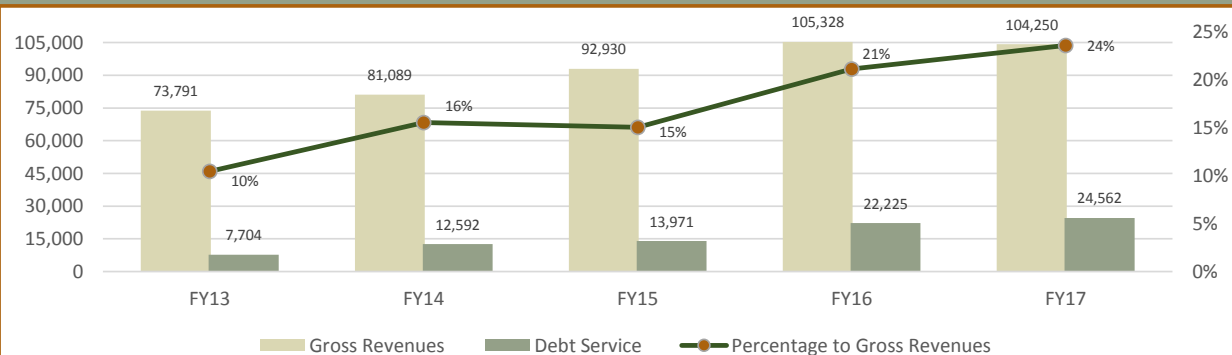





(1) Gross Revenues excludes SDC

(2) Debt Service Excludes Cap I

# Water & Wastewater Analytics

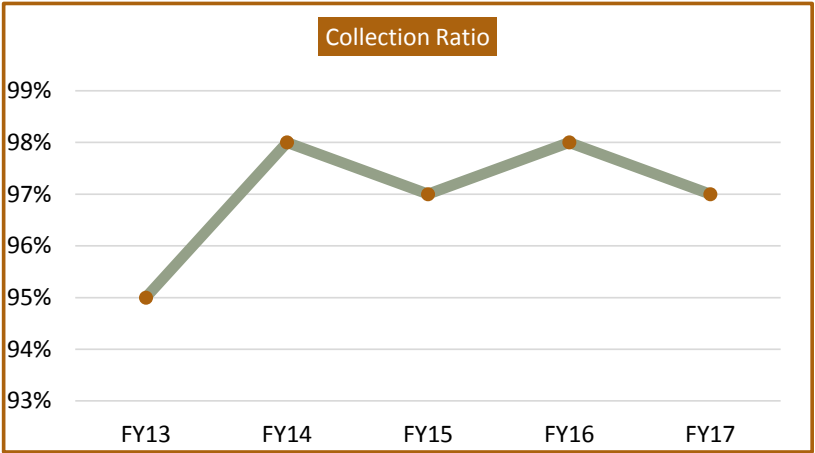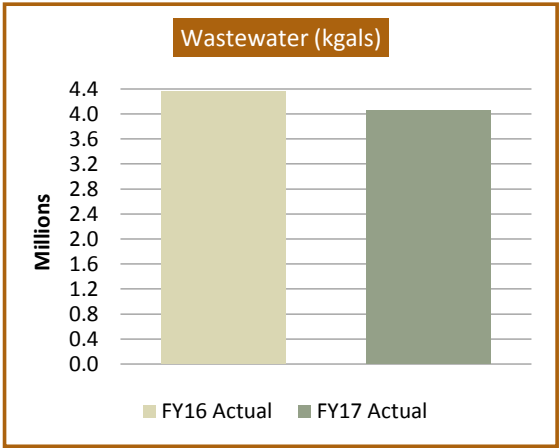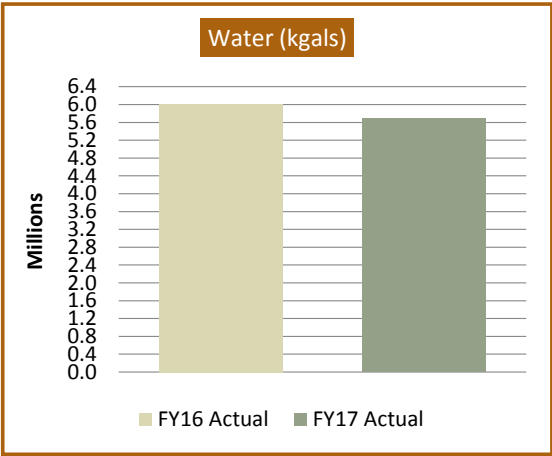

# Water & Wastewater Customers

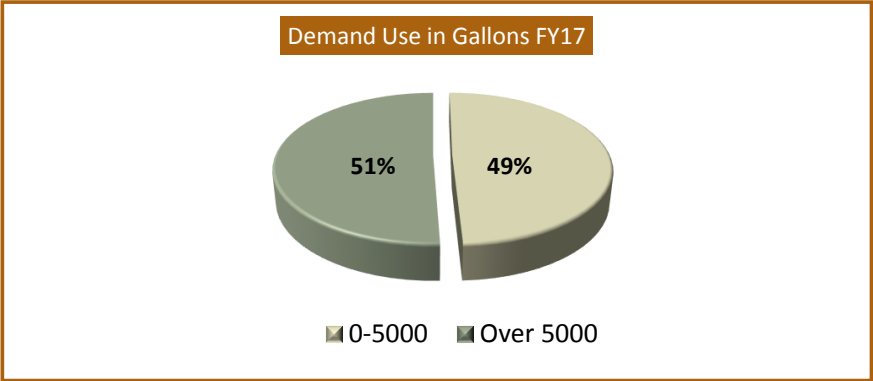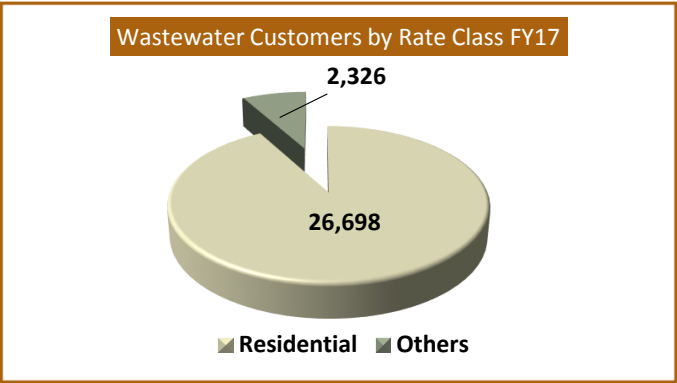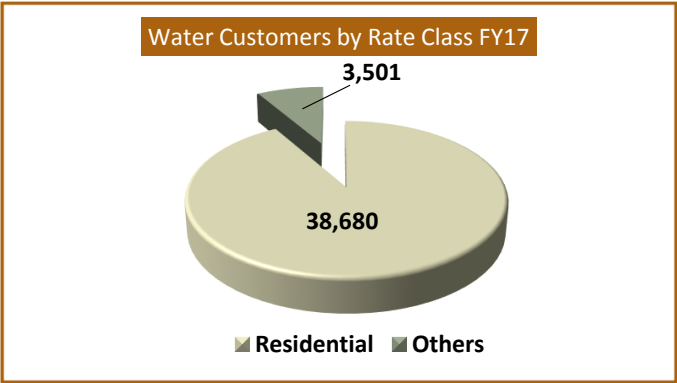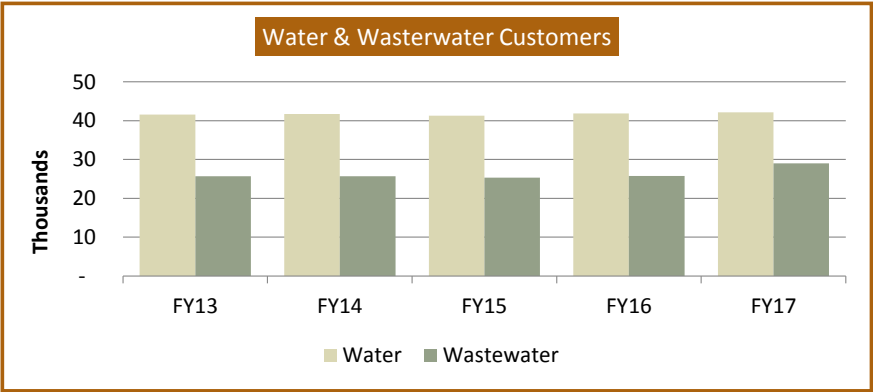


## Top Ten Largest Water and Wastewater Customers – September 2017


Water			Wastewater		
Customer Name	FY17 Revenues	% of Total	Customer Name	FY17 Revenues	% of Total
1) MDI GUAM CORPORATION/LEOPALACE	\$1,316,123	2.01%	1) AIR FORCE DOD	\$3,860,920	10.17%
2) PACIFIC ISLANDS CLUB	1,178,757	1.80%	2) NAVY DOD	1,684,854	4.44%
3) HOTELS OF THE MARIANAS INC	995,330	1.52%	3) HOTELS OF THE MARIANAS INC	1,064,415	2.80%
4) SHERATON LAGUNA GUAM RESORT	851,904	1.30%	4) SHERATON LAGUNA GUAM RESORT	911,821	2.40%
5) HYATT	847,386	1.30%	5) HYATT	906,969	2.39%
6) HOTEL NIKKO GUAM	813,085	1.24%	6) HOTEL NIKKO GUAM	868,680	2.29%
7) PACIFIC STAR RESORT & SPA	649,388	0.99%	7) PACIFIC STAR RESORT & SPA	692,867	1.82%
8) MDI GUAM CORPORATION/WESTIN	628,271	0.96%	8) MDI GUAM CORPORATION/WESTIN	671,635	1.77%
9) GUAM REEF HOTEL INC	592,583	0.91%	9) OUTRIGGER GUAM RESORT	633,320	1.67%
10) OUTRIGGER GUAM RESORT	591,248	0.90%	10) GUAM REEF HOTEL INC	633,306	1.67%
<b>Total</b>	<b>\$8,464,075</b>	<b>12.95%</b>	<b>Total</b>	<b>\$11,928,786</b>	<b>31.42%</b>

# Power, Water Purchases and Water Production


POWER PURCHASES (KWH)

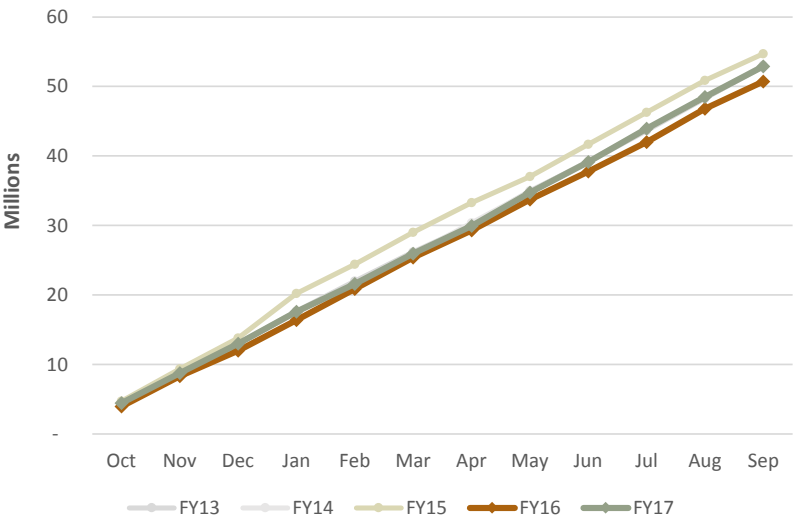

POWER PURCHASES BY FUNCTION (KWH)

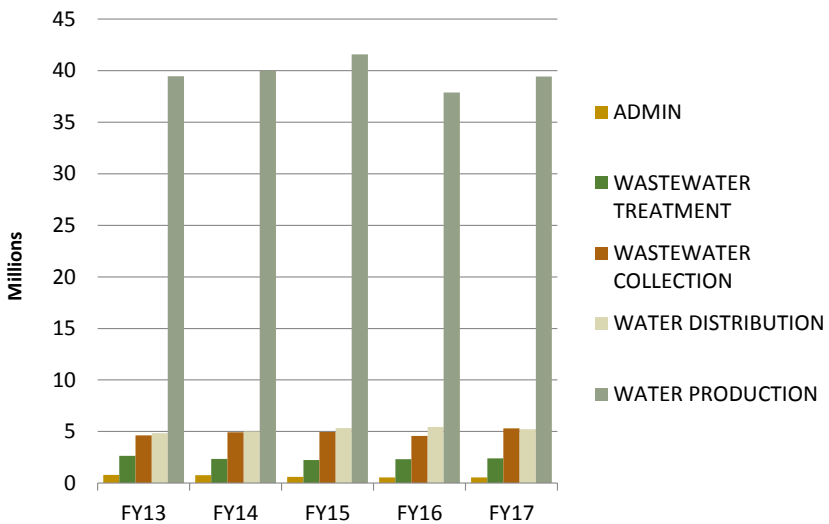


Water Production & Purchases

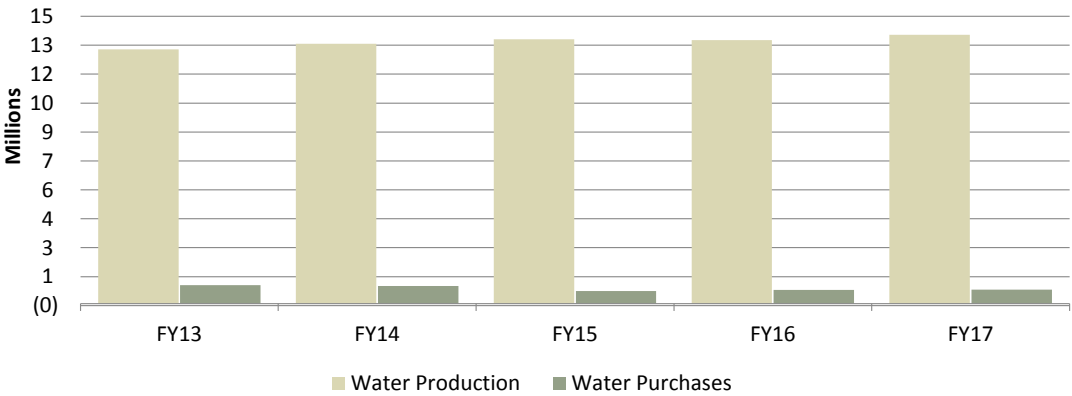


## FTE by Major Division

<b><u>DIVISION</u></b>	<b><u>FY2013</u></b>	<b><u>FY2014</u></b>	<b><u>FY2015</u></b>	<b><u>FY2016</u></b>	<b><u>FY2017</u></b>
ADMINISTRATION	129	129	140	163	162
WATER	117	110	106	104	106
WASTEWATER	68	62	63	67	62
TOTAL NUMBER OF STAFF	<u>314</u>	<u>301</u>	<u>309</u>	<u>334</u>	<u>330</u>
Gross Salaries & Wages (\$000)	14,929	15,532	15,805	16,442	17,210
Water Customers	41,582	41,702	41,274	42,259	42,181
Staff to Customers Ratio	0.76%	0.72%	0.75%	0.79%	0.78%

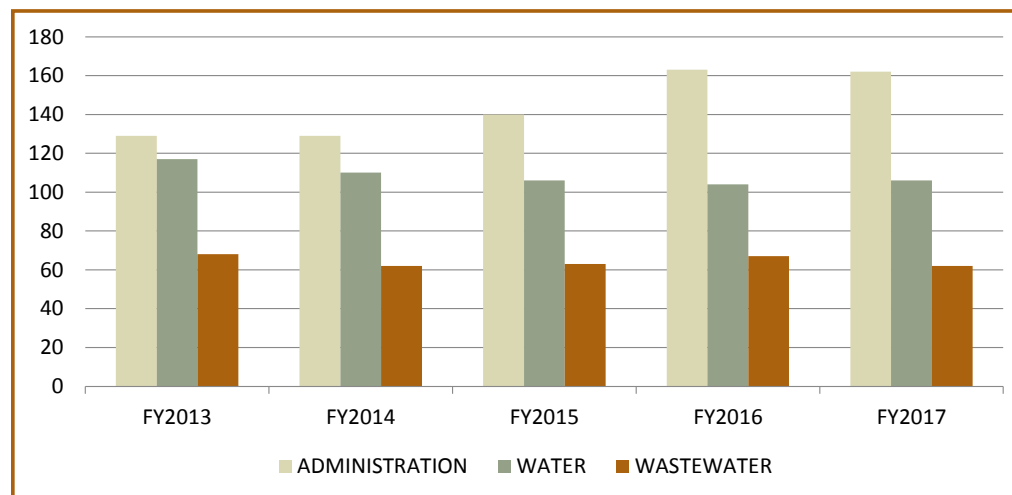




## SDC Water & Wastewater (Meter Quantity)

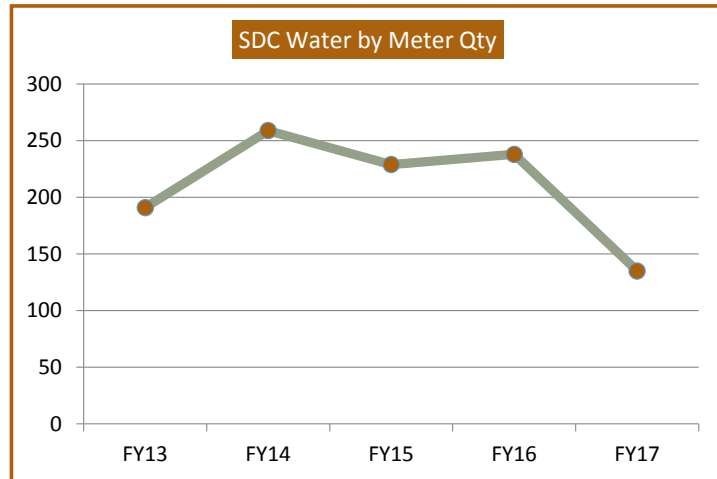

### Actual Meter Sizes

(Inches)	FY 2013	FY 2014	FY 2015	FY 2016	FY17
5/8 x 3/4	179	248	220	239	129
1	-	5	5	7	2
1 1/2	5	1	1	1	1
2	4	3	2	4	2
3	-	1	-	1	-
4	3	-	1	-	-
6	-	-	-	-	1
8	-	1	-	-	-
10	-	-	-	-	-
<b>Total SDC by Water</b>	<b>191</b>	<b>259</b>	<b>229</b>	<b>252</b>	<b>135</b>

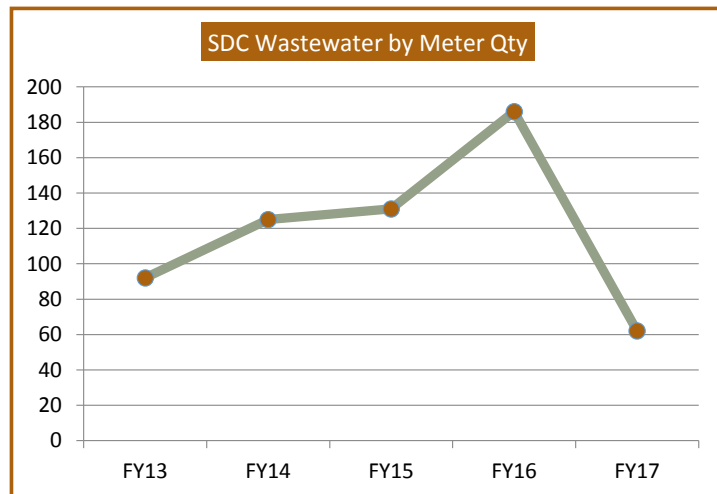

### Actual Meter Sizes

(Inches)	FY 2013	FY 2014	FY 2015	FY 2016	FY17
5/8 x 3/4	80	115	124	179	58
1	-	4	3	2	-
1 1/2	5	1	1	1	1
2	4	3	2	3	2
3	-	1	-	1	-
4	3	-	1	-	-
6	-	-	-	-	1
8	-	1	-	-	-
10	-	-	-	-	-
<b>Total SDC by Wastewater</b>	<b>92</b>	<b>125</b>	<b>131</b>	<b>186</b>	<b>62</b>

**GUAM WATERWORKS AUTHORITY  
SEPTEMBER 30, 2017  
FINANCIAL AND RELATED REPORTS  
TABLE OF CONTENTS**

	<b>SCHEDULES</b>	<b>PAGE</b>
<b>BALANCE SHEET</b>	<b>A</b>	<b>2</b>
<b>INCOME STATEMENT MTD ACTUALS VS MTD BUDGET</b>	<b>B</b>	<b>3</b>
<b>INCOME STATEMENT MTD ACTUALS FY17 VS FY16</b>	<b>C</b>	<b>4</b>
<b>INCOME STATEMENT YTD ACTUALS VS YTD BUDGET</b>	<b>D</b>	<b>5</b>
<b>INCOME STATEMENT YTD ACTUALS FY17 VS FY16</b>	<b>E</b>	<b>6</b>
<b>BOND COMPLIANCE</b>	<b>F</b>	<b>7</b>
<b>SCHEDULE OF CASH RESTRICTED/UNRESTRICTED</b>	<b>G</b>	<b>8</b>
<b>STATEMENT OF CASH FLOWS</b>	<b>H</b>	<b>9</b>
<b>AGING REPORT - GOVERNMENT ACCOUNTS</b>	<b>I</b>	<b>10</b>
<b>SCHEDULE OF SERIES 2010 BOND STATUS</b>	<b>J</b>	<b>11</b>
<b>SCHEDULE OF SERIES 2013 BOND STATUS</b>	<b>K</b>	<b>12</b>
<b>SCHEDULE OF SERIES 2014 REFUNDED BOND STATUS</b>	<b>L</b>	<b>13</b>
<b>SCHEDULE OF SERIES 2016 BOND STATUS</b>	<b>M</b>	<b>14</b>
<b>SUMMARY OF BOND BANK BALANCES</b>	<b>N</b>	<b>15</b>

**GUAM WATERWORKS AUTHORITY**  
**Balance Sheet**  
**September 30, 2017**

**SCHEDULE A**

<b>ASSETS</b>	<b>Unaudited September 30, 2017</b>	<b>Audited September 30, 2016</b>	<b>Increase (Decrease)</b>
<u>Current Assets:</u>			
Cash:			
Unrestricted (Schedule G)	5,000,721	8,157,430	(3,156,709)
Restricted Funds (Schedule G)	65,103,751	48,436,547	16,667,204
Accounts Receivable Trade, Net of Allowance for Doubtful Receivables of \$12,052,579 at Sep 30, 2017 and \$11,302,579 at Sep 30, 2016	15,842,062	14,562,072	1,279,989
Other Receivable	2,182,580	2,147,155	35,425
Materials & Supplies Inventory, Net of Allowance for Obsolescence of \$457,370 at Sep 30, 2017 and Sep 30, 2016	1,517,465	2,269,775	(752,310)
Total Current Assets	89,646,579	75,572,979	14,073,600
<u>Property, Plant and Equipment</u>			
Utility plant in service:			
Water system	311,716,223	306,262,568	5,453,655
Wastewater system	282,331,832	259,512,407	22,819,425
Non-utility property	18,571,111	22,474,787	(3,903,676)
Total property	612,619,165	588,249,761	24,369,404
Less Accumulated Depreciation	(298,781,718)	(282,837,613)	(15,944,106)
Land	1,110,998	254,288	856,710
Construction Work in Progress	135,427,628	81,877,561	53,550,067
Property, Plant and Equipment, net	450,376,072	387,543,997	62,832,075
<u>Other noncurrent assets</u>			
Restricted cash (Schedule G)	236,587,387	285,277,784	(48,690,397)
Investments (Schedule G)	41,042,038	41,029,262	12,776
Other Prepaid Expenses	732,238	652,000	80,238
Total other noncurrent assets	278,361,663	326,959,047	(48,597,383)
<b>TOTAL ASSETS</b>	<b>818,384,314</b>	<b>790,076,022</b>	<b>28,308,291</b>
Deferred outflows of resources:			
Debt defeasance loss on refunding	1,695,981	1,878,602	(182,621)
Deferred outflows from pension	3,414,242	4,668,010	(1,253,768)
<b>Total Assets and Deferred Outflows of Resources</b>	<b>823,494,537</b>	<b>796,622,635</b>	<b>26,871,902</b>
<b>LIABILITIES AND NET ASSETS</b>			
<u>Current Liabilities:</u>			
Current maturities of long-term debt			
-Series 2010 Bond	1,655,000	1,655,000	-
-Series 2014 Refunding	3,385,000	3,385,000	-
-Notes Payable	2,873,988	2,873,988	-
Accounts Payable -Trade	5,897,623	4,909,146	988,477
Accrued Expense	42,126	42,126	0
Interest Payable	6,656,499	6,748,638	(92,139)
Accrued Payroll and Employee Benefits	2,609,176	1,692,622	916,555
Accrued Annual Leave	1,891,497	1,641,497	250,000
Current portion of employee annual leave	524,652	548,845	(24,193)
Contractors' Payable	9,616,922	3,436,908	6,180,014
Customer and Other Deposits	2,130,957	2,228,235	(97,278)
Total Current Liabilities	37,283,441	29,162,004	8,121,437
<u>Long Term Debt, less current maturities</u>			
Series 2010 Revenue Bond	112,870,000	114,525,000	(1,655,000)
Series 2013 Revenue Bond	172,630,000	172,630,000	-
Series 2014 Refunding	72,610,000	75,995,000	(3,385,000)
Series 2016 Revenue Bond	143,310,000	143,310,000	-
Unamortized Discount - Bond 2010	(1,867,525)	(1,948,205)	80,680
Unamortized Discount - Bond 2013	(1,338,751)	(1,389,850)	51,099
Unamortized Premium - Bond 2014	4,804,694	5,071,307	(266,613)
Unamortized Premium - Bond 2016	17,262,975	17,870,470	(607,495)
Notes Payable	5,697,499	8,578,203	(2,880,704)
Unfunded Ret Liability (GASB 67/68)	37,997,946	38,195,938	(197,992)
Employee Annual Leave, Less Current Portion	911,277	887,084	24,193
<b>TOTAL LIABILITIES</b>	<b>602,171,556</b>	<b>602,886,951</b>	<b>(715,394)</b>
<b>Net Assets</b>	<b>221,322,981</b>	<b>193,735,684</b>	<b>27,587,297</b>
<b>Total Liabilities and Net Assets</b>	<b>823,494,537</b>	<b>796,622,635</b>	<b>26,871,902</b>

GWA October 17, 2017 Work Session - DIVISION REPORTS

GUAM WATERWORKS AUTHORITY  
Statement of Operations and Retained Earnings (Unaudited)  
Comparative Budget vs. Actual for the period ending September 30, 2017

SCHEDULE B

	Month to Date		Variance
	Budget	Actual (Unaudited)	Increase /
	September-17	September-17	(Decrease)
<b>OPERATING REVENUES</b>			
Water Revenues	5,678,548	5,906,577	228,029
Wastewater Revenues	3,284,461	3,294,425	9,964
Legislative Surcharge	288,387	295,732	7,345
Other Revenues	43,750	31,097	(12,653)
System Development Charge	133,333	52,932	(80,402)
<b>Total Operating Revenues</b>	<b>9,428,479</b>	<b>9,580,762</b>	<b>152,284</b>
<b>OPERATING AND MAINTENANCE EXPENSES</b>			
Water Purchases	599,391	595,719	(3,672)
Power Purchases	1,084,804	1,084,621	(183)
Total Utility Costs	1,684,195	1,680,339	(3,855)
Salaries and Wages	1,599,470	1,598,954	(516)
Pension and Benefits	472,585	471,544	(1,040)
Total Salaries and Benefits	2,072,055	2,070,498	(1,557)
Capitalized Labor and Benefits	(292,554)	(200,000)	92,554
Net Salaries and Benefits	1,779,501	1,870,498	90,998
<b>Administrative and General Expenses</b>			
Sludge removal	123,895	123,780	(114)
Chemicals	135,222	134,357	(865)
Materials & Supplies	227,071	226,298	(772)
Transportation	155,419	155,378	(42)
Communications	12,152	12,006	(146)
Claims	30,284	30,211	(73)
Insurance	76,312	75,480	(832)
Training & Travel	49,570	49,373	(196)
Advertising	10,545	10,397	(148)
Miscellaneous	73,963	73,430	(533)
Total Administrative and General Expense	894,431	890,711	(3,721)
<b>Regulatory Expense</b>	43,791	43,529	(262)
<b>Bad Debts Provision</b>	62,500	62,497	(3)
<b>Depreciation Expense</b>	1,529,550	1,329,008	(200,542)
<b>Contractual Expense</b>			
Audit & Computer Maint.	48,630	47,701	(929)
Building rental	38,368	36,582	(1,785)
Equipment rental	96,270	95,659	(610)
Legal	439	-	(439)
Laboratory	34,086	33,520	(566)
Other	263,292	286,191	22,899
Total Contractual Expense	481,085	499,654	18,569
Retiree Supp. Annuities and health care costs	239,312	243,987	4,675
Contribution to Government of Guam	48,285	49,500	1,215
Total Retiree Benefits	287,597	293,487	5,890
<b>Total Operating Expenses</b>	<b>6,762,648</b>	<b>6,669,723</b>	<b>(92,926)</b>
<b>Earnings (Loss) from Operations</b>	<b>2,665,830</b>	<b>2,911,040</b>	<b>245,210</b>
Interest Income-2010/13/14/16 Series Bond	1,029	150,816	149,787
Interest Income-Other Funds	642	22,770	22,129
Interest Income-SDC	-	1,276	1,276
Interest Expense- 2010/13/14/16 Series Bond	(2,223,983)	(2,211,025)	12,959
Interest Expense- ST BOG	(46,124)	(7,728)	38,396
Federal Expenditures	-	-	-
Loss on Asset Disposal	-	-	-
AFUDC	625,000	625,000	-
Amortization of Discount, Premium and Issuance Costs	37,738	61,861	24,123
Loss on Defeasance Bond05 Refunding	(19,483)	(15,218)	4,265
Deferred outflows from pension	(66,928)	(104,481)	(37,552)
Prior Year Adjustment	-	-	-
Total non-operating revenues (expenses)	(1,692,111)	(1,476,729)	215,381
<b>Net Income (Loss) before capital contributions</b>	<b>973,720</b>	<b>1,434,311</b>	<b>460,591</b>
<b>Capital Contributions</b>			
Grants from US Government	250,000	2,109,678	1,859,678
Grants from GovGuam & Others	-	-	-
Other Contributions	-	-	-
Total Capital Contributions	250,000	2,109,678	1,859,678
<b>Change in Net Assets</b>	<b>1,223,720</b>	<b>3,543,988</b>	<b>2,320,269</b>
<b>Debt Service Calculation</b>			
Earnings From Operations	2,665,830	2,911,040	
System Development Charge	(133,333)	(52,932)	
Interest/Investment Income	642	22,770	
Depreciation	1,529,550	1,329,008	
<b>Balance Available for Debt Service per Section 6.12</b>	<b>4,062,689</b>	<b>4,209,887</b>	
Working Capital Reserve Available for Debt Service	632,083	932,134	
Transfer to Working Capital Debt Service Reserve	(304,167)	-	
<b>Balance Available for Debt Service inclusive of reserves</b>	<b>4,390,606</b>	<b>5,142,021</b>	
<b>Debt Service</b>			
Principal	420,000	420,000	
Interest	1,626,858	1,626,858	
<b>Total</b>	<b>2,046,858</b>	<b>2,046,858</b>	
<b>Debt Service Coverage (1.25X)- per Section 6.12 (Indenture)</b>	<b>1.98</b>	<b>2.06</b>	
<b>Debt Service Coverage (1.75X) inclusive of reserves (PUC)</b>	<b>2.15</b>	<b>2.51</b>	

GWA October 17, 2017 Work Session - DIVISION REPORTS

GUAM WATERWORKS AUTHORITY  
Statement of Operations and Retained Earnings (Unaudited)  
Comparative for the period ending September 30, 2017 and 2016

SCHEDULE C

	Month to Date		Variance
	Actual (Unaudited)	Actual (Audited)	Increase /
	September-17	September-16	(Decrease)
<b>OPERATING REVENUES</b>			
Water Revenues	5,906,577	5,361,643	544,934
Wastewater Revenues	3,294,425	3,102,398	192,027
Legislative Surcharge	295,732	241,527	54,205
Other Revenues	31,097	43,325	(12,228)
System Development Charge	52,932	119,028	(66,096)
<b>Total Operating Revenues</b>	<b>9,580,762</b>	<b>8,867,921</b>	<b>712,842</b>
<b>OPERATING AND MAINTENANCE EXPENSES</b>			
Water Purchases	595,719	531,170	64,549
Power Purchases	1,084,621	935,490	149,130
Total Utility Costs	1,680,339	1,466,660	213,679
Salaries and Wages	1,598,954	1,333,993	264,961
Pension and Benefits	471,544	454,904	16,640
Total Salaries and Benefits	2,070,498	1,788,897	281,601
Capitalized Labor and Benefits	(200,000)	(248,363)	48,363
Net Salaries and Benefits	1,870,498	1,540,534	329,964
<b>Administrative and General Expenses</b>			
Sludge removal	123,780	130,423	(6,643)
Chemicals	134,357	186,596	(52,239)
Materials & Supplies	226,298	103,711	122,587
Transportation	155,378	47,876	107,502
Communications	12,006	10,265	1,741
Claims	30,211	10,618	19,593
Insurance	75,480	101,111	(25,631)
Training & Travel	49,373	12,457	36,917
Advertising	10,397	15,907	(5,510)
Miscellaneous	73,430	68,429	5,001
Total Administrative and General Expense	890,711	687,393	203,318
<b>Regulatory Expense</b>	<b>43,529</b>	<b>27,104</b>	<b>16,424</b>
<b>Bad Debts Provision</b>	<b>62,497</b>	<b>86,193</b>	<b>(23,695)</b>
<b>Depreciation Expense</b>	<b>1,329,008</b>	<b>1,279,008</b>	<b>50,000</b>
<b>Contractual Expense</b>			
Audit & Computer Maint.	47,701	86,467	(38,766)
Building rental	36,582	33,279	3,304
Equipment rental	95,659	58,162	37,498
Legal	-	362	(362)
Laboratory	33,520	10,234	23,286
Other	286,191	154,589	131,602
Total Contractual Expense	499,654	343,094	156,560
Retiree Supp. Annuities and health care costs	243,987	230,355	13,632
Contribution to Government of Guam	49,500	48,667	833
Total Retiree Benefits	293,487	279,022	14,465
<b>Total Operating Expenses</b>	<b>6,669,723</b>	<b>5,709,007</b>	<b>960,716</b>
<b>Earnings (Loss) from Operations</b>	<b>2,911,040</b>	<b>3,158,914</b>	<b>(247,874)</b>
Interest Income-2010/13/14/16 Series Bond	150,816	2,083	148,733
Interest Income-Other Funds	22,770	1,281	21,489
Interest Income-SDC	1,276	1,896	(620)
Interest Expense- 2010/13/14/16 Series Bond	(2,211,025)	(1,994,375)	(216,650)
Interest Expense- ST BOG	(7,728)	(59,096)	51,368
Federal Expenditures	-	(88,189)	88,189
Loss on Asset Disposal	-	(4,150)	4,150
AFUDC	625,000	1,142,370	(517,370)
Amortization of Discount, Premium and Issuance Costs	61,861	(160,812)	222,672
Loss on Defeasance Bond05 Refunding	(15,218)	(19,483)	4,265
Deferred outflows from pension	(104,481)	(7,452)	(97,029)
Prior Year Adjustment	-	(51,397)	51,397
Total non-operating revenues (expenses)	(1,476,729)	(1,237,323)	(239,406)
<b>Net Income (Loss) before capital contributions</b>	<b>1,434,311</b>	<b>1,921,591</b>	<b>(487,280)</b>
<b>Capital Contributions</b>			
Grants from US Government	2,109,678	434,254	1,675,424
Grants from GovGuam & Others	-	23,151	(23,151)
Other Contributions	-	-	-
Total Capital Contributions	2,109,678	457,405	1,652,272
<b>Change in Net Assets</b>	<b>3,543,988</b>	<b>2,378,996</b>	<b>1,164,992</b>
<b>Debt Service Calculation</b>			
Earnings From Operations	2,911,040	3,158,914	
System Development Charge	(52,932)	(119,028)	
Interest/Investment Income	22,770	1,281	
Depreciation	1,329,008	1,279,008	
<b>Balance Available for Debt Service per Section 6.12</b>	<b>4,209,887</b>	<b>4,320,176</b>	
Working Capital Reserve Available for Debt Service	932,134	382,083	
Transfer to Working Capital Debt Service Reserve	-	-	
<b>Balance Available for Debt Service inclusive of reserves</b>	<b>5,142,021</b>	<b>4,702,259</b>	
<b>Debt Service</b>			
Principal	420,000	409,167	
Interest	1,626,858	1,442,950	
<b>Total</b>	<b>2,046,858</b>	<b>1,852,116</b>	
<b>Debt Service Coverage (1.25X)- per Section 6.12 (Indenture)</b>	<b>2.06</b>	<b>2.33</b>	
<b>Debt Service Coverage (1.75X) inclusive of reserves (PUC)</b>	<b>2.51</b>	<b>2.54</b>	

GWA October 17, 2017 Work Session - DIVISION REPORTS

GUAM WATERWORKS AUTHORITY  
Statement of Operations and Retained Earnings (Unaudited)  
Comparative Budget vs. Actual for the period ending September 30, 2017

SCHEDULE D

	Year to Date		Variance
	Budget	Actual (Unaudited)	Increase /
	September-17	September-17	(Decrease)
<b>OPERATING REVENUES</b>			
Water Revenues	68,142,571	63,626,166	(4,516,405)
Wastewater Revenues	39,413,527	37,005,466	(2,408,061)
Legislative Surcharge	3,460,644	3,187,567	(273,077)
Other Revenues	525,000	430,892	(94,108)
System Development Charge	1,600,000	874,072	(725,928)
<b>Total Operating Revenues</b>	<b>113,141,742</b>	<b>105,124,163</b>	<b>(8,017,579)</b>
<b>OPERATING AND MAINTENANCE EXPENSES</b>			
Water Purchases	8,116,687	7,309,125	(807,562)
Power Purchases	12,741,648	12,076,262	(665,386)
Total Utility Costs	20,858,335	19,385,387	(1,472,948)
Salaries and Wages	19,037,643	17,210,388	(1,827,255)
Pension and Benefits	7,171,015	5,532,557	(1,638,458)
Total Salaries and Benefits	26,208,658	22,742,945	(3,465,713)
Capitalized Labor and Benefits	(3,510,651)	(2,900,000)	610,651
Net Salaries and Benefits	22,698,007	19,842,945	(2,855,062)
<b>Administrative and General Expenses</b>			
Sludge removal	2,092,736	1,685,842	(406,894)
Chemicals	2,162,664	2,146,528	(16,136)
Materials & Supplies	1,690,947	1,659,963	(30,984)
Transportation	857,030	642,172	(214,858)
Communications	169,822	130,503	(39,319)
Claims	255,406	254,705	(701)
Insurance	1,623,740	1,087,233	(536,507)
Training & Travel	271,838	271,569	(269)
Advertising	109,534	107,853	(1,681)
Miscellaneous	1,212,559	862,275	(350,284)
Total Administrative and General Expense	10,446,276	8,848,643	(1,597,633)
<b>Regulatory Expense</b>	284,486	283,985	(501)
<b>Bad Debts Provision</b>	750,000	749,942	(58)
<b>Depreciation Expense</b>	18,354,600	15,948,096	(2,406,504)
<b>Contractual Expense</b>			
Audit & Computer Maint.	984,564	975,125	(9,439)
Building rental	460,412	438,678	(21,734)
Equipment rental	763,237	762,487	(750)
Legal	7,465	6,479	(986)
Laboratory	159,035	133,443	(25,592)
Other	1,920,501	1,917,454	(3,047)
Total Contractual Expense	4,295,214	4,233,667	(61,547)
Retiree Supp. Annuities and health care costs	2,871,740	2,782,745	(88,995)
Contribution to Government of Guam	593,120	594,000	880
Total Retiree Benefits	3,464,860	3,376,745	(88,115)
<b>Total Operating Expenses</b>	<b>81,151,778</b>	<b>72,669,409</b>	<b>(8,482,369)</b>
<b>Earnings (Loss) from Operations</b>	<b>31,989,964</b>	<b>32,454,754</b>	<b>464,790</b>
Interest Income-2010/13/14/16 Series Bond	12,344	784,252	771,908
Interest Income-Other Funds	7,702	120,071	112,369
Interest Income-SDC	-	12,717	12,717
Interest Expense- 2010/13/14/16 Series Bond	(26,687,801)	(26,648,925)	38,876
Interest Expense- ST BOG	(553,489)	(524,835)	28,654
Federal Expenditures	-	(256,661)	(256,661)
Loss on Asset Disposal	-	(232,147)	(232,147)
AFUDC	7,500,000	7,500,000	-
Amortization of Discount, Premium and Issuance Costs	452,850	742,328	289,478
Loss on Defeasance Bond05 Refunding	(233,796)	(182,621)	51,175
Deferred outflows from pension	(803,138)	(1,253,768)	(450,630)
Prior Year Adjustment	-	(529,784)	(529,784)
Total non-operating revenues (expenses)	(20,305,328)	(20,469,372)	(164,044)
<b>Net Income (Loss) before capital contributions</b>	<b>11,684,636</b>	<b>11,985,382</b>	<b>300,746</b>
<b>Capital Contributions</b>			
Grants from US Government	3,000,000	15,600,029	12,600,029
Grants from GovGuam & Others	-	1,886	1,886
Other Contributions	-	-	-
Total Capital Contributions	3,000,000	15,601,914	12,601,914
<b>Change in Net Assets</b>	<b>14,684,636</b>	<b>27,587,297</b>	<b>12,902,661</b>
<b>Debt Service Calculation</b>			
Earnings From Operations	31,989,964	32,454,754	
System Development Charge	(1,600,000)	(874,072)	
Interest/Investment Income	7,702	120,071	
Depreciation	18,354,600	15,948,096	
<b>Balance Available for Debt Service per Section 6.12</b>	<b>48,752,266</b>	<b>47,648,850</b>	
Working Capital Reserve Available for Debt Service	7,585,000	11,185,610	
Transfer to Working Capital Debt Service Reserve	(3,650,000)	-	
<b>Balance Available for Debt Service inclusive of reserves</b>	<b>52,687,266</b>	<b>58,834,460</b>	
<b>Debt Service</b>			
Principal	5,040,000	5,040,000	
Interest	19,522,301	19,522,301	
<b>Total</b>	<b>24,562,301</b>	<b>24,562,301</b>	
<b>Debt Service Coverage (1.25X)- per Section 6.12 (Indenture)</b>	<b>1.98</b>	<b>1.94</b>	
<b>Debt Service Coverage (1.75X) inclusive of reserves (PUC)</b>	<b>2.15</b>	<b>2.40</b>	

GWA October 17, 2017 Work Session - DIVISION REPORTS

GUAM WATERWORKS AUTHORITY  
Statement of Operations and Retained Earnings (Unaudited)  
Comparative for the period ending September, 2017 and 2016

SCHEDULE E

	Year to Date		Variance
	ACTUAL (Unaudited)	ACTUAL (Audited)	Increase /
	September-17	September-16	(Decrease)
<b>OPERATING REVENUES</b>			
Water Revenues	63,626,166	64,339,714	(713,548)
Wastewater Revenues	37,005,466	37,228,781	(223,315)
Legislative Surcharge	3,187,567	2,898,325	289,243
Other Revenues	430,892	519,899	(89,006)
System Development Charge	874,072	1,428,332	(554,260)
<b>Total Operating Revenues</b>	<b>105,124,163</b>	<b>106,415,050</b>	<b>(1,290,887)</b>
<b>OPERATING AND MAINTENANCE EXPENSES</b>			
Water Purchases	7,309,125	6,374,035	935,090
Power Purchases	12,076,262	11,225,884	850,379
Total Utility Costs	19,385,387	17,599,919	1,785,468
Salaries and Wages	17,210,388	16,007,914	1,202,474
Pension and Benefits	5,532,557	5,458,851	73,706
Total Salaries and Benefits	22,742,945	21,466,765	1,276,180
Capitalized Labor and Benefits	(2,900,000)	(2,980,358)	80,358
Net Salaries and Benefits	19,842,945	18,486,407	1,356,538
<b>Administrative and General Expenses</b>			
Sludge removal	1,685,842	1,565,080	120,762
Chemicals	2,146,528	2,239,147	(92,619)
Materials & Supplies	1,659,963	1,244,535	415,428
Transportation	642,172	574,510	67,662
Communications	130,503	123,178	7,325
Claims	254,705	127,412	127,293
Insurance	1,087,233	1,213,327	(126,094)
Training & Travel	271,569	149,481	122,088
Advertising	107,853	190,889	(83,036)
Miscellaneous	862,275	821,152	41,123
Total Administrative and General Expense	8,848,643	8,248,710	599,933
<b>Regulatory Expense</b>	283,985	325,252	(41,267)
<b>Bad Debts Provision</b>	749,942	1,034,310	(284,369)
<b>Depreciation Expense</b>	15,948,096	15,348,101	599,995
<b>Contractual Expense</b>			
Audit & Computer Maint.	975,125	1,037,609	(62,484)
Building rental	438,678	399,343	39,335
Equipment rental	762,487	697,942	64,544
Legal	6,479	4,348	2,131
Laboratory	133,443	122,810	10,633
Other	1,917,454	1,855,070	62,384
Total Contractual Expense	4,233,667	4,117,122	116,544
Retiree Supp. Annuities and health care costs	2,782,745	2,764,262	18,483
Contribution to Government of Guam	594,000	584,000	10,000
Total Retiree Benefits	3,376,745	3,348,262	28,483
<b>Total Operating Expenses</b>	<b>72,669,409</b>	<b>68,508,084</b>	<b>4,161,325</b>
<b>Earnings (Loss) from Operations</b>	<b>32,454,754</b>	<b>37,906,966</b>	<b>(5,452,212)</b>
Interest Income-2010/13/14/16 Series Bond	784,252	24,991	759,262
Interest Income-Other Funds	120,071	15,378	104,693
Interest Income-SDC	12,717	22,746	(10,029)
Interest Expense- 2010/13/14/16 Series Bond	(26,648,925)	(23,932,501)	(2,716,425)
Interest Expense- ST BOG	(524,835)	(709,146)	184,311
Federal Expenditures	(256,661)	(1,058,262)	801,601
Loss on Asset Disposal	(232,147)	(49,796)	(182,351)
AFUDC	7,500,000	13,708,441	(6,208,441)
Amortization of Discount, Premium and Issuance Costs	742,328	(1,929,740)	2,672,068
Loss on Defeasance Bond05 Refunding	(182,621)	(233,796)	51,175
Deferred outflows from pension	(1,253,768)	(89,420)	(1,164,348)
Prior Year Adjustment	(529,784)	(616,767)	86,983
Total non-operating revenues (expenses)	(20,469,372)	(14,847,872)	(5,621,500)
<b>Net Income (Loss) before capital contributions</b>	<b>11,985,382</b>	<b>23,059,094</b>	<b>(11,073,711)</b>
<b>Capital Contributions</b>			
Grants from US Government	15,600,029	5,211,045	10,388,984
Grants from GovGuam & Others	1,886	277,818	(275,932)
Other Contributions	-	-	-
Total Capital Contributions	15,601,914	5,488,862	10,113,052
<b>Change in Net Assets</b>	<b>27,587,297</b>	<b>28,547,956</b>	<b>(960,659)</b>
<b>Debt Service Calculation</b>			
Earnings From Operations	32,454,754	37,906,966	
System Development Charge	(874,072)	(1,428,332)	
Interest/Investment Income	120,071	15,378	
Depreciation	15,948,096	15,348,101	
<b>Balance Available for Debt Service per Section 6.12</b>	<b>47,648,850</b>	<b>51,842,113</b>	
Working Capital Reserve Available for Debt Service	11,185,610	4,585,000	
Transfer to Working Capital Debt Service Reserve	-	-	
<b>Balance Available for Debt Service inclusive of reserves</b>	<b>58,834,460</b>	<b>56,427,113</b>	
<b>Debt Service</b>			
Principal	5,040,000	4,910,000	
Interest	19,522,301	17,315,395	
<b>Total</b>	<b>24,562,301</b>	<b>22,225,395</b>	
<b>Debt Service Coverage (1.25X)- per Section 6.12 (Indenture)</b>	<b>1.94</b>	<b>2.33</b>	
<b>Debt Service Coverage (1.75X) inclusive of reserves (PUC)</b>	<b>2.40</b>	<b>2.54</b>	

## SCHEDULE F

**Bond Compliance**

(\$\$\$)  
Per Indenture  
 As of 09/30/17  
 (\$\$\$)  
 Bond  
 2010/2013/2014/2016

•	Operation and Maintenance Fund-BOG	<i>Equivalent to 55 days of the annual O&amp;M budget less depreciation</i>	\$10.5M	\$10.5M
•	Bond Reserve Fund - US Bank	<i>Fully funded- Principal and Interest (Bond Series 2010, 2013, 2014 Refunding and 2016)</i>	\$34.9M	\$34.9M
•	Operation, Maintenance, Renewal and Replacement Reserve Fund-BOG Trust	<i>Equivalent to 1/4 of the annual O&amp;M budget &amp; CIP budget to be funded in 5 years (\$2M/year)</i>	\$17.4M	\$17.4M
•	Capital Improvement Fund	<i>Balance remaining in the Revenue Fund after the foregoing deposits</i>	\$3.9K	\$5.6K
•	Capitalized Interest Fund			\$1.8M



**GUAM WATERWORKS AUTHORITY**  
**Restricted and Unrestricted Cash Summary**  
**FY 2017**

**SCHEDULE G**

<b>Description</b>	<b>Unaudited September 30, 2017</b>	<b>Audited September 30, 2016</b>	<b>Increase (Decrease)</b>
<b>UNRESTRICTED</b>			
Change Fund	2,000	2,000	0
Petty Cash	5,000	5,000	0
BOG - General Fund	4,963,682	8,126,177	(3,162,495)
BOG - PRN Payroll	30,039	24,253	5,786
<b>Sub-total Unrestricted</b>	<b>5,000,721</b>	<b>8,157,430</b>	<b>(3,156,709)</b>
<b>RESTRICTED</b>			
BOG - Credit Card-Sweep	-	-	0
BOG - On Line Payment	-	-	0
BOG - Sweep Account	-	76	(76)
Bank of Hawaii	134,720	121,322	13,398
ANZ Bank	-	229	(229)
First Hawaiian Bank	10,302	47,741	(37,439)
Bank Pacific	16,223	14,194	2,029
Community First FCU	3,803	4,638	(835)
BOG - Customer Refunds	1,827,485	1,431,631	395,854
Bank Pacific - Surcharge	278,022	166,763	111,259
Bank Pacific - Escrow Deposit	665,955	845,734	(179,779)
BOG Emergency Reserve Fund	6,122	6,114	7
BOG - Revenue Trust	183,628	595,751	(412,122)
BOG Revenue Trust Fund	7,782,227	8,182,472	(400,245)
BOG Capital Improvement Fund-Bond	5,598	3,933	1,665
BOG Capital Improvement Revenue Fund	-	-	0
BOG-O & M Reserve	13,516,540	4,050,319	9,466,221
BOG-Debt Service Reserve	11,217,733	11,185,610	32,124
BOG-CAPEX Reserve	15,462,869	8,710,383	6,752,486
BOG Sewer Hookup Revolving Fund	63,590	62,132	1,458
BOG Short Term Loan DSF	-	-	0
BOG Subord. Sec. Fund	859,233	859,233	0
BOG Operation and Maintenance Fund	3,083,482	3,083,482	0
	<b>55,117,532</b>	<b>39,371,755</b>	<b>15,745,777</b>
BOG - SDC Deposit	1,486,219	1,064,792	421,427
BOG - SDC CDs	8,500,000	8,000,000	500,000
<b>Total Restricted</b>	<b>65,103,751</b>	<b>48,436,547</b>	<b>16,667,204</b>
<b>Reserve Funds</b>			
BOG Series 05 OMRRRF Fund	17,423,213	17,423,213	0
BOG Series 10 Construction Fund	9,299,311	11,725,749	(2,426,437)
BOG Series 13 Construction Fund	74,499,150	107,622,618	(33,123,468)
BOG Series 13 CAP I Fund	-	-	0
BOG Series 14 Refunding Construction Fund	771,281	820,529	(49,248)
BOG Series 16 Construction Fund	132,811,449	138,748,131	(5,936,682)
BOG Series 16 Cap Int Fund	1,782,982	8,937,545	(7,154,562)
BOG Series 16 COI Fund	-	-	0
<b>Total Restricted - Held by Trustee</b>	<b>236,587,387</b>	<b>285,277,784</b>	<b>(48,690,397)</b>
USB Series 2010 Debt Service Fund	2,020,121	2,016,414	3,707
USB Series 2010 Debt Service Reserve Fund	7,566,460	7,566,460	0
USB Series 2013 Debt Service Fund	2,336,754	2,333,083	3,671
USB Series 2013 Debt Service Reserve Fund	12,031,688	12,031,688	0
USB Series 2014 Refunding Debt Service Fund	1,796,559	1,791,266	5,293
USB Series 2014 Refunding Debt Service Reserve Fund	7,707,602	7,707,628	(26)
USB Series 2016 Debt Service Fund	130	-	130
USB Series 2016 Debt Service Reserve Fund	7,582,725	7,582,725	0
<b>Total Investments</b>	<b>41,042,038</b>	<b>41,029,262</b>	<b>12,776</b>
<b>Total Restricted and Unrestricted Cash</b>	<b>347,733,897</b>	<b>382,901,023</b>	<b>(35,167,126)</b>

**SCHEDULE H**

**Guam Waterworks Authority**  
**Statement of Cash Flows (Unaudited)**  
**FY 2017**

**YTD**  
**Sep-17**

**Increase (decrease) in cash****Cash flows from operating activities:**

Cash received from trade and others	103,518,335
Cash payments to suppliers/contractors for goods and services	(32,073,221)
Cash payments to employees for services	(20,997,359)

**Net cash provided by operating activities**


---

50,447,754
**Cash flows from capital and related financing activities:**

Contributed capital received (grants)	14,788,448
Acquisition of utility plant	(67,734,698)
Repayment of Long Term Debt	(5,782,328)
Interest expense	(27,803,343)

**Net cash provided by (used in) capital and related financing activities**


---

(86,531,921)
**Cash flows from investing activities:**

Transfers from (to) restricted fund	32,010,417
Interest income received	917,041

**Net cash provided by investing activities**


---

32,927,458
**Net increase (decrease) in cash**

(3,156,709)

**Unrestricted cash at beginning of the period**

8,157,430

**Unrestricted cash at end of period**


---

5,000,721

Reconciliation of operating loss to net cash provided by  
operating activities:

**Operating Income (loss)**

31,704,813

Adjustments to reconcile to net cash provided by operating activities:

Depreciation expense	15,948,096
Other Expense/income	1,573,570
(Increase) decrease in assets:	
Accounts receivable	(1,508,551)
Materials and supplies inventory	752,310
Other Assets	(80,238)

Increase (decrease) in liabilities:

Accounts payable, Contractors, Retention & Escrow Deposit	988,477
Accrued payroll	1,166,555
Customer deposits	(97,278)

**Net cash provided by operating activities**


---

50,447,754

Guam Waterworks Authority  
Accounts Receivable - Government  
As of September 30, 2017

## SCHEDULE I

Customer Name	No. of Accounts	A G I N G					Outstanding Balance
		Current Balance	31-60 days	61-90 days	91-120 days	Over 120 days	
Guam International Airport Authority	10	45,892	28,532	44,012	29,386	150,835	298,657
Guam Power Authority	25	50,126	107,374	70,531	9,662	679	238,372
Port Authority of Guam	1	41,888	26,603	-	-	-	68,490
Guam Memorial Hospital Authority	3	38,565	131	-	-	-	38,696
University of Guam	2	6,675	-	-	-	-	6,675
Guam Housing & Urban Renewal Authority	7	1,051	176	-	-	92	1,319
Guam Housing Corporation	1	32	-	-	-	-	32
<b>Autonomous Agencies</b>	<b>49</b>	<b>184,227</b>	<b>162,816</b>	<b>114,543</b>	<b>39,048</b>	<b>151,606</b>	<b>652,240</b>
Department of Education	48	283,578	86,993	-	2,647	20,174	393,392
Department of Parks & Recreation	21	50,139	50,478	36,425	21,614	121,126	279,782
Department of Corrections	6	136,391	109,383	-	-	-	245,773
Department of Public Health & Social Services	5	2,347	1,517	176	1,003	103,115	108,158
Mayors' Council of Guam	47	11,846	13,952	334	7,886	-	34,018
Department of Chamorro Affairs	6	7,626	7,724	15,826	-	-	31,177
Department of Agriculture	6	5,508	5,796	-	-	-	11,304
Guam Fire Department	8	7,229	2,727	442	-	-	10,399
Department of Youth Affairs	4	5,619	249	-	-	-	5,868
Department of Public Works	9	4,593	228	-	-	-	4,821
Office of The Governor	2	3,451	-	-	-	-	3,451
Sanctuary Inc	1	3,336	-	-	-	-	3,336
Department of Military Affairs/GUARNG	1	2,333	-	-	-	-	2,333
Department of Administration	2	571	103	1,103	-	-	1,776
Department of Mental Health and Substance Abuse	1	1,339	-	-	-	-	1,339
Division of Senior Citizens, DPHSS	2	865	199	152	-	-	1,216
GHURA-Agafa Gumas Park	1	47	33	119	278	327	803
Guam Police Department	1	718	-	-	-	-	718
Guam Veterans Affairs Office	2	483	-	-	-	-	483
Department of Customs & Quarantine	1	374	-	-	-	-	374
Guam Legislature	2	116	134	-	-	-	250
Department of Agriculture-Fisheries	1	123	97	-	-	-	220
The Office of the Dededo Mayor	1	47	92	-	-	-	139
Guam Public Library	3	127	-	-	-	-	127
Merizo Mayor	1	28	-	-	-	-	28
Guam Solid Waste Authority	1	23	-	-	-	-	23
<b>Line Agencies</b>	<b>183</b>	<b>528,856</b>	<b>279,706</b>	<b>54,577</b>	<b>33,428</b>	<b>244,741</b>	<b>1,141,308</b>
<b>Total as of September 30, 2017</b>	<b>232</b>	<b>713,084</b>	<b>442,522</b>	<b>169,120</b>	<b>72,476</b>	<b>396,347</b>	<b>1,793,549</b>
<b>Total as of September 30, 2016</b>	<b>243</b>	<b>1,516,081</b>	<b>325,256</b>	<b>94,308</b>	<b>95,259</b>	<b>717,692</b>	<b>2,748,597</b>
<b>% Increase / (Decrease)</b>	<b>-5%</b>	<b>-53%</b>	<b>36%</b>	<b>79%</b>	<b>-24%</b>	<b>-45%</b>	<b>-35%</b>

**GWA October 17, 2017 Work Session - DIVISION REPORTS**

**GUAM WATERWORKS AUTHORITY**  
**2010 Series Bond Project Status**  
**As of Sept. 30, 2017**

**SCHEDULE J**

PROJECT NAME	ORIGINAL		Adjusted Project	EXPENDITURES AS OF 09/30/17	OUTSTANDING ENCUMBRANCES	TOTAL EXPENDITURES		UNOBLIGATED PROJECT COST	Construction fund balance AS OF 09/30/17					
	APPROVED PROJECT COST	Cost				AND ENCUMBRANCES	ENCUMBRANCES							
Ground Water Disinfection	\$	-	\$	500,000	\$	438,141	\$	61,859	\$	61,859				
"A" Series Well Transmission Line	\$	600,000	\$	518,144	\$	474,434	\$	1,274	\$	475,709	\$	42,435	\$	43,710
Water Booster Pump Station	\$	500,000	\$	500,000	\$	418,844	\$	81,156	\$	500,000	\$	(0)	\$	81,156
Meter Replacement Program	\$	2,500,000	\$	10,300,000	\$	10,254,220	\$	19,409	\$	10,273,628	\$	26,372	\$	45,780
Barrigada Tank Repair/Replacement	\$	-	\$	5,450,000	\$	5,442,302	\$	7,698	\$	5,450,000	\$	0	\$	7,698
Leak Detection	\$	-	\$	200,000	\$	-	\$	200,000	\$	200,000	\$	-	\$	200,000
Potable Water System Planning	\$	200,000	\$	200,000	\$	179,638	\$	20,362	\$	200,000	\$	-	\$	20,362
Implement Ground Water Rule	\$	-	\$	1,700,000	\$	1,499,464	\$	200,535	\$	1,700,000	\$	1	\$	200,536
Brigade II (Ugum Lift) BPS Upgrade	\$	1,200,000	\$	1,700,000	\$	83,395	\$	202,199	\$	285,595	\$	1,414,405	\$	1,616,605
Deep Well Rehabilitation	\$	548,000	\$	548,000	\$	548,000	\$	-	\$	548,000	\$	-	\$	-
New Deep Wells at Down Hard	\$	3,773,000	\$	638,252	\$	485,743	\$	-	\$	485,743	\$	152,509	\$	152,509
Rehabilitation of Asan Springs	\$	900,000	\$	900,000	\$	188,771	\$	152,068	\$	340,838	\$	559,162	\$	711,229
Master Meters	\$	1,600,000	\$	1,600,000	\$	1,421,267	\$	68,690	\$	1,489,957	\$	110,043	\$	178,733
Ugum Water Treatment Plant Intake	\$	3,670,000	\$	700,000	\$	543,615	\$	156,385	\$	700,000	\$	-	\$	156,385
Water Wells	\$	2,000,000	\$	-	\$	-	\$	-	\$	-	\$	-	\$	-
Water Distribution System	\$	384,000	\$	3,174,748	\$	3,174,748	\$	-	\$	3,174,748	\$	(0)	\$	(0)
Pressure Zone Realignment /	\$	3,550,000	\$	-	\$	-	\$	-	\$	-	\$	-	\$	-
Northern System Water Distribution	\$	2,725,000	\$	-	\$	-	\$	-	\$	-	\$	-	\$	-
Central Water Distribution System 2005	\$	1,200,000	\$	900,000	\$	692,926	\$	82,076	\$	775,002	\$	124,998	\$	207,074
Southern Water Distribution System	\$	1,800,000	\$	-	\$	-	\$	-	\$	-	\$	-	\$	-
Mechanical/Electrical Equipment	\$	1,360,000	\$	1,200,000	\$	1,079,495	\$	120,505	\$	1,200,000	\$	(0)	\$	120,505
Water Reservoir Internal/External	\$	500,000	\$	2,000,000	\$	890,583	\$	573,410	\$	1,463,993	\$	536,007	\$	1,109,417
Water Reservoir Internal/External	\$	2,400,000	\$	-	\$	-	\$	-	\$	-	\$	-	\$	-
Water System Reservoirs 2005 Improvements	\$	11,697,000	\$	1,050,000	\$	1,050,000	\$	-	\$	1,050,000	\$	0	\$	0
Distribution System Upgrades	\$	3,182,000	\$	474,160	\$	451,462	\$	22,698	\$	474,160	\$	0	\$	22,698
Ugum Water Treatment Plant Reservoir	\$	3,672,000	\$	-	\$	-	\$	-	\$	-	\$	-	\$	-
Water Audit Program & Water Loss Control Plan	\$	-	\$	100,000	\$	15,031	\$	63,428	\$	78,459	\$	21,541	\$	84,970
Production Plan / Reduce Navy Purchases	\$	-	\$	100,000	\$	94,286	\$	5,714	\$	100,000	\$	-	\$	5,714
Hydraulic Assessment of Tank	\$	-	\$	500,000	\$	497,004	\$	2,996	\$	500,000	\$	-	\$	2,996
Agana Heights & Chaot Tanks	\$	-	\$	4,700,000	\$	4,327,370	\$	372,630	\$	4,700,000	\$	-	\$	372,630
Tank Major Repair Yigo#1 Mangilao#2 Agat#2	\$	-	\$	1,900,000	\$	1,750,355	\$	97,659	\$	1,848,013	\$	51,987	\$	149,645
Tank Major Repair Yigo#1 Mangilao#2 Agat#2	\$	-	\$	-	\$	-	\$	-	\$	-	\$	-	\$	-
Assessment of maloloj Elevetad & Yigo Elevated	\$	-	\$	200,000	\$	200,000	\$	-	\$	200,000	\$	-	\$	-
Public Water System Asser Inventory/Condition Assesment	\$	-	\$	100,000	\$	96,554	\$	3,446	\$	100,000	\$	-	\$	3,446
Public Water System GIS & Mapping	\$	-	\$	50,000	\$	50,000	\$	-	\$	50,000	\$	-	\$	-
Wastewater System Planning	\$	1,500,000	\$	1,500,000	\$	1,465,858	\$	8,142	\$	1,474,000	\$	26,000	\$	34,142
Wastewater Vehicles	\$	235,000	\$	235,000	\$	209,795	\$	25,205	\$	235,000	\$	0	\$	25,205
NDWWTP - Chlorine Tanks	\$	250,000	\$	250,000	\$	250,000	\$	-	\$	250,000	\$	-	\$	-
Turnon Bay Sewer Upgrades	\$	100,000	\$	-	\$	-	\$	-	\$	-	\$	-	\$	-
Wastewater Collection System Repl/Rehab	\$	-	\$	1,105,000	\$	718,036	\$	283,287	\$	1,001,323	\$	103,677	\$	386,964
Facilities Plan/Design for Baza Gardens WWTP	\$	1,250,000	\$	1,250,000	\$	1,239,250	\$	10,750	\$	1,250,000	\$	-	\$	10,750
Facilities Plan/Design for Agat-Santa Rita WWTP	\$	900,000	\$	899,630	\$	881,749	\$	17,881	\$	899,630	\$	-	\$	17,881
Priority 1 Sewer Upgrades – Baza Gardens WWTP	\$	650,000	\$	-	\$	-	\$	-	\$	-	\$	-	\$	-
Baza Gardens STP Replacement	\$	3,567,000	\$	1,301,947	\$	268,150	\$	48,850	\$	317,000	\$	984,947	\$	1,033,797
Facilities Plan/Design for Umatac Merizo WWTP	\$	-	\$	900,000	\$	683,211	\$	170,646	\$	853,858	\$	46,142	\$	216,789
Agat/Santa Rita STP Replacement	\$	2,968,000	\$	2,218,000	\$	2,215,591	\$	2,109	\$	2,217,701	\$	300	\$	2,409
Northern District WWTP Primary Treatment Upgrades	\$	-	\$	11,750,000	\$	11,363,439	\$	211,161	\$	11,574,600	\$	175,400	\$	386,561
Biosolids Management Plan	\$	-	\$	200,000	\$	196,414	\$	3,586	\$	200,000	\$	-	\$	3,586
Agana WWTP Interim Measures	\$	-	\$	11,500,000	\$	11,242,386	\$	57,614	\$	11,300,000	\$	200,000	\$	257,614
I&I SSES Southern	\$	-	\$	800,000	\$	733,872	\$	66,129	\$	800,000	\$	(0)	\$	66,128
I&I SSES Central	\$	-	\$	850,000	\$	794,325	\$	55,675	\$	850,000	\$	-	\$	55,675
I&I SSES Northern	\$	-	\$	-	\$	-	\$	-	\$	-	\$	-	\$	-
Umatac Merizo Replacement	\$	-	\$	250,000	\$	247,431	\$	2,569	\$	250,000	\$	-	\$	2,569
Northern District WWTP Secondary Treatment Upgrades	\$	-	\$	1,000,000	\$	-	\$	-	\$	-	\$	-	\$	1,000,000
Well Electrical Protection	\$	26,000	\$	-	\$	-	\$	-	\$	-	\$	-	\$	-
SCADA Pilot Project	\$	300,000	\$	61,950	\$	19,812	\$	42,138	\$	61,950	\$	(0)	\$	42,138
Electrical Upgrade - Water Wells	\$	3,000,000	\$	354,227	\$	335,378	\$	18,849	\$	354,227	\$	0	\$	18,849
Electrical Upgrade - Water Booster	\$	325,000	\$	-	\$	-	\$	-	\$	-	\$	-	\$	-
Electrical Upgrade -Water Booster	\$	350,000	\$	-	\$	-	\$	-	\$	-	\$	-	\$	-
Electrical Upgrade - Other Water	\$	250,000	\$	-	\$	-	\$	-	\$	-	\$	-	\$	-
SCADA Improvements – Phase 1	\$	250,000	\$	250,000	\$	193,989	\$	56,011	\$	250,000	\$	-	\$	56,011
SCADA Improvements – Phase 2	\$	1,100,000	\$	1,056,986	\$	1,027,424	\$	29,562	\$	1,056,986	\$	-	\$	29,562
SCADA Improvements – Phase 3	\$	2,500,000	\$	24,956	\$	24,956	\$	-	\$	24,956	\$	0	\$	0
SCADA Improvements – Phase 4	\$	850,000	\$	-	\$	-	\$	-	\$	-	\$	-	\$	-
Laboratory Modernization	\$	1,200,000	\$	-	\$	-	\$	-	\$	-	\$	-	\$	-
Land Survey	\$	1,500,000	\$	500,000	\$	461,986	\$	37,701	\$	499,687	\$	313	\$	38,014
General Plant Improvements / Water	\$	14,370,000	\$	7,241,000	\$	7,241,000	\$	0	\$	7,241,000	\$	0	\$	0
Interest Earned	\$	-	\$	-	\$	-	\$	-	\$	-	\$	-	\$	59,011
Total Construction Fund (2010 Series Revenue Bond)	\$	87,402,000	\$	87,402,000	\$	78,161,700	\$	3,664,061	\$	81,825,761	\$	4,576,239	\$	9,299,311

- 1.) PUC's Docket 11-01 \$29,000,000.00 dated 09/19/11 authorized GWA for reallocation  
2.) PUC's Docket 11-01 Reallocation of \$23,246,000.00 dated 07/30/12  
3.) PUC's Docket Reallocation dated February 2013

GWA October 17, 2017 Work Session - DIVISION REPORTS

**GUAM WATERWORKS AUTHORITY**  
**2013 Series Bond Project Status**  
**As of Sept. 30, 2017**

**SCHEDULE K**

PROJECT NAME	ORIGINAL		Adjusted Project Cost	EXPENDITURES AS OF 09/30/17	OUTSTANDING ENCUMBRANCES	TOTAL EXPENDITURES AND		UNOBLIGATED PROJECT COST	Construction fund balance	
	APPROVED PROJECT COST					ENCUMBRANCES			AS OF 09/30/17	
Santa Rita Springs Booster Pump Rehab Phase II	\$ 100,000	\$ 100,000		24,098	75,902	\$ 100,000	\$ -	\$ 75,902		
"A" Series Well Transmission Line	\$ 400,000	\$ 400,000		314,479	55,367	\$ 369,846	\$ 30,154	\$ 85,521		
Water Booster Pump Station	\$ 6,000,000	\$ 1,861,000		1,656,428	23,536	\$ 1,679,964	\$ 181,036	\$ 204,572		
Meter Replacement Program		\$ 999,000		996,532	-	\$ 996,532	\$ 2,468	\$ 2,468		
Barriqada Tank Repair/Replacement	\$ 6,000,000	\$ 4,987,000		4,924,959	62,041	\$ 4,987,000	\$ 0	\$ 62,041		
Leak Detection	\$ 100,000	\$ 20,000		16,916	-	\$ 16,916	\$ 3,084	\$ 3,084		
Potable Water System Planning	\$ 800,000	\$ 624,000		598,825	25,175	\$ 624,000	\$ -	\$ 25,175		
Implement Ground Water Rule	\$ 1,000,000	\$ 1,000,000		1,000,000	-	\$ 1,000,000	\$ -	\$ -		
Deep Well Rehabilitation	\$ 800,000	\$ 200,000		189,930	10,071	\$ 200,000	\$ (0)	\$ 10,070		
New Deep Wells at Down Hard	\$ 2,000,000	\$ 810,000				\$ -	\$ 810,000	\$ 810,000		
Master Meters	\$ 4,000,000	\$ 784,000		531,188	180,872	\$ 712,060	\$ 71,940	\$ 252,812		
Uqum Water Treatment Plant Intake	\$ 1,000,000	\$ 982,000		578,858	280,943	\$ 859,801	\$ 122,199	\$ 403,142		
Water Wells	\$ 4,200,000	\$ 4,200,000		2,274,832	750,914	\$ 3,025,746	\$ 1,174,254	\$ 1,925,168		
Water Distribution System	\$ 12,000,000	\$ 11,151,000		4,366,442	4,680,418	\$ 9,046,860	\$ 2,104,140	\$ 6,784,558		
Pressure Zone Realignment /	\$ 1,000,000	\$ 431,000		321,651	1,074	\$ 322,725	\$ 108,275	\$ 109,349		
Mechanical/Electrical Equipment	\$ 430,000	\$ 430,000		328,686	98,112	\$ 426,798	\$ 3,202	\$ 101,314		
Water Reservoir Internal/External	\$ 800,000	\$ -				\$ -	\$ -	\$ -		
Water System Reservoirs 2005 Improvements	\$ 21,000,000	\$ 13,878,000		9,052,791	4,695,985	\$ 13,748,776	\$ 129,224	\$ 4,825,209		
Uqum Water Treatment Plant Reservoir	\$ 7,000,000	\$ 90,000				\$ -	\$ 90,000	\$ 90,000		
Aqana Heights & Chaot Tanks	\$ 4,500,000	\$ 3,280,000		233,265	47,022	\$ 280,287	\$ 2,999,713	\$ 3,046,735		
Tank Major Repair Yigo#1 Mangilao#2 Aqat#2	\$ 13,500,000	\$ 11,605,000		847,731	10,757,269	\$ 11,605,000	\$ 0	\$ 10,757,270		
Tank Major Repair Yigo#1 Manqillao#2 Aqat#2	\$ 8,000,000	\$ -				\$ -	\$ -	\$ -		
Assessment of maloilo Elevated & Yigo Elevated	\$ 500,000	\$ 485,117		461,813	23,304	\$ 485,117	\$ -	\$ 23,304		
Fire Hydrant Replacement Program	\$ -	\$ -				\$ -	\$ -	\$ -		
Wastewater System Planning	\$ 800,000	\$ 651,000		550,480	100,520	\$ 651,000	\$ (0)	\$ 100,520		
Lift Station Upgrades	\$ 5,000,000	\$ 946,000		561,748	363	\$ 562,111	\$ 383,889	\$ 384,252		
Wastewater Collection System Repl/Rehab	\$ 6,500,000	\$ 780,000		476,682	168,631	\$ 645,314	\$ 134,687	\$ 303,318		
Baza Gardens STP Replacement		\$ 3,114,883		889,234	2,225,634	\$ 3,114,869	\$ 15	\$ 2,225,649		
Facilities Plan/Design for Umatac-Merizo WWTP		\$ 473,000		335,000	36,699	\$ 371,699	\$ 101,301	\$ 138,000		
Agat/Santa Rita STP Replacement	\$ 19,000,000	\$ 67,200,000		28,903,287	38,296,713	\$ 67,200,000	\$ 0	\$ 38,296,713		
Agana WWTP Interim Measures		\$ 673,000		548,597	124,403	\$ 673,000	\$ (0)	\$ 124,403		
Umatac Merizo Replacement	\$ 2,000,000	\$ -				\$ -	\$ -	\$ -		
Wastewater Pump Station Electrical Upgrade	\$ 620,000	\$ 620,000		91,348	8,513	\$ 99,861	\$ 520,139	\$ 528,652		
Electrical Upgrade - Water Wells	\$ 1,500,000	\$ 1,500,000		1,480,769	19,230	\$ 1,500,000	\$ 0	\$ 19,231		
Electrical Upgrade - Water Booster	\$ 325,000	\$ 2,000				\$ -	\$ 2,000	\$ 2,000		
Electrical Upgrade - Water Booster	\$ 350,000	\$ 200,000		977	-	\$ 977	\$ 199,023	\$ 199,023		
Electrical Upgrade - Other Water	\$ 250,000	\$ 150,000		60,700	-	\$ 60,700	\$ 89,300	\$ 89,300		
SCADA Improvements - Phase 3	\$ 1,850,000	\$ 923,000		427,949	294,410	\$ 722,359	\$ 200,641	\$ 495,051		
SCADA Improvements - Phase 4	\$ 500,000	\$ -				\$ -	\$ -	\$ -		
Laboratory Modernization	\$ 1,500,000	\$ 1,173,000		1,061,199	110,266	\$ 1,171,465	\$ 1,535	\$ 111,801		
Land Survey	\$ 2,000,000	\$ 2,000		1,038	15	\$ 1,053	\$ 948	\$ 963		
General Plant Improvements / Water	\$ 2,000,000	\$ 2,600,000		1,265,043	1,176,695	\$ 2,441,737	\$ 158,263	\$ 1,334,957		
Allowance for COI								\$ 275,005		
Interest Earned								\$ 272,619		
<b>Total Construction Fund (2013 Series Revenue Bond)</b>	<b>\$ 139,325,000</b>	<b>\$ 139,325,000</b>	<b>\$ 65,373,475</b>	<b>\$ 64,330,097</b>	<b>\$ 129,703,572</b>	<b>\$ 9,621,428</b>	<b>\$ 74,499,150</b>			

PUC's Docket 14-04 dated February 25, 2014

GWA October 17, 2017 Work Session - DIVISION REPORTS

GUAM WATERWORKS AUTHORITY  
2014 Series Refunded Bond Project Status  
As of Sept. 30, 2017

SCHEDULE L

PROJECT NAME	ORIGINAL APPROVED PROJECT	ADJUSTED PROJECT COST	EXPENDITURES AS OF 09/30/17	OUTSTANDING ENCUMBRANCES	TOTAL EXPENDITURES AND ENCUMBRANCES	UNOBLIGATED PROJECT COST	20% PUC AS OF 09/30/17	Construction fund balance AS OF 09/30/17
Agana Treatment Plant	\$ 10,475,000	\$ 11,065,512	11,065,512	\$ -	\$ 11,065,512	\$ (0)	\$ 2,095,000	\$ (0)
Agana Outfall	\$ 5,030,000	\$ 10,127,198	10,127,198	\$ -	\$ 10,127,198	\$ 0	\$ 1,006,000	\$ 0
Northern District (Outfall)	\$ 4,700,000	\$ 10,251,423	10,251,423	\$ -	\$ 10,251,423	\$ 0	\$ 940,000	\$ 0
Northern District WWTP Upgrade		\$ 173,681	173,681		\$ 173,681	\$ -		\$ -
Northern Treatment Plant		\$ -	-		\$ -	\$ -		\$ -
Baza Gardens Wastewater Treatment Plant	\$ 500,000	\$ 297,177	297,177	\$ -	\$ 297,177	\$ (0)	\$ 100,000	\$ (0)
Interim Disinfection Facilities	\$ 581,000	\$ 3,437,311	3,408,599	\$ 28,712	\$ 3,437,311	\$ (0)	\$ 116,200	\$ 28,712
Electrical Protection	\$ 1,000,000	\$ 1,512,483	1,512,483.3	\$ -	\$ 1,512,483	\$ (0)	\$ 200,000	\$ (0)
Well Vulnerability Reduction	\$ 600,000	\$ 185,522	185,522	\$ -	\$ 185,522	\$ 0	\$ 120,000	\$ 0
Old Agat Wastewater Collection (I/I Reductio	\$ 2,155,000	\$ 1,931,659	1,931,659	\$ -	\$ 1,931,659	\$ (0)	\$ 431,000	\$ (0)
Chaot WW Pump Station/Collection System	\$ 410,000	\$ 399,120	399,120	\$ -	\$ 399,120	\$ -	\$ 82,000	\$ -
Lift Station Upgrades	\$ 230,000	\$ 149,895	149,895	\$ -	\$ 149,895	\$ 0	\$ 46,000	\$ 0
Collection Line Upgrades	\$ 200,000	\$ 62,755	62,755	\$ -	\$ 62,755	\$ 0	\$ 40,000	\$ 0
"A" Well Transmission Line	\$ 2,413,000	\$ 3,833,175	3,790,888	\$ 42,287	\$ 3,833,175	\$ (0)	\$ 482,600	\$ 42,287
Santa Rita Springs - Booster Pump Rehab.	\$ 648,000	\$ 306,841	306,841	\$ -	\$ 306,841	\$ (0)	\$ 129,600	\$ (0)
Fena Bypass Transmission line		\$ 160,913	160,913	\$ -	\$ 160,913	\$ (0)	\$ -	\$ (0)
Storage Additions	\$ 950,000	\$ -	-		\$ -	\$ -	\$ 190,000	\$ -
Booster Station Upgrades	\$ 390,000	\$ 66,734	66,734	\$ -	\$ 66,734	\$ -	\$ 78,000	\$ -
Mangilao Tank Repair	\$ 800,000	\$ 398,367	397,933	\$ 434	\$ 398,367	\$ (0)	\$ 160,000	\$ 434
Ugum Tank Replacement	\$ 2,500,000	\$ -	-		\$ -	\$ -	\$ 500,000	\$ -
Ugum WTPlant Refurbishment (\$1.724,970EPA)		\$ 6,588,473	6,531,525	\$ 56,949	\$ 6,588,473	\$ (0)		\$ 56,948
Barrigada Tank Repair/Replacement	\$ 3,000,000	\$ 65,019	65,019	\$ -	\$ 65,019	\$ 0	\$ 600,000	\$ 0
Water Reservoir Condition Assessment		\$ 1,250,000	1,249,227.16	\$ 772	\$ 1,250,000	\$ 0	\$ -	\$ 773
EarthTech Well Buyout	\$ 5,000,000	\$ 5,975,000	5,975,000	\$ -	\$ 5,975,000	\$ -	\$ 1,000,000	\$ -
Water Wastewater Master Plan	\$ 4,900,000	\$ 4,881,308	4,881,308	\$ -	\$ 4,881,308	\$ 0	\$ 980,000	\$ 0
Laboratory Modernization	\$ 800,000	\$ 135,055	135,055	\$ -	\$ 135,055	\$ 0	\$ 160,000	\$ 0
Land Survey	\$ 800,000	\$ 577,836	565,670	\$ 12,166	\$ 577,836	\$ 0	\$ 160,000	\$ 12,166
Ground Water Disinfection		\$ -	-		\$ -	\$ -		\$ -
GWUDI Study		\$ 262,234	260,430	\$ 1,804	\$ 262,234	\$ -		\$ 1,804
Contingency	\$ 12,276,023	\$ 154	-	\$ -	\$ -	\$ -		\$ 732
Vehicles	\$ 1,100,000	\$ 1,280,000	2,130,305	\$ (850,305)	\$ 1,280,000	\$ -	\$ 220,000	\$ -
Generation Equipment	\$ 700,000	\$ 880,000	2,712	\$ 877,288	\$ 880,000	\$ 0		\$ 27,033
Leak Detection/Line Replacement	\$ 8,200,000	\$ 5,988,494	5,988,494	\$ -	\$ 5,988,494	\$ -	\$ 1,640,000	\$ -
Automated Meter Reading	\$ 12,572,063	\$ 17,468,359	16,870,522	\$ 537,157	\$ 17,468,359.32	\$ 0	\$ 2,514,413	\$ 597,837
Total Construction Fund (2014 Series Refu	\$ 82,930,086	\$ 89,711,698	88,891,990	\$ 758,873.38	\$ 89,711,543	\$ 1	\$ 13,990,813	\$ 768,726
Interest Earned	\$ 6,781,612	\$ (0)				\$ (0)		\$ 2,555
Total Project Cost Funding	\$ 89,711,698	\$ 89,711,698	88,891,990	\$ 758,873.38	\$ 89,711,543	\$ 1	\$ 13,990,813	\$ 771,282

## GWA October 17, 2017 Work Session - DIVISION REPORTS

GUAM WATERWORKS AUTHORITY  
2016 Series Bond Project Status  
As of Sept. 30, 2017

## SCHEDULE M

PROJECT NAME	ORIGINAL APPROVED PROJECT COST	Adjusted Project Cost	EXPENDITURES AS OF 09/30/17	OUTSTANDING ENCUMBRANCES	TOTAL EXPENDITURES AND ENCUMBRANCES	UNOBLIGATED PROJECT COST	Construction fund balance AS OF 09/30/17
Water Booster Pump Station	\$ 4,139,000	\$ 4,139,000			\$ -	\$ 4,139,000	\$ 4,139,000
Meter Replacement Program	\$ 4,501,000	\$ 4,501,000		150,000.00	\$ 150,000	\$ 4,351,000	\$ 4,501,000
Barriqada Tank Repair/Replacement	\$ 1,013,000	\$ 1,013,000		-	\$ -	\$ 1,013,000	\$ 1,013,000
Leak Detection	\$ 1,180,000	\$ 1,180,000		-	\$ -	\$ 1,180,000	\$ 1,180,000
Potable Water System Planning	\$ 2,276,000	\$ 2,276,000	159,105	317,188.58	\$ 476,294	\$ 1,799,706	\$ 2,116,895
Deep Well Rehabilitation	\$ 250,000	\$ 250,000		-	\$ -	\$ 250,000	\$ 250,000
New Deep Wells at Down Hard	\$ 1,190,000	\$ 1,190,000			\$ -	\$ 1,190,000	\$ 1,190,000
Master Meters	\$ 3,616,000	\$ 3,616,000		151,539.00	\$ 151,539	\$ 3,464,461	\$ 3,616,000
Uqum Water Treatment Plant Intake	\$ 18,000	\$ 18,000			\$ -	\$ 18,000	\$ 18,000
Water Wells	\$ 2,500,000	\$ 2,500,000			\$ -	\$ 2,500,000	\$ 2,500,000
Water Distribution System	\$ 2,049,000	\$ 49,000			\$ -	\$ 49,000	\$ 49,000
Pressure Zone Realignment /	\$ 1,141,000	\$ 1,141,000			\$ -	\$ 1,141,000	\$ 1,141,000
Mechanical/Electrical Equipment	\$ 100,000	\$ 100,000			\$ -	\$ 100,000	\$ 100,000
Water Reservoir Internal/External	\$ 800,000	\$ 800,000			\$ -	\$ 800,000	\$ 800,000
Water System Reservoirs 2005 Improvements	\$ 42,350,000	\$ 28,350,000	456,038	1,893,343.00	\$ 2,349,381	\$ 26,000,620	\$ 27,893,963
Uqum Water Treatment Plant Reservoir	\$ 6,410,000	\$ -			\$ -	\$ -	\$ -
Water Audit Program & Water Loss Control Plan	\$ 1,000,000	\$ 1,000,000			\$ -	\$ 1,000,000	\$ 1,000,000
Aqana Heights & Chaot Tanks	\$ 1,220,000	\$ 1,220,000			\$ -	\$ 1,220,000	\$ 1,220,000
Tank Major Repair Yiqo#1 Manqilao#2 Aqat#2	\$ 1,895,000	\$ 1,895,000			\$ -	\$ 1,895,000	\$ 1,895,000
Tank Major Repair Yiqo#1 Manqilao#2 Aqat#2	\$ 10,500,000	\$ 7,409,830		1,822,132.80	\$ 1,822,133	\$ 5,587,697	\$ 7,409,830
Fire Hydrant Replacement Program	\$ 2,000,000	\$ 2,000,000			\$ -	\$ 2,000,000	\$ 2,000,000
					\$ -	\$ -	
Wastewater System Planning	\$ 349,000	\$ 349,000	30,708	282,274.77	\$ 312,983	\$ 36,017	\$ 318,292
Lift Station Upgrades	\$ 2,404,000	\$ 2,404,000	17,800	200,000.00	\$ 217,800	\$ 2,186,200	\$ 2,386,200
Wastewater Collection System Repl/Rehab	\$ 2,920,000	\$ 2,920,000			\$ -	\$ 2,920,000	\$ 2,920,000
Baza Gardens STP Replacement	\$ 16,700,000	\$ 29,400,170	4,871,711	24,327,379.80	\$ 29,199,091	\$ 201,079	\$ 24,528,459
Facilities Plan/Design for Umatac-Merizo WWTP	\$ 527,000	\$ 527,000	190,947	61,158.47	\$ 252,105	\$ 274,895	\$ 336,053
Aqat/Santa Rita STP Replacement	\$ 3,000,000	\$ 3,000,000	337,891	348,827.64	\$ 686,719	\$ 2,313,281	\$ 2,662,109
Aqana WWTP Interim Measures	\$ 827,000	\$ 827,000			\$ -	\$ 827,000	\$ 827,000
Umatac Merizo Replacement	\$ 8,000,000	\$ 20,800,000	199,684	20,574,598.47	\$ 20,774,282	\$ 25,718	\$ 20,600,316
					\$ -	\$ -	
Wastewater Pump Station Electrical Upgrade	\$ 100,000	\$ 100,000			\$ -	\$ 100,000	\$ 100,000
Electrical Upgrade - Water Wells	\$ 650,000	\$ 650,000			\$ -	\$ 650,000	\$ 650,000
Electrical Upgrade - Water Booster	\$ 323,000	\$ 323,000			\$ -	\$ 323,000	\$ 323,000
SCADA Improvements – Phase 3	\$ 1,177,000	\$ 1,177,000		432,705.00	\$ 432,705	\$ 744,295	\$ 1,177,000
SCADA Improvements – Phase 4	\$ 6,500,000	\$ 6,500,000			\$ -	\$ 6,500,000	\$ 6,500,000
					\$ -	\$ -	
Laboratory Modernization	\$ 1,127,000	\$ 1,127,000	956,458	170,541.65	\$ 1,127,000	\$ -	\$ 170,542
Land Survey	\$ 1,998,000	\$ 1,998,000		1,246,376.39	\$ 1,246,376	\$ 751,624	\$ 1,998,000
General Plant Improvements / Water	\$ 2,769,463	\$ 2,769,463	120,192	1,357,138.23	\$ 1,477,330	\$ 1,292,133	\$ 2,649,271
Information Technology Integration Improvements	\$ 500,000	\$ 500,000	244,068	-	\$ -	\$ 500,000	\$ 255,932
Interest Earned		\$ -					\$ 376,587
		\$ -					
<b>Total Construction Fund (2016 Series Revenue Bond)</b>	<b>\$ 140,019,463</b>	<b>\$ 140,019,463</b>	<b>\$ 7,584,601</b>	<b>\$ 53,335,204</b>	<b>\$ 60,675,737</b>	<b>\$ 79,343,726</b>	<b>\$ 132,811,448</b>

**GUAM WATERWORKS AUTHORITY**  
**Schedule of Series 2010, 2013, 2014 Refunding and 2016 Bond Bank Accounts**  
**As of September 30, 2017**

**SCHEDULE N****9/30/2017****BANK OF GUAM**

BOG - Revenue Account	7,782,227
BOG - Operations and Maintenance Reserve	3,083,482
BOG - Operations, Maintenance, Renewal and Replacement Reserve Fund	17,423,213
BOG - Capital Improvement Fund	5,598
BOG - O & M Reserve	13,516,540
BOG - Debt Service Reserve	11,217,733
BOG - CAPEX Reserve	15,462,869
<b>Total BOG Bank Account Balance</b>	<b>68,491,662</b>

**Series 2010 Bond:**

BOG - Construction Account	9,299,311
USB - Debt Service Fund	2,020,121
USB - Debt Service Reserve Fund	7,566,460
<b>Total Series 2010 Bond Bank Balance</b>	<b>18,885,892</b>

**Series 2013 Bond:**

BOG - Construction Fund	74,499,150
BOG - Capitalized Interest Fund	-
USB - Debt Service Fund	2,336,754
USB - Debt Service Reserve Fund	12,031,688
<b>Total Series 2013 Bond Bank Balance</b>	<b>88,867,592</b>

**Series 2014 Refunding Bond:**

BOG - Construction Fund	771,281
USB - Debt Service Fund	1,796,559
USB - Debt Service Reserve Fund	7,707,602
<b>Total Series 2014 Refunding Bond Bank Balance</b>	<b>10,275,442</b>

**Series 2016 Bond:**

BOG - Construction Account	132,811,449
BOG - Capitalized Interest Fund	1,782,982
BOG - Cost of Issuance Fund	-
USB - Debt Service Fund	130
USB - Debt Service Reserve Fund	7,582,725
<b>Total Series 2016 Bond Bank Balance</b>	<b>142,177,286</b>





## Guam Waterworks Authority

## VEHICLE FLEET STATUS

10/13/2017

EQUIPMENT STATUS					SUMMARY						
Description	Number of Equipment	Number of Equipment Available	Number of Equipment Not Available	Percentage	Operational	Operational w/Rprs Pending	In Shop-Accident Repairs	In Shop-Assessment Pending	In Shop-Repairs Pending	In Shop-Vendor Repairs	Recommend Survey
Backhoe	5	1	4	20%	1	0	0	0	2	1	1
Bobcat	1	1	0	100%	1	0	0	0	0	0	0
Boom Truck	2	1	1	50%	1	0	0	0	1	0	0
Crane	2	0	2	0%	0	0	0	0	0	1	1
Dump Truck	3	1	2	33%	1	0	0	1	1	0	0
Flat Bed	1	0	1	0%	0	0	0	0	0	0	1
Forklift	7	6	1	86%	6	0	0	0	0	0	1
Fuel Tanker	1	1	0	100%	1	0	0	0	0	0	0
Heavy Duty	3	1	2	33%	1	0	0	0	0	1	1
Light	150	107	43	71%	104	3	2	6	4	8	23
Mini Backhoe	4	2	2	50%	2	0	0	0	2	0	0
Pumper Truck	1	0	1	0%	0	0	0	0	0	1	0
Sludge Truck	4	2	2	50%	1	1	0	0	2	0	0
Tow	1	0	1	0%	0	0	0	0	0	0	1
Tractor	2	1	1	50%	1	0	0	0	0	1	0
Trailer	12	9	3	75%	8	1	0	0	0	1	2
Trencher	1	1	0	100%	1	0	0	0	0	0	0
Vaccon	1	1	0	100%	1	0	0	0	0	0	0
Vacuum Truck	3	2	1	67%	2	0	0	0	0	1	0
Water Buffalo	2	2	0	100%	2	0	0	0	0	0	0
Water Tanker	5	4	1	80%	4	0	0	0	0	0	1
Total	211	143	68		138	5	2	7	12	15	32

GWA October 17, 2017 Work Session - DIVISION REPORTS

Guam Waterworks Authority		Date: 10/13/2017		 <b>GUAM WATERWORKS AUTHORITY</b> WATER DISTRIBUTION FACILITIES REPORT
		Time:		
REVIEWS				
TOTAL PUMPS INSTALLED	51	OVERALL AVERAGE	92%	
TOTAL PUMPS OPERATIONAL	47	% OF OPERATING PUMPS	92%	
TOTAL BOOSTER PUMP STATIONS	25			

Northern District													
NO.	FACILITY	PUMP HORSEPOWER	NO OF INSTALLED PUMPS	NO OF OPERATIONAL PUMPS	PUMP AVAILABILITY %	GENERATOR OPERATIONAL FAULT	ATS MANUAL/AUTO	PUMP UNIT REMARKS	WORK ORDER NO.	VALVES, ELECTRICAL, STRUCTURAL REMARKS	WORK ORDER NO.	ESTIMATED REPAIR DATE	PUMP AND MOTOR INVENTORY
1	Gayinero	20	2	2	100%	OP	A						
2	Mataguac	25	2	2	100%	OP	A						
3	Santa Rosa	15	2	2	100%	OP	A						
4	Hyundai	40	2	1	50%	OP	A	Pump # 1 requires pump and motor. Station to undergo renovation during reservoir project.					
5	Access	60	2	2	100%	OP	A						
6	Chin, Palauan	5	2	2	100%	N/A							
7	Nimitz Hill	7.5	2	2	100%	N/A							
8	Adiwag	1.5	2	2	100%	N/A							
9	Pale Kiren	1	1	1	100%	N/A							
10	Uloa/Untalan	1	2	2	100%	OP	A						
11	Late Heights	15	2	2	100%	OP	A						
	<b>TOTAL = 11</b>		<b>21</b>	<b>20</b>	<b>95%</b>								
pump availability =no of operational pumps/no of pumps*100%													

Central District													
NO.	FACILITY	PUMP HORSEPOWER	NO OF INSTALLED PUMPS	NO OF OPERATIONAL PUMPS	PUMP AVAILABILITY %	GENERATOR OPERATIONAL FAULT	ATS MANUAL/AUTO	PUMP UNIT REMARKS	WORK ORDER NO.	VALVES, ELECTRICAL, STRUCTURAL REMARKS	WORK ORDER NO.	ESTIMATED REPAIR DATE	UPDATES
1	Pago	150 / 100	3	2	67%	OP	A	Pump 2 leaking at seal, pump operational, work ongoing.					
2	Brigade	60	3	3	100%	OP	A						
3	Windward Hills	200 / 75	3	2	67%	OP	A	Pump 1 leaking at seal, work ongoing.					
4	Santa Rita Springs	40	2	2	100%	OP	A						
5	Santa Ana (Lower)	25	2	1	50%	N/A							
6	Camacho	1	1	1	100%	N/A							CIP required for new unit and electrical for generator
7	Tenorio	1.5	1	1	100%	N/A							CIP required for new unit and electrical for generator
	<b>Total=7</b>		<b>15</b>	<b>12</b>	<b>80%</b>								
pump availability =no of operational pumps/no of pumps*100%													

Southern District													
NO.	FACILITY	PUMP HORSEPOWER	NO OF INSTALLED PUMPS	NO OF OPERATIONAL PUMPS	PUMP AVAILABILITY %	GENERATOR OPERATIONAL FAULT	ATS MANUAL/AUTO	PUMP UNIT REMARKS	WORK ORDER NO.	VALVES, ELECTRICAL, STRUCTURAL REMARKS	WORK ORDER NO.	ESTIMATED REPAIR DATE	UPDATES
1	Malololj Line	125 / 50	3	3	100%	OP	A						
2	Geus	25	2	2	100%	OP	A						
3	Pigua	7.5	2	2	100%	N/A							
4	Toguan	25	2	2	100%	OP	A						
5	WBP-2	25	2	2	100%	OP	A						
6	WBP-1	5	2	2	100%	OP	A						
7	Malololj Elevated	15	2	2	100%	OP	A						
	<b>Total=7</b>		<b>15</b>	<b>15</b>	<b>100%</b>								
pump availability =no of operational pumps/no of pumps*100%													